Tier 1. Investment in flexibility

MMCS final project | Group 15 | Technical report section

Conditional investment case. In the 2023 design year, economic allocation selects 20 MW of electrolysis and no battery, yielding £8.57m/year of equivalent incremental value at the reference hydrogen netback. Prioritising same-day electricity sales selects zero investment. A firm offtake agreement and permission to redirect saleable electricity determine which case applies.

1. System boundary and opportunity

We use the brief's constructed system [1]. Daily supply combines reported generation and the separately provided simulated wind farm. Demand limits total electricity sales. Existing generation is fixed, electricity imports are excluded, and unused energy has zero value. The objective is incremental project value against the same policy's zero-investment schedule. A wind-farm-only boundary is tested in Section 4.

Repaired input v2 contains 2,452 aligned days from January 2020 to September 2026 [2]. Fuel components reconcile to reported generation. We convert daily mean MW to MWh with 24 hours and use the corrected £/MWh column, deflated by monthly CPI. Design uses all 365 days of 2023. The fixed investment is replayed on complete later years.

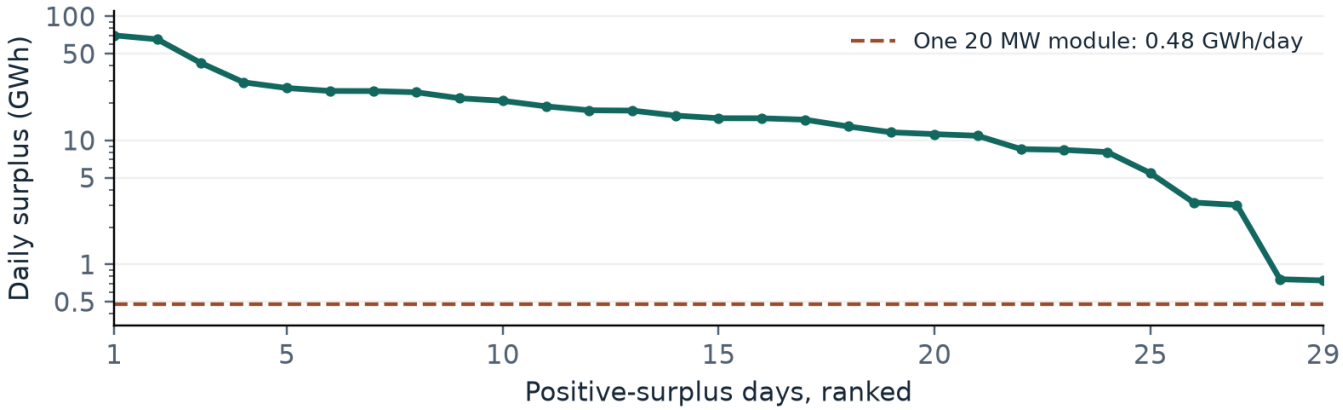


Figure 1. 2023 surplus duration. Only 29 days have a positive physical surplus. Their total is 549.94 GWh and their median is 15.09 GWh. All 336 other days have zero surplus and are omitted from this logarithmic plot.

Reference assumptions in 2020 pounds

Input	Assumption used
Battery	1.5 MW / 3 MWh modules, 20-80% state of charge, 90% round-trip efficiency, £256k/MWh installed, £14.9k/MW-year fixed costs, 15-year life.
Electrolyser	20 MW modules, 20-100% online loading, 55.9 kWh/kg. £29.21m per module, £0.52m/year fixed costs, £9.79m stack proxy in years 11 and 22, 30-year life.
Economics	5% real discount rate. £7.799/kg netback with a 10 t/day offtake limit is a policy-supported reference scenario. Market terms and access to support remain investment conditions.

Installed electrolyser cost uses the converted midpoint of the IEA benchmark. Fixed operating and stack costs use separate UK legacy proxies. The underlying cost ranges and conversion assumptions are documented in [3].

2. Investment model and matched comparison

Choose integer battery and electrolyser counts b and n. For day t, let q, c, r and h denote direct sale, charge, discharge and electrolysis input in MWh. Supply is G and demand is D. z counts online electrolyser modules and L caps daily hydrogen sales in kg. The core mixed-integer linear program is implemented in Python/FICO Xpress.

$$\text{Maximise } \Sigma_t[p_t(q_t + r_t) + vh_t/0.0559] - a_B b - a_H n.$$
$$q_t + c_t + h_t \le G_t \quad \text{and} \quad q_t + r_t \le D_t.$$
$$96z_t \le h_t \le 480z_t, \quad z_t \text{ integer}, \quad 0 \le z_t \le n, \quad h_t/0.0559 \le L.$$
$$c_t \le 1.8b/\eta, \quad r_t \le 1.8b\eta, \quad \Sigma r_t = 0.90\Sigma c_t, \quad \eta = \sqrt{0.90}.$$

In the annual objective, p is £/MWh, v is £/kg, and a_B, a_H are annualised costs per module. Policy **A** allows economic allocation. Policy **B** fixes direct sales to min(G, D), including on negative-price days. Flows are nonnegative. The Tier 1 annual pool relaxes the ordering of storage transfers. Fixed battery schedules are checked with chronological stock and empty initial and terminal usable inventory.

2023 portfolio	A BESS/H_2 MW	A Δ £m/yr	B BESS/H_2 MW	B Δ £m/yr
No investment	0 / 0	+0.00	0 / 0	+0.00
Battery only	0 / 0	+0.00	0 / 0	+0.00
Hydrogen only	0 / 20	+8.57	0 / 0	+0.00
Joint choice	0 / 20	+8.57	0 / 0	+0.00
Fixed reference module	0 / 20	+8.57	0 / 20	-1.07

Table 1. BESS denotes battery energy storage system. Gains use the policy-matched zero-investment reference and equivalent annual costs, in 2020 pounds.

The same 20 MW module run by a simple sale-first rule loses £1.07m/year in 2023. Optimising its use in A improves the result by £9.64m/year. Both use the same day data and capital cost. With no battery, this improvement comes from how today's power is allocated.

Battery economics and physical check

Without a sales floor, removing a battery leaves direct sales and hydrogen feasible and deletes only its discharge revenue. Even with free charging and full discharge every day at positive prices, one module earns at most £48.7k/year in 2023. Its annual cost is £96.4k. The bound rules out storage in both policies in 2023-25 under the stated daily throughput. With one forced module in A, the pool gives £-83.1k/year and the stock check gives £-92.0k/year. Stock-based operating value of £4.3k/year falls below fixed operating cost of £22.3k/year even at zero purchase cost.

3. What changes the investment decision?

In A, the selected electrolyser consumes 171.84 GWh and produces 3,074 t of hydrogen. Relative to no investment, 13.92 GWh comes from reduced unused electricity and 157.92 GWh from displaced direct sales. Only 8.1% of the input can be assigned to physical surplus under a surplus-first convention, capturing 2.53% of annual surplus.

Fuel totals alone allow 0-13.92 GWh of the captured surplus to be attributed to wind and solar, depending on source allocation. The bound assigns captured energy within the available wind/solar and other-generation volumes each day. The site-only sensitivity constrains device input to the simulated wind profile.

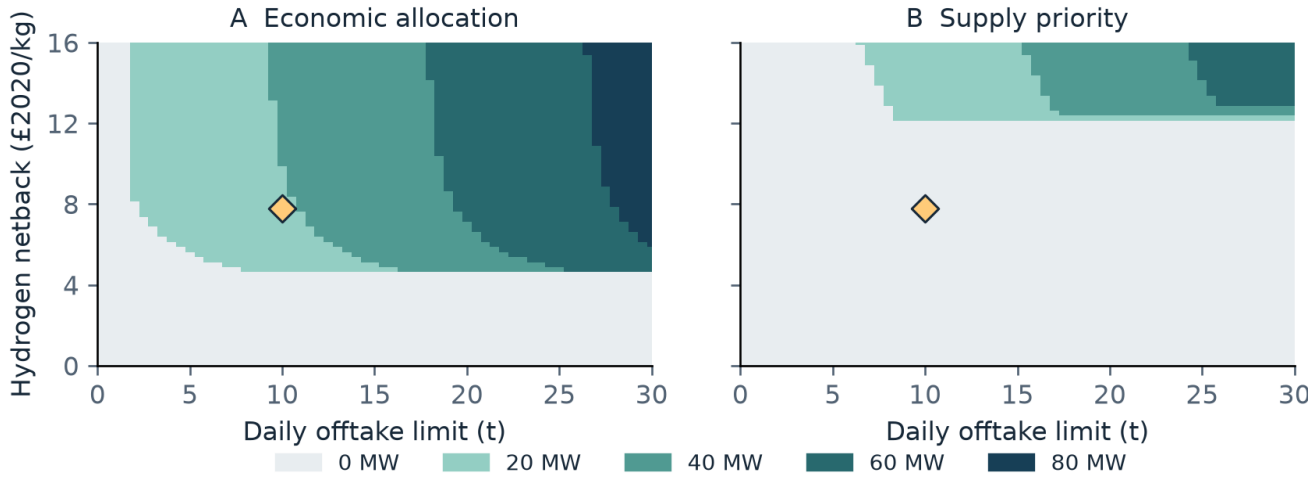


Figure 2. 2023 investment trigger map. Each cell selects the number of 20 MW modules with greatest annual gain, including zero. Gold diamonds mark the reference netback and offtake limit. Positive-price sellable electricity carries its full opportunity cost.

At 10 t/day offtake, the break-even netback for a fixed 20 MW module is £4.61/kg in A and £12.08/kg in B. With no battery, the map is obtained by enumerating active modules and checking each daily loading interval's endpoints and its direct-sales kink. Eight selected map cells agree with the full Xpress model. The offtake limit caps sales and the netback represents value after variable non-power costs.

Price of retaining electricity sales

Share of foregone sales restored	Sales given up (GWh)	H_2 MW	Δ £m/year
0%	157.92	20	+8.57
25%	118.44	20	+7.46
50%	78.96	20	+5.19
75%	39.48	20	+2.46
100%	0.00	0	+0.00

Table 2. Annual sales floors in A. Restoring half the 157.92 GWh foregone under free dispatch retains £5.19m/year of gain. Restoring all sales selects no new asset. B is a daily priority rule, while these floors allow the operator to choose which days to preserve sales.

4. Robustness and investment recommendation

A fixed 20 MW module is evaluated on each historical year at identical cost and offtake assumptions. The site boundary assigns background generation first to demand, makes only residual demand available to the wind farm and restricts device input to its wind output. These are matched incremental comparisons within each boundary.

Fixed 20 MW replay	A Δ £m/year	B Δ £m/year
2022	+8.91	+7.31
2023	+8.57	-1.07
2024	+11.95	-1.00
2025	+13.17	+4.48
2025, £4/kg and 5 t/day	-0.24	-0.77
2023, wind site boundary	+8.17	-1.07

B's 2025 break-even netback falls to £3.13/kg at 10 t/day as surplus opportunities increase. The 2025 contract downside reverses both investment cases. A's 2023 gain remains £7.29m/year at 25% higher installed cost and an 8% real discount rate. Reoptimising the 280 strict-quality days retains the 2023 capacity choices. Fixed-capacity replays assess performance on known historical conditions.

Cash flow of the 2023 economic case

Annual component	£2020m/year
Hydrogen netback receipts	+23.97
Foregone direct electricity receipts	-12.39
Fixed operating cost	−0.52
Equivalent cost of initial capital and stack renewals	−2.49
Equivalent incremental gain	+8.57

The £29.21m initial investment gives 2.64 years of simple payback and 2.90 years at 5% real discount. A 30-year repeat of the 2023 operating cash flows, with stack renewals and zero terminal value, gives £131.78m net present value. This projection assumes the reference netback and operating conditions persist throughout the horizon.

> **Client action.** Retain the current assets while verifying delivered hydrogen netback, daily acceptance and electricity sales obligations. Consider one 20 MW module if the agreed terms clear the corresponding contract boundary and the site can supply it. Evaluate a battery only when an additional paid service or a different throughput and cost basis can bridge the quantified revenue gap.

Validation. 42 optimal Xpress schedules and two matched rule schedules reconcile energy, device limits, sales and incremental cash. The largest physical check residual is below 0.001 MWh. Both 2023 joint cases independently reproduce the prior reference. The calculation archive includes schedules, inputs and the validation checks.

Sources. [1] MMCS 2026/27 Project Brief, pp. 2-3, 5-6, and project briefing. [2] Course datasets, repaired release 20261104-v2 and its audit, with ONS monthly CPI D7BT. [3] Danish Energy Agency storage catalogue, IEA *Global Hydrogen Review 2025*, BEIS *Hydrogen Production Costs 2021* and DESNZ HAR1 results, as transcribed and converted in the project R2-R4 parameter research.