


Fig 1a -- Heat-shock thermometer (label-blind)

Per-library $\log_2(\text{CPM} + 0.5)$; libraries 031–040 (inferred 39C) should be systematically higher

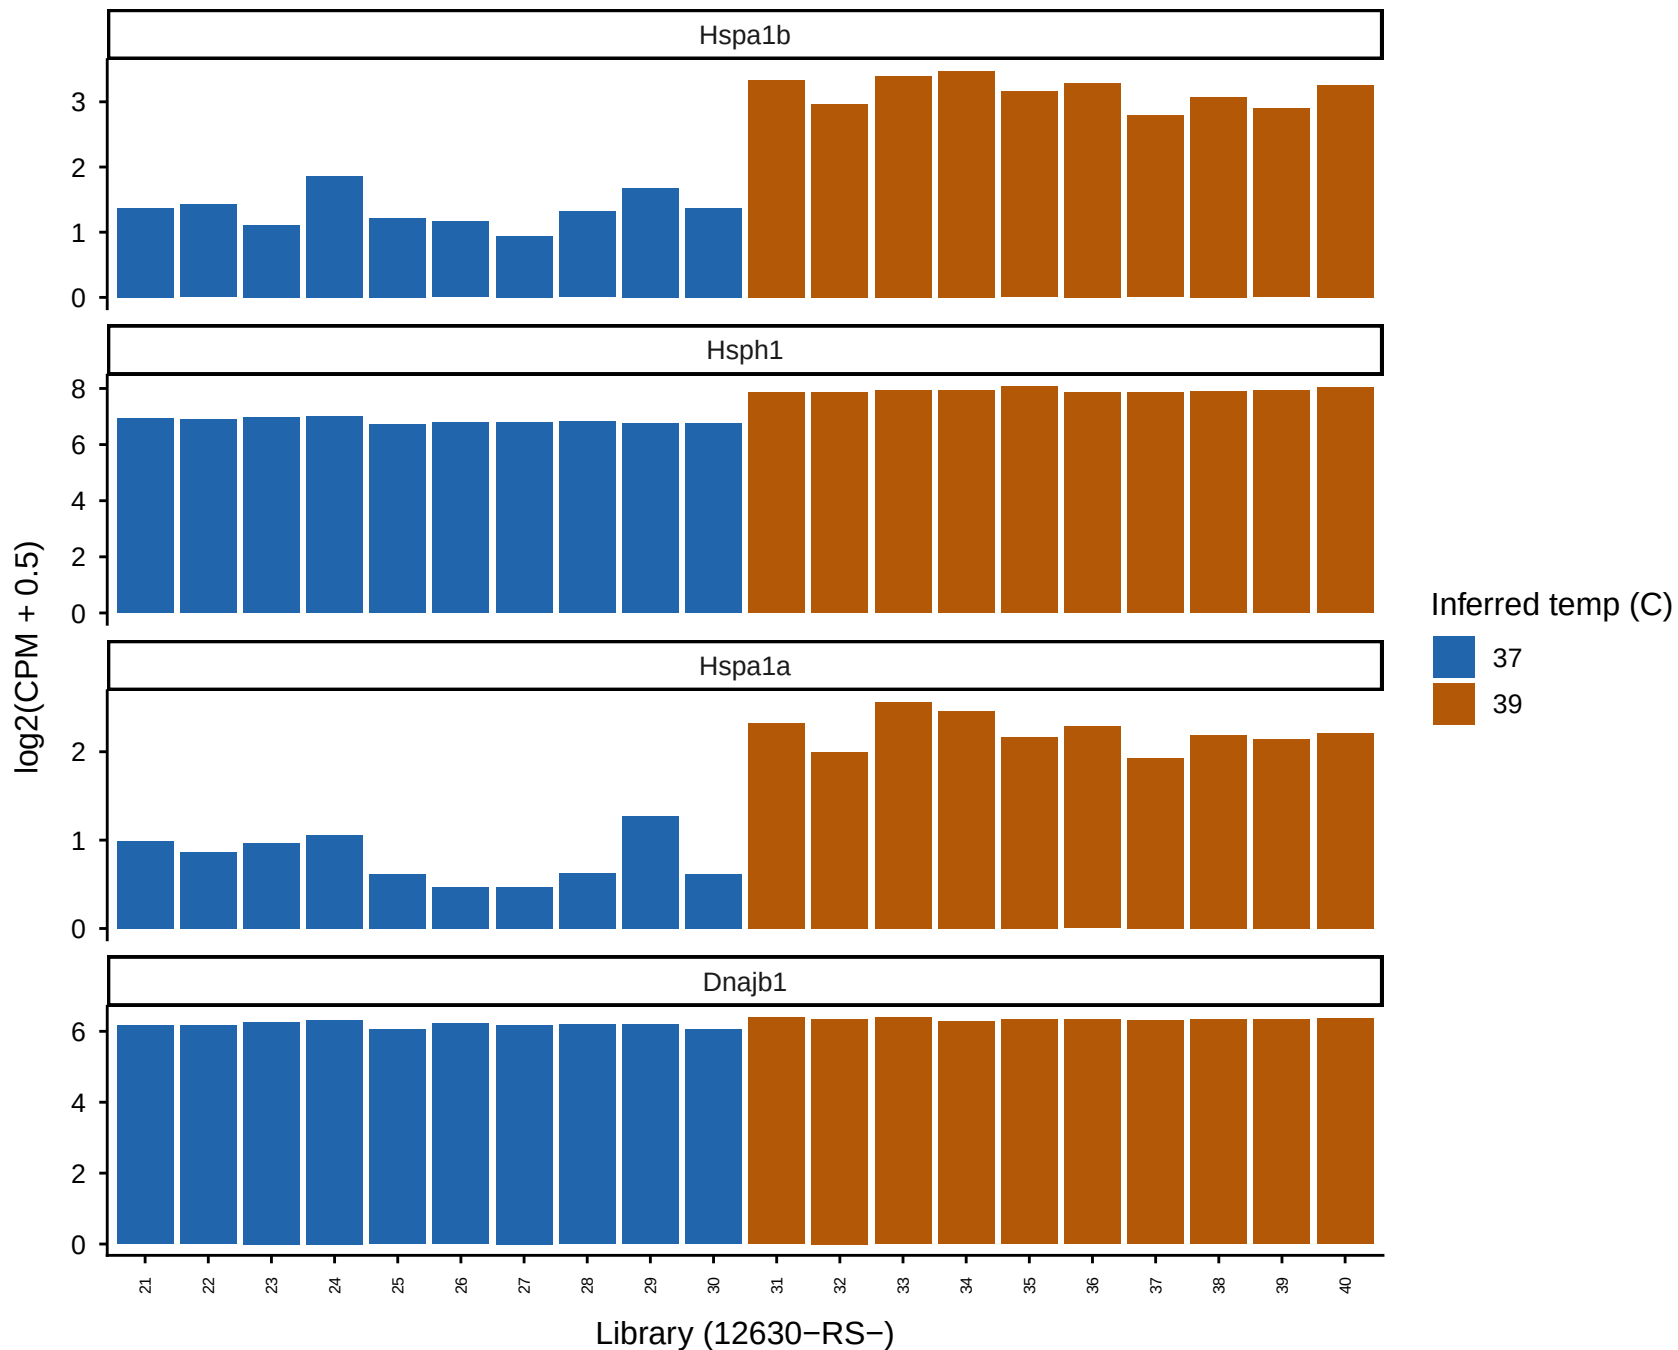

PROVISIONAL – inferred sample mapping (Hspa1b/Hsph1 thermometer + Cgas), pending collaborator sample sheet