

## Decarbonising the Residential Heating in the North of Tyne (NoT)

### Integrating Social Interventions and Low-Carbon Technologies

Mohamed Abuella and Adib Allahham


# Heat Decarbonisation: North of Tyne (NoT)

## Objective:


Assessment of the impacts of social and technical interventions for the decarbonisation of residential heating on the electricity and gas systems in the North of Tyne (NoT) region.

## Key Questions:

1. What are the impacts of social and technical interventions on system performance?
2. What is the economic dispatch and associated CO2 emissions of the heating interventions?
3. What are the impacts heat pumps and hydrogen boilers at different intervention levels?
4. What are the impacts of the combined interventions of heat pumps and hydrogen boilers?
5. What is economic plan of one-day heating interventions for the years 2025-2050?
6. What is the plan for combined heat pumps and hydrogen boilers with CCS over 2025-2050?
7. What are the requirements/impacts for hydrogen blending into the existing gas network?

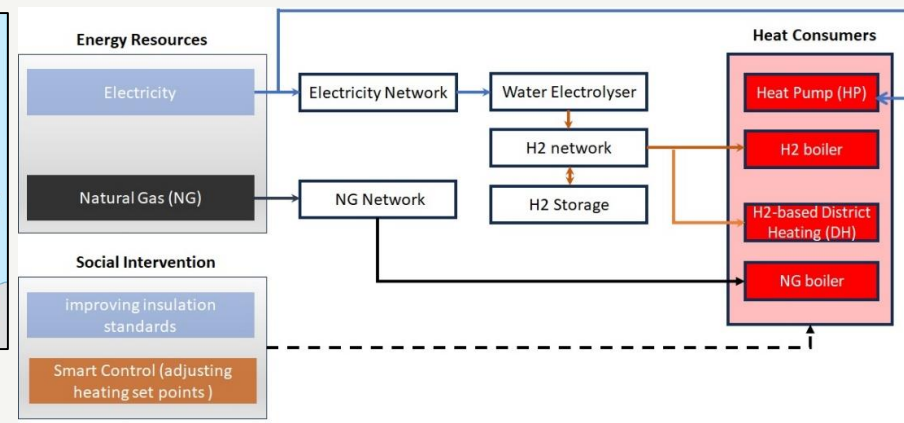

## High-level diagram of resources-technology model

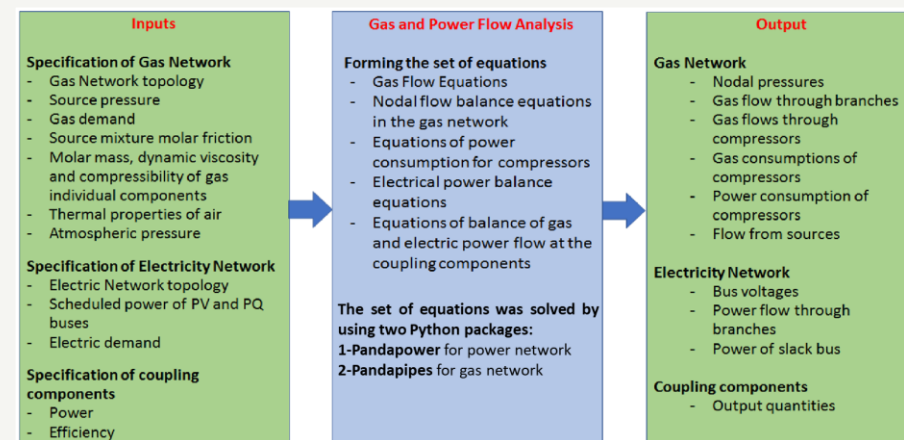


## Schematic Diagram of Modelling


## Heat Decarbonisation: North of Tyne (NoT)

### Demand Overview

The heating scenarios use the coldest day in November 2019 as a baseline to model peak energy demand. Total energy demand reached 31 GWh, with gas consumption (24 GWh) significantly outpacing electricity (7 GWh). Daily domestic demand averaged 16.6 GWh (12.45 GWh for gas, 4.15 GWh for electricity).

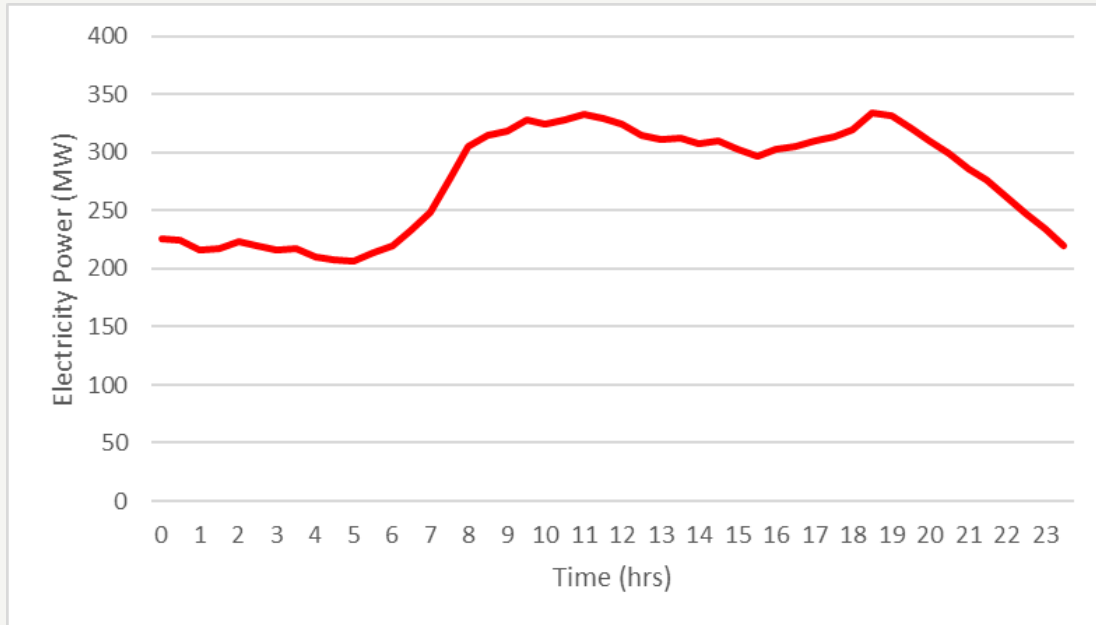

Daily Profile of Total Electricity Demand for NoT in 2019

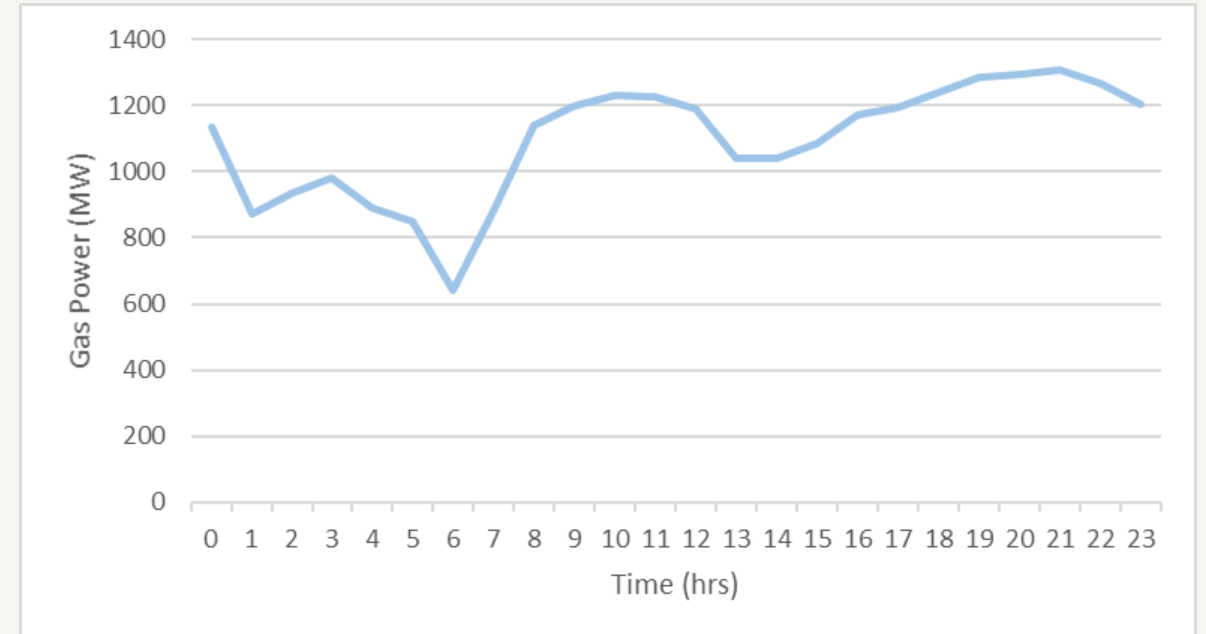

Daily Profile of Total Gas Demand for NoT in 2019

## Heat Decarbonisation: North of Tyne (NoT)

### Social Intervention Scenarios

The heat decarbonisation scenarios evaluate how social-based interventions impact electricity and gas networks and the broader energy system within the North of Tyne (NoT) region.

Developed to address decarbonisation needs, these scenarios model various heating interventions affecting 10% of households.

Scenario Formulation of Socio-Technical Interventions of Residential Heating in NoT

Scenario	Intervention	Effect on Gas Demand	Effect on Electricity Demand
1	Decreasing the heating set point by 2°C	20% decrease	No effect
2	Improving the whole building insulation level similar to Passivhaus standards	77% decrease	No effect
3	Delay start of heating from October to November	5.5% decrease	No effect
4	Use of radiator valves to turn off heating in unoccupied rooms	4% decrease	No effect
5	Use of heat pumps	21.3 % decrease	7.1% increase
6	Use of hydrogen boilers	10% decrease	No effect

# Heat Decarbonisation: North of Tyne (NoT)

## Modelling Social-Technical Interventions Scenarios by Monte Carlo Simulation



Let  $G_0$  and  $E_0$  represent the baseline gas and electricity demands, respectively. The adjusted demands  $G$  and  $E$  after applying a random intervention  $I_j$ .

$$G = \frac{1}{n} \sum_{i=1}^n \left( G_0 \times \sum_{j=1}^N \Pr(I_j) \cdot R_j \cdot X_j \right)$$

$$E = \frac{1}{n} \sum_{i=1}^n \left( E_0 \times \sum_{j=1}^N \Pr(I_j) \cdot K_j \cdot Y_j \right)$$

Where:  
 $R_j$  is the adjusting factor for intervention  $j$  (e.g., heating setpoint reduction, insulation improvement, etc.).  
 $K_j$  is the adjusting factor for intervention  $j$  (e.g., heat pumps, hydrogen boilers, etc.).  
 $X_j$  and  $Y_j$  are random variables drawn from normal distributions representing uncertainty,  $X_j \sim (\mu_{R_j}, \sigma_{R_j})$  for gas change and  $Y_j \sim (\mu_{K_j}, \sigma_{K_j})$  for electricity change).  
 $\Pr(I_j)$  is the probability of selecting intervention  $j$ , (in 6 interventions,  $\Pr = 1/N = 1/6$ ).  
 $N$  is the total number of interventions.  
 $i$  is the iteration of simulation out of  $n$  simulations.

The Monte Carlo simulation of heating interventions indicates a noticeable reduction in gas demand, with only a marginal increase in electricity demand.

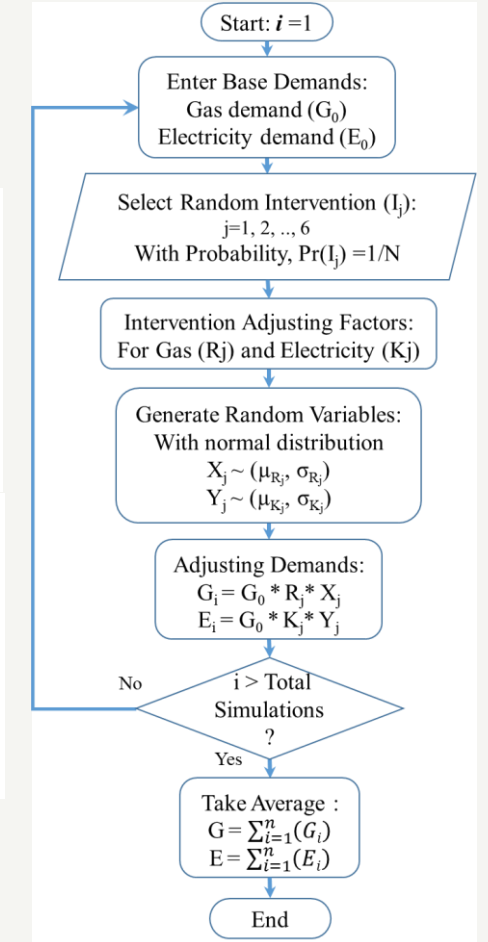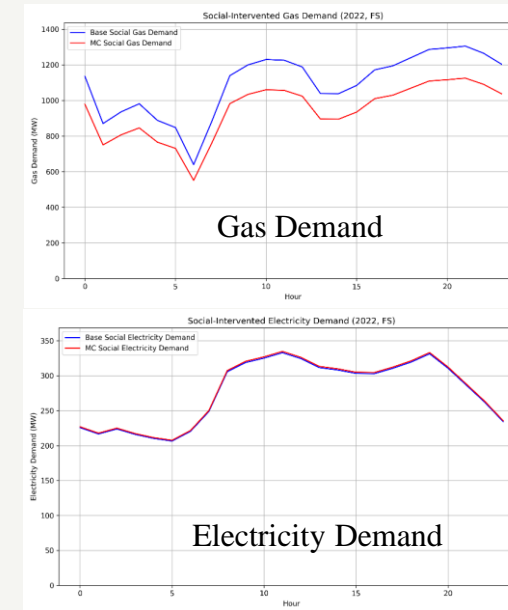

Monte Carlo Simulation for Social and Technical Interventions of Heating Demand

# Heat Decarbonisation: North of Tyne (NoT)


## System Data

### Energy Generation, Coupling and Storage

Generation Type	Total Capacity (MW)	Cost (£/MWh)	Economic Life (years)	Emissions (tCO <sub>2</sub> /MWh)
GT (Gas Turbine)	2247.75	85	13	0.488
Biomass	18.25	75	18	0.786
Wind	52.60	46	18	0.000
Solar	10.12	44	18	0.000
CHP (Combined Heat and Power)	Basically 10%, will be excluded with 100% intervention from heat pumps and hydrogen boilers.	76	23	0.488
P2G (Power-to-Gas) and G2P (Gas-to-Power)	Unlimited to simulate the import and export of energy into and out of the system.	-	-	-
EZ (Electrolyser)	Basically 10%, varies with interventions from hydrogen boilers.	42	13	0.000
FC (Fuel Cell)	Basically 10%, varies with interventions from hydrogen boilers.	42	13	0.000
BESS (Battery Energy Storage System)	Capacity: 80 MWh, Efficiency: 90%, Charge/Discharge Rate: 40 MW Primarily compensates for solar energy.	-	-	-

### General and Economic Parameters of the Energy System

Parameter	Value
Electricity OPEX Cost	£33.69 per MWh
Gas OPEX Cost	£9.73 per MWh
Hydrogen OPEX Cost	£9 per MWh
Electricity Price	Hourly variable, average: £125 per MWh
Gas Price	Hourly variable, average: £37.5 per MWh
Discount Rate	5%
CO <sub>2</sub> Price	£43.29 per tonne (example, varies by year)
Carbon Capture Cost Adjustment	30% increase in gas price for CCS (in 2040, 2045, 2050)
CCS Capacity	Absorbed from deployed technology (e.g., GT, Biomass) by 15% share; CO <sub>2</sub> capture rate: net zero (0%)

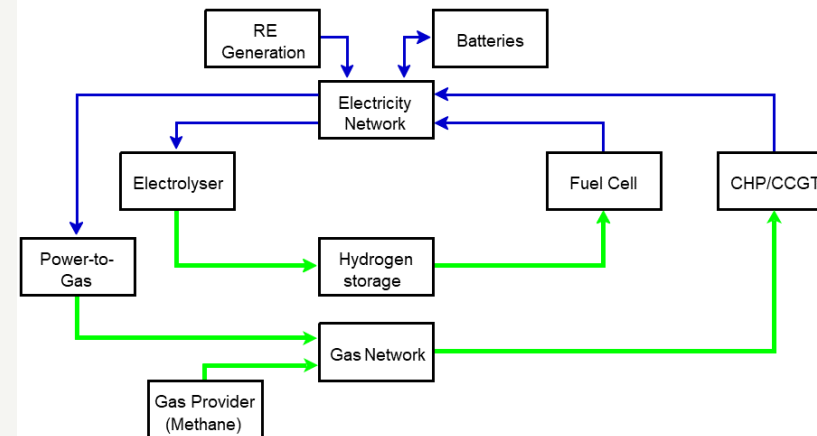

Interaction within the energy system



# Heat Decarbonisation: North of Tyne (NoT)

## Case Study

1) Analysis the economic dispatch for the base case (without interventions) and Monte Carlo simulation of the social and technical interventions.

**BESS:**


(Positive) Discharging,  
(Negative) Charging.

**Hydrogen:**


(Positive) Fuel Cell,  
(Negative) Electrolyser.

Electricity (G2P), Gas (P2G):  
(Positive) Utilize or Importing,  
(Negative) Export.

(Base Case)

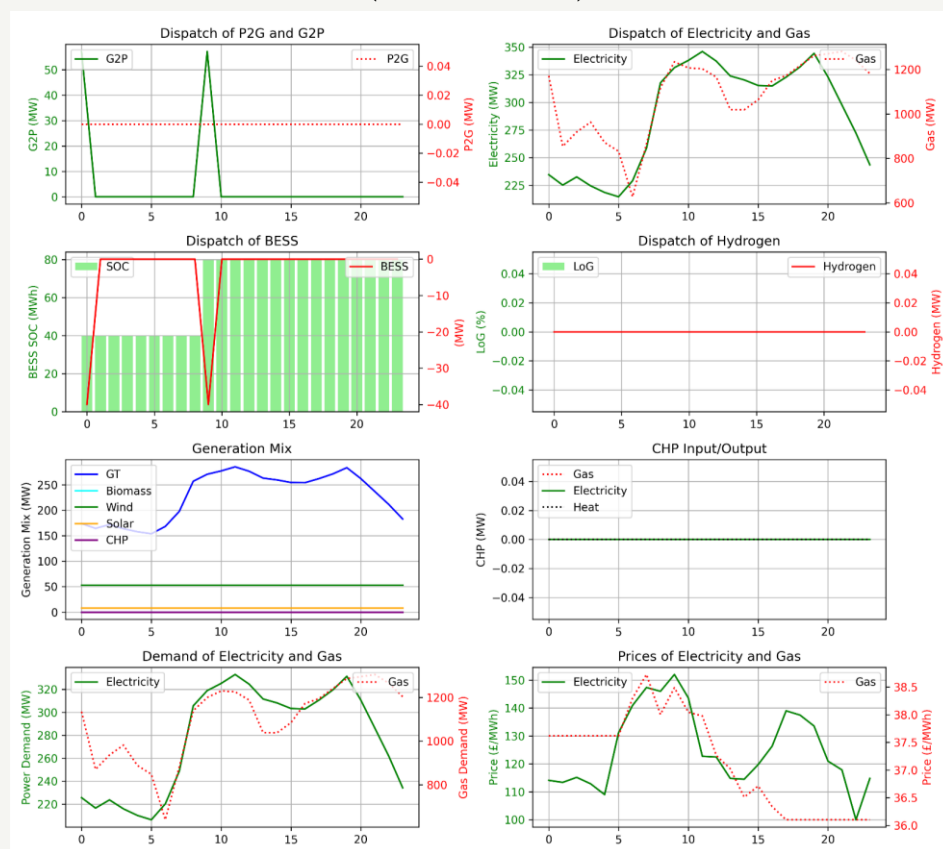

(Monte Carlo Simulation of Interventions)

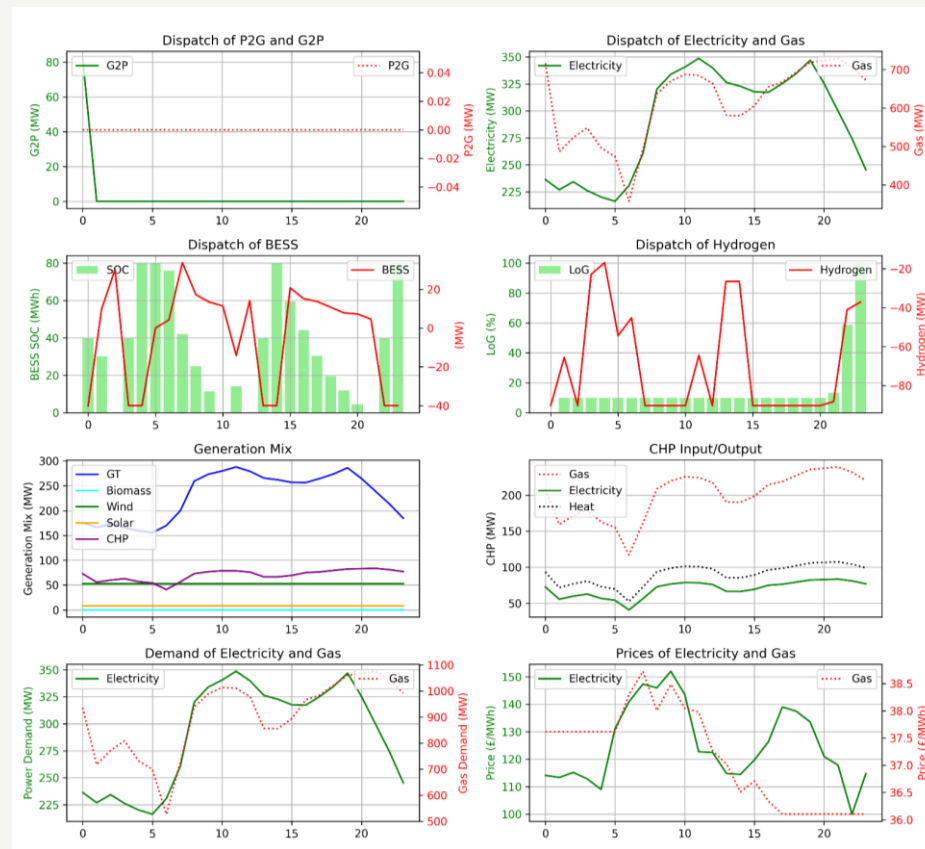

# Heat Decarbonisation: North of Tyne (NoT)

## Case Study


2) Investigating the impacts social and technical interventions on the supply side for both cases:  
(A) Base (without interventions) and (B) Monte Carlo simulation for heating interventions.

**Note:** The energy and emissions of hydrogen production are included in the model.

*CO<sub>2</sub> Emissions* → CO<sub>2</sub> emissions is system-wide emissions, and the hydrogen is green.  
*CO<sub>2</sub> (Grey Hydrogen)* → CO<sub>2</sub> emissions from producing grey hydrogen only.


(Generation Mix: (A) Base and (B) Interventions cases)

Generation Mix and CO<sub>2</sub> Emissions (Base and Monte Carlo Simulations of Heating Interventions)

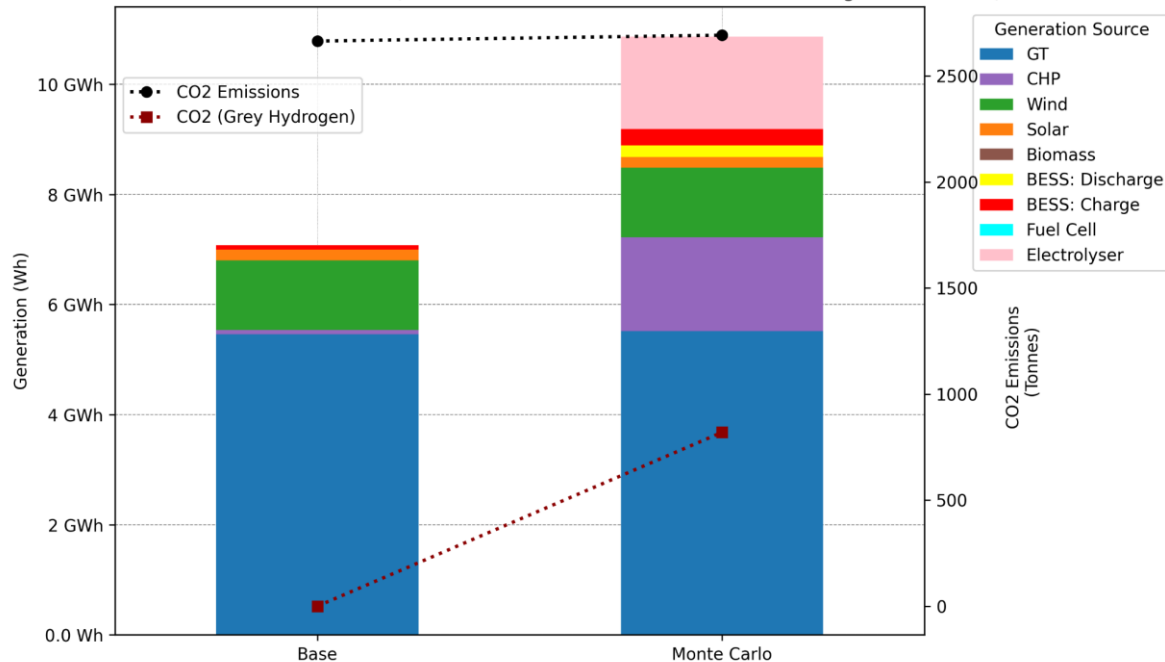

(Energy Vectors: (A) Base and (B) Interventions cases)

Energy Vectors (Base and Monte Carlo Simulations of Heating Interventions)

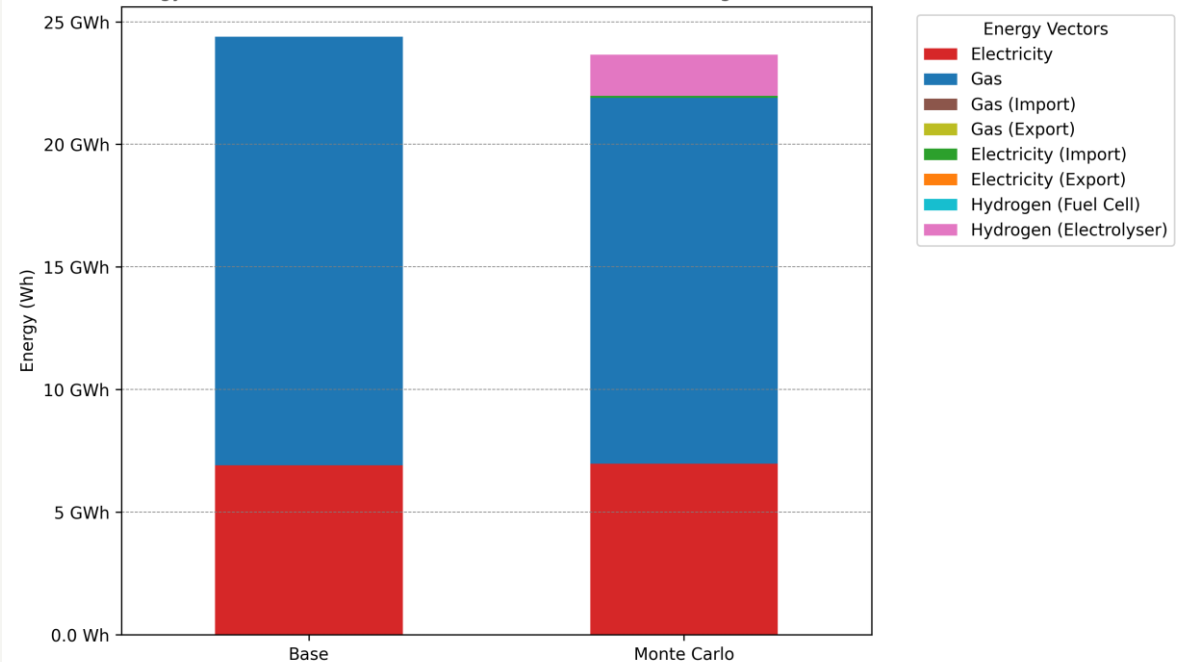




# Heat Decarbonisation: North of Tyne (NoT)

## Case Study


3) Investigating the impacts heat pumps and hydrogen boilers with different interventions levels (10% - 50%) separately. Other social-technical interventions complete the remaining heating demand.

**Note:** In consideration of customer comfort and affordability, we focus more on technical interventions, such as heat pumps and hydrogen boilers. The share of heat energy from CHP is excluded when the intervention consists entirely of heat pumps or hydrogen boilers (@ 100%).

### (Heat Pumps Interventions)

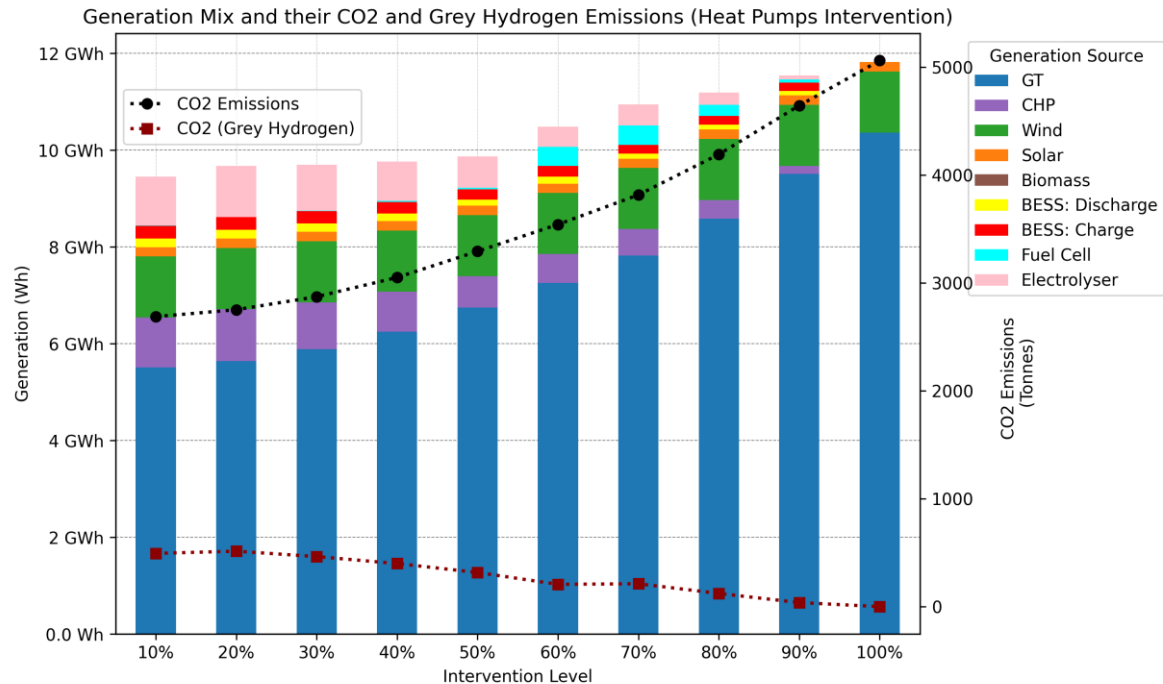

### (Hydrogen Boilers Interventions)

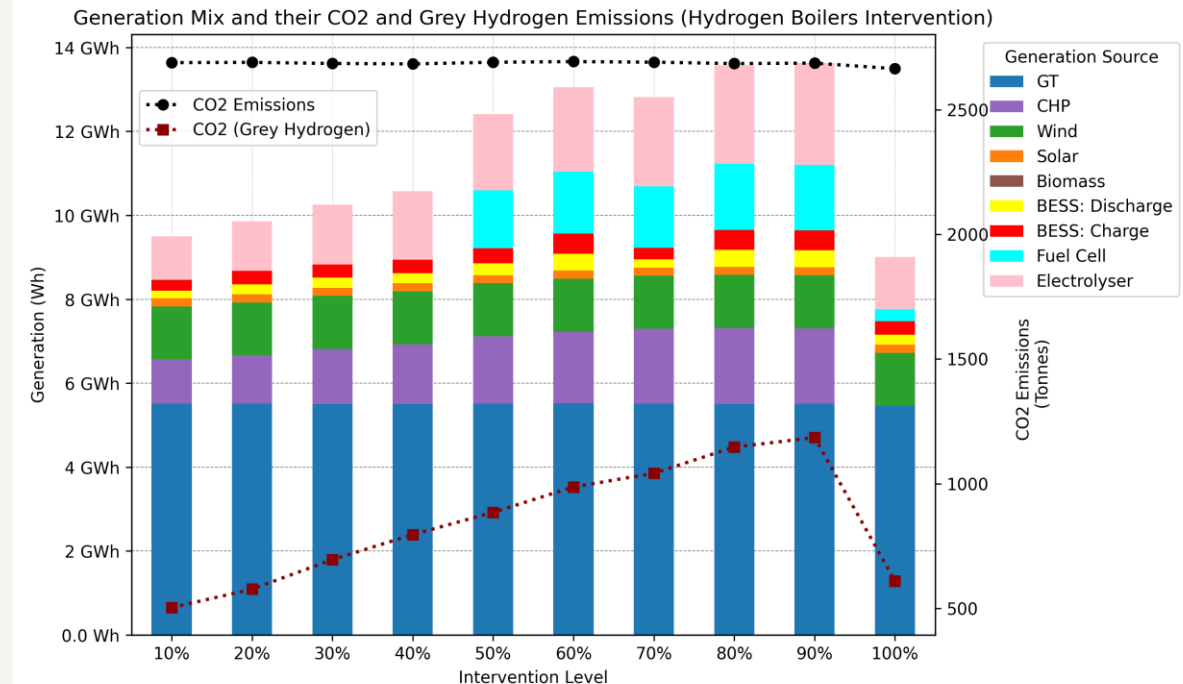


# Heat Decarbonisation: North of Tyne (NoT)

## Case Study

4) Investigating the impacts heat pumps and hydrogen boilers with different interventions levels (10% - 50%) for each. Other social-technical interventions complete the remaining heating demand, except when HPs=50% and HBs=50%.

**Note:** The share of heat energy from CHP is excluded when the intervention consists entirely of heat pumps or hydrogen boilers (@ 100%).

Heat Pumps and Hydrogen Boilers interventions with equal shares (10% - 50%) for each

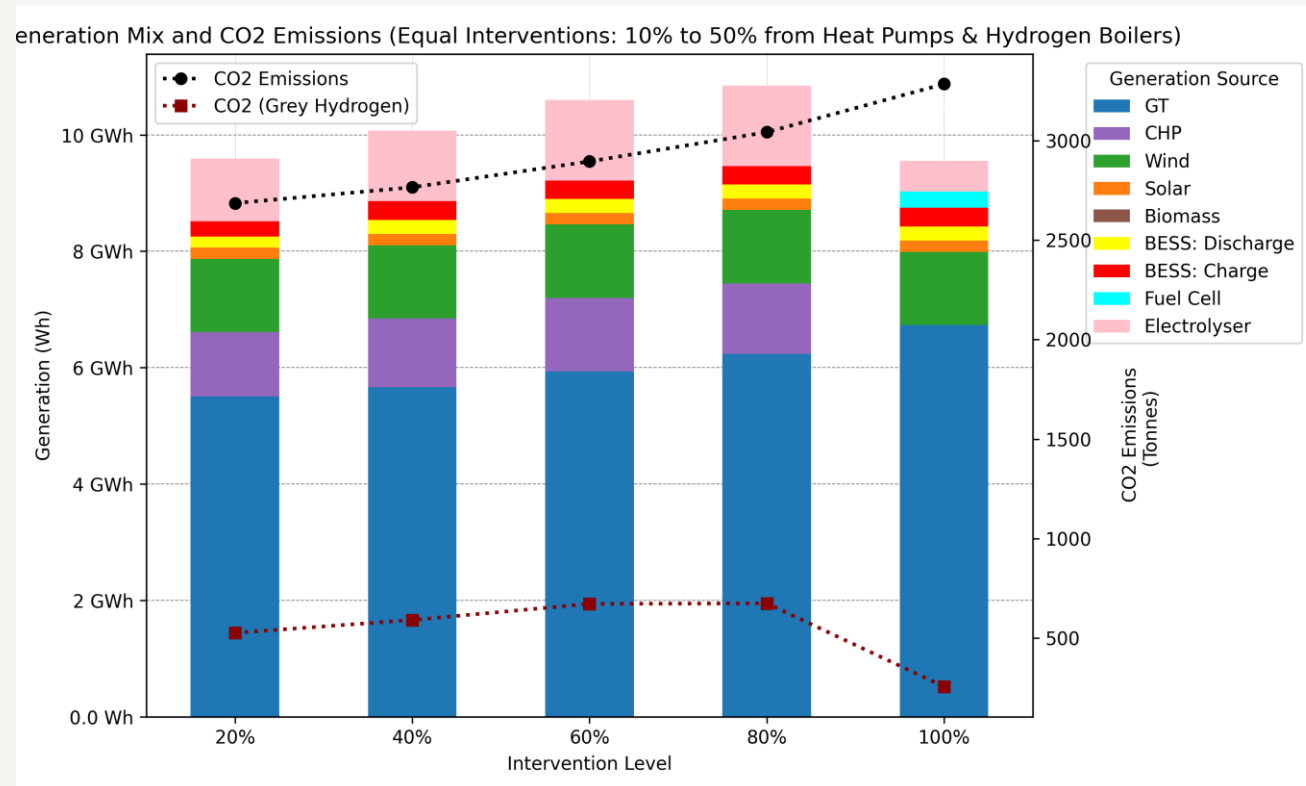

# Heat Decarbonisation: North of Tyne (NoT)


## Case Study

5) Economic planning for one day heating demand from Monte Carlo simulated social and technical interventions with level equal share for each intervention. Planning years are 2025 to 2050, so the economic dispatch of one day is planned in each year.


**Note:** To match with the future energy supply installations, the day demand is scaled by the trend of demand change according to the (FS) scenario in Energy Future Scenarios from National Grid.

Avg. Demand (MW)	2025	2030	2035	2040	2045	2050
Electricity	288	303	328	372	434	512
Gas	1075	1190	1609	3006	9157	1168

(A) Without CCS deployment

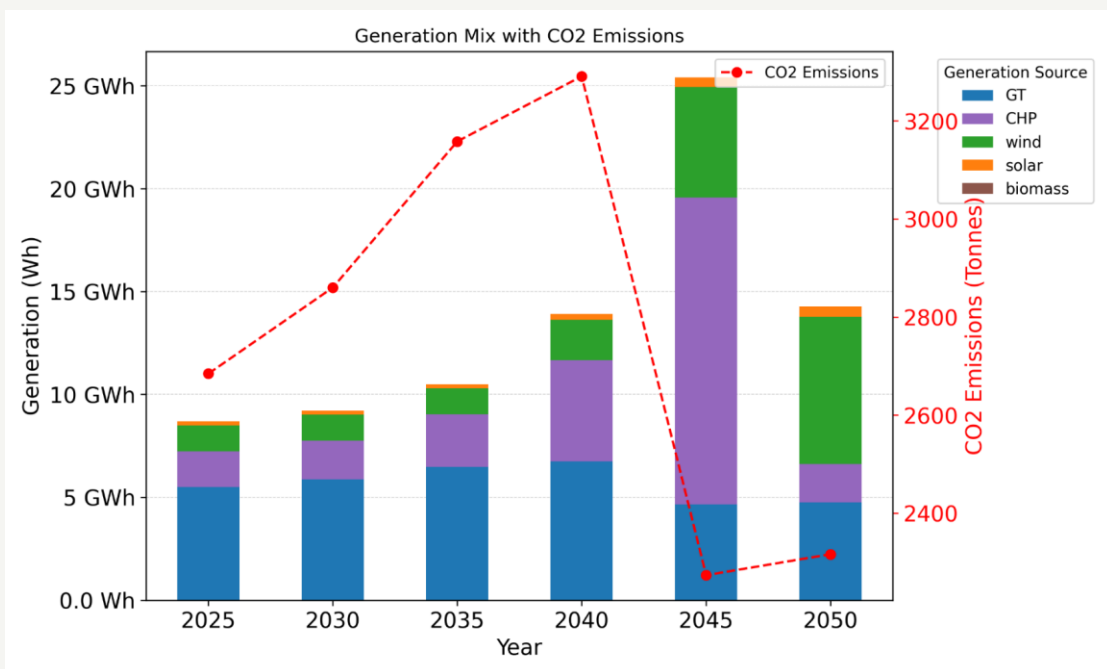

(B) With CCS deployment, from 2040 to 2050

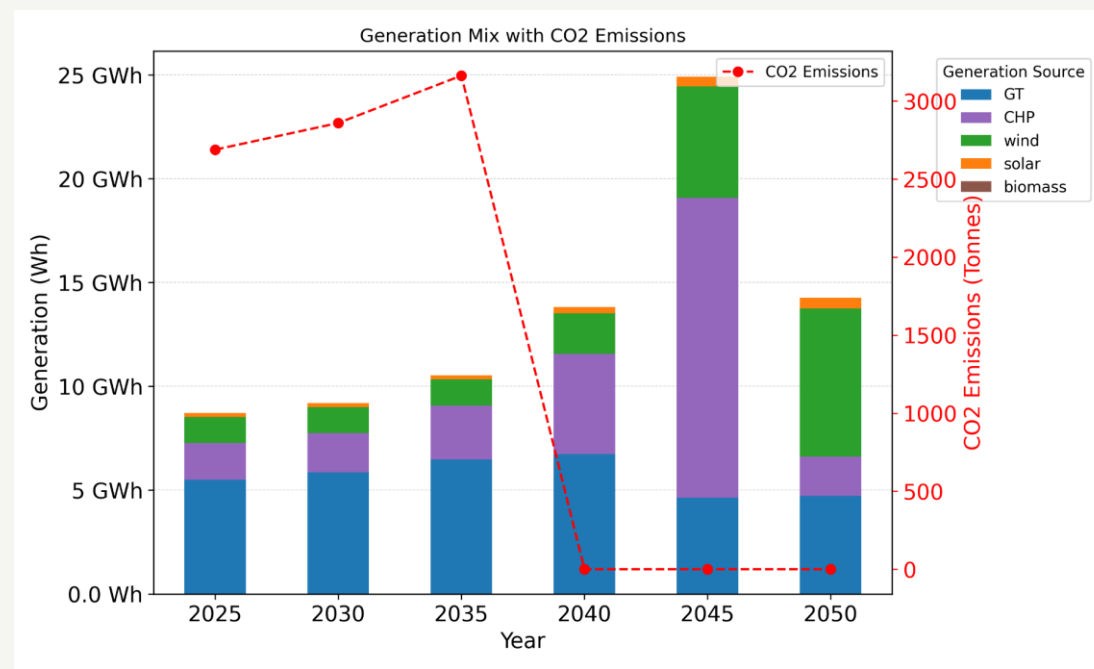


# Heat Decarbonisation: North of Tyne (NoT)


## Case Study

6) Economic planning for one day with heating interventions 50% of heat pumps and 50% hydrogen boilers (2025 - 2050).

(A) Without CCS deployment

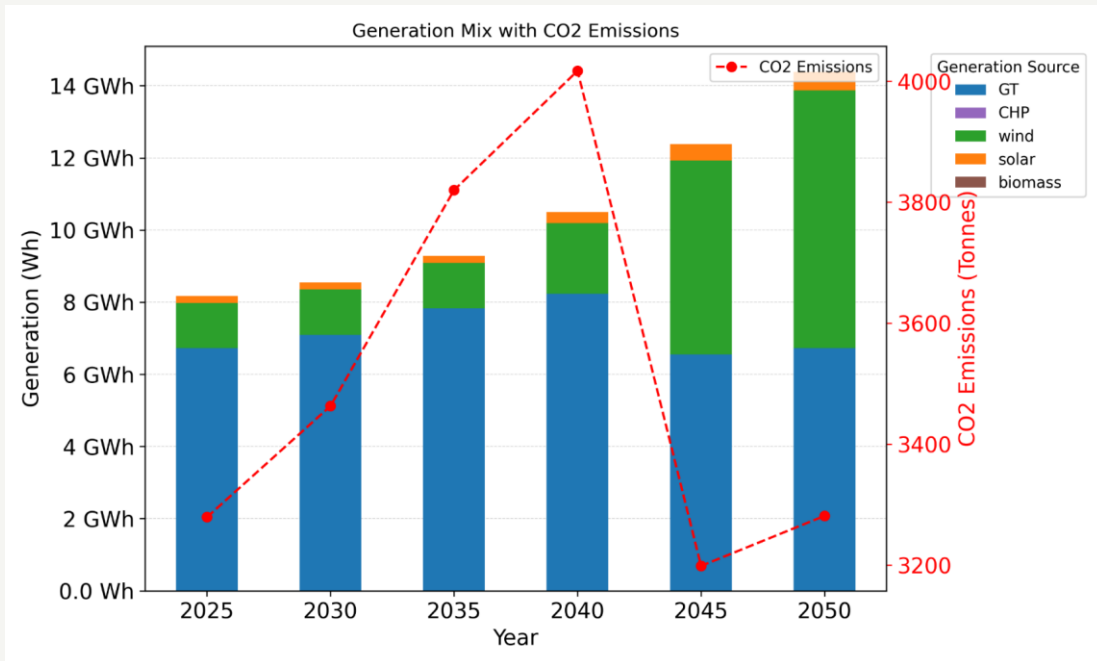

(B) With CCS deployment, from 2040 to 2050

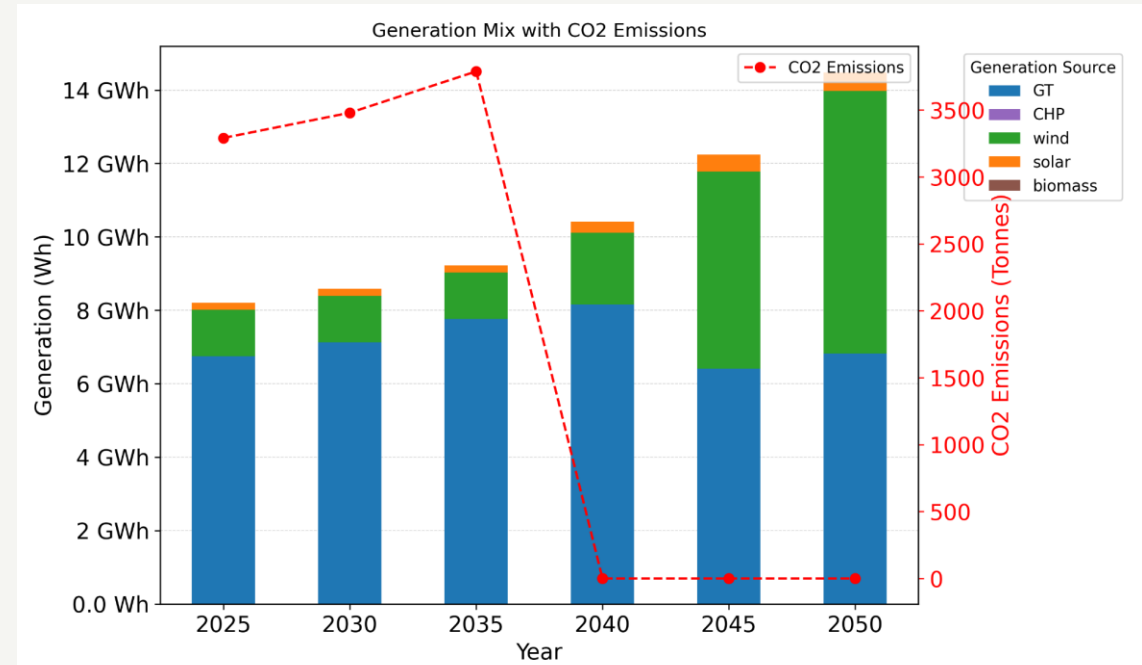


# Heat Decarbonisation: North of Tyne (NoT)

## Case Study


### 7) Economic planning for one day with hydrogen blending into the existing natural gas network

Combining Game-Theory model with OPGF model


GT model output → OPGF output → GT model

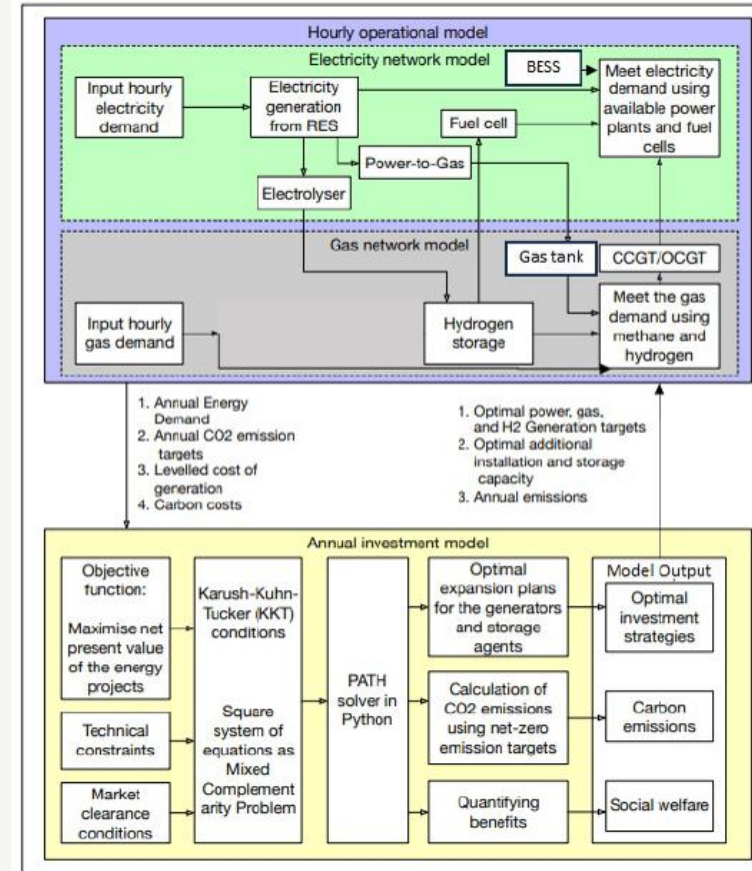


Schematic Diagram of Game-Theoretic Model

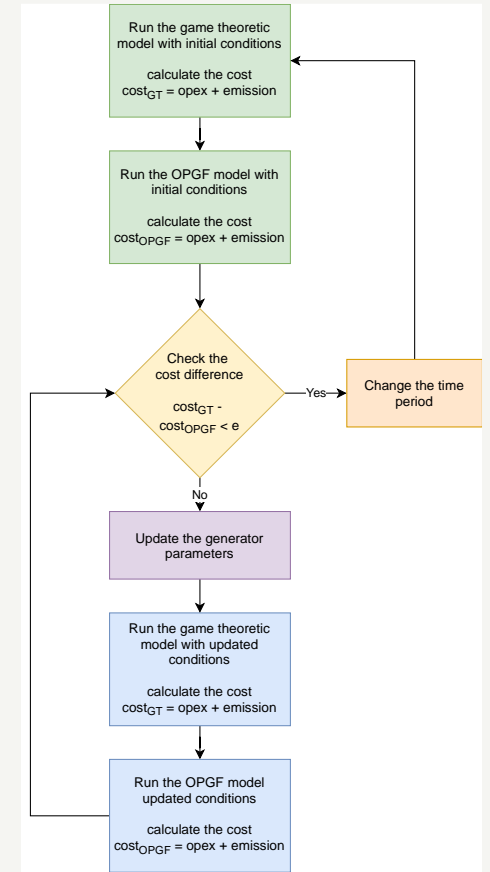

Short-term operation & long term planning

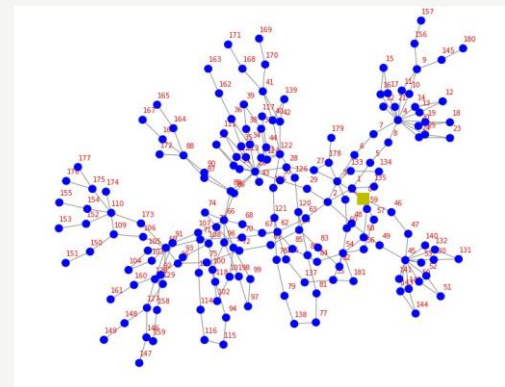

Electricity Network

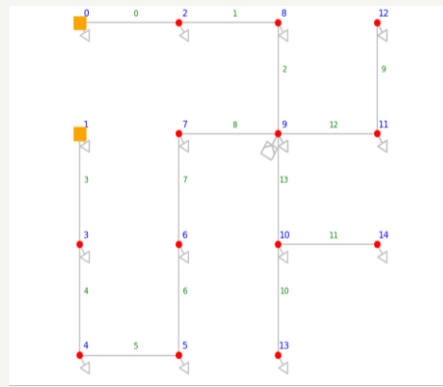

Gas Network

# Heat Decarbonisation: North of Tyne (NoT)


## Case Study

**7.1)** Economic planning with hydrogen blending for one day with heating demand from Monte Carlo simulated social and technical interventions with level equal share for each intervention.


Electrolyser (EZ) → Hydrogen Boiler ≥ EZ ≥ Hydrogen Blending  
 Fuel Cell (FC) → 0 ≥ EZ ≥ (Hydrogen Blending - Hydrogen Boiler)

Avg. Demand (MW)	2025	2030	2035	2040	2045	2050
Electricity	288	303	328	372	434	512
Gas	1075	1190	1609	3006	9157	1168

(A) Hydrogen Blending = **10 %** into the gas network,  
 with CCS deployment (2040 to 2050) and unlimited Renewables

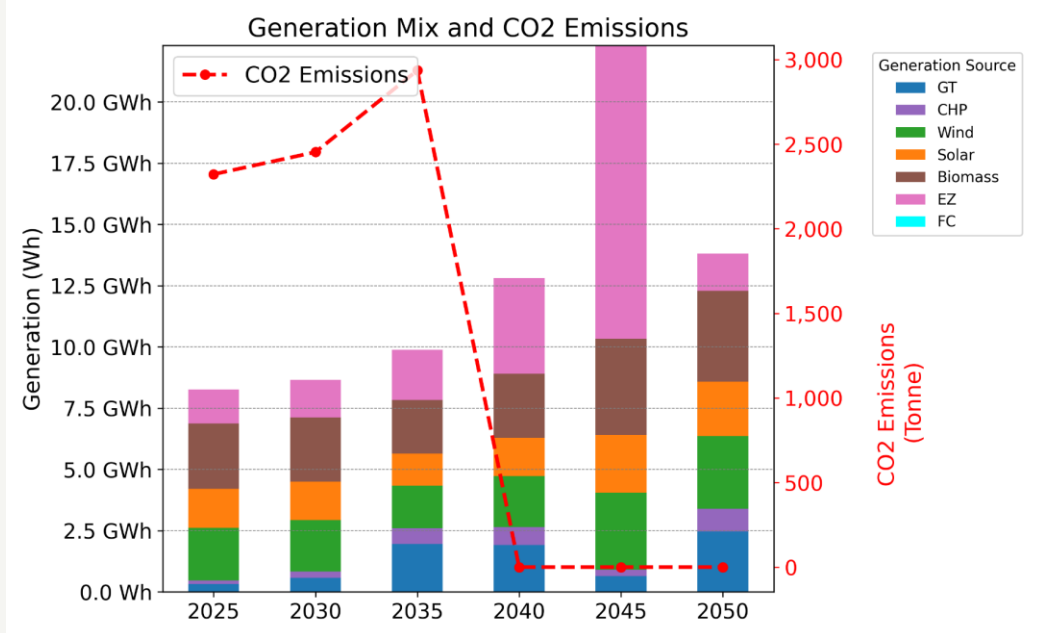

(B) Hydrogen Blending = **20 %** into the gas network,  
 With CCS deployment (2040 to 2050) and unlimited Renewables

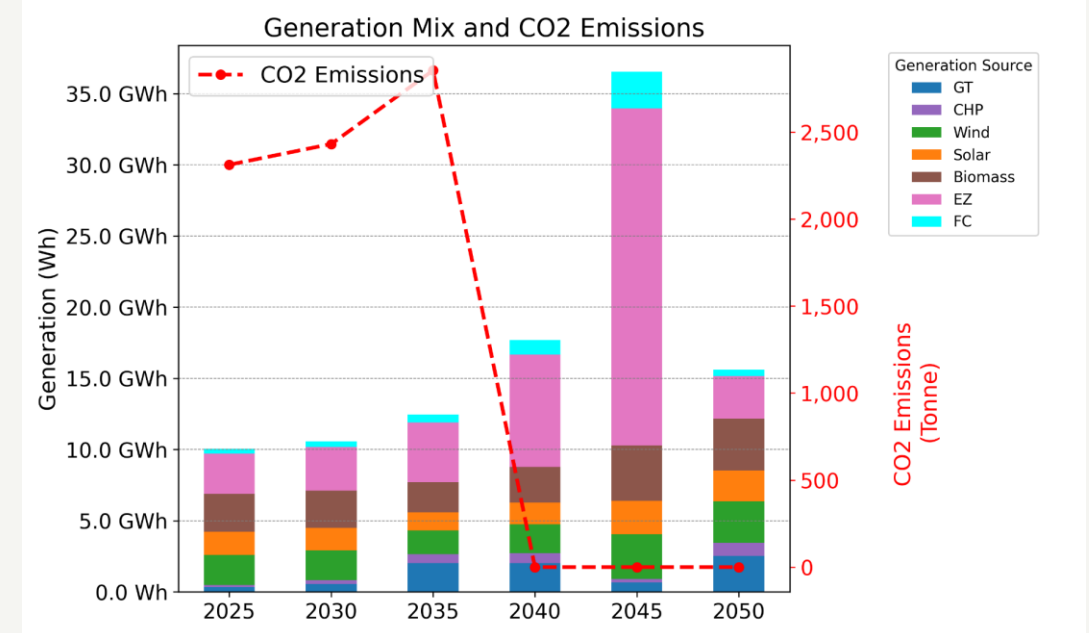



# Heat Decarbonisation: North of Tyne (NoT)


## Case Study

**7.2)** Economic planning for one day with heating interventions 50% of heat pumps and 50% hydrogen boilers (2025 - 2050).


Electrolyser (EZ) → Hydrogen Boiler ≥ EZ ≥ Hydrogen Blending  
 Fuel Cell (FC) → 0 ≥ EZ ≥ (Hydrogen Blending - Hydrogen Boiler)

Avg. Demand (MW)	2025	2030	2035	2040	2045	2050
Electricity	288	303	328	372	434	512
Gas	1075	1190	1609	3006	9157	1168

(A) Hydrogen Blending = **50 %** into the gas network,  
 with CCS deployment (2040 to 2050) and unlimited Renewables

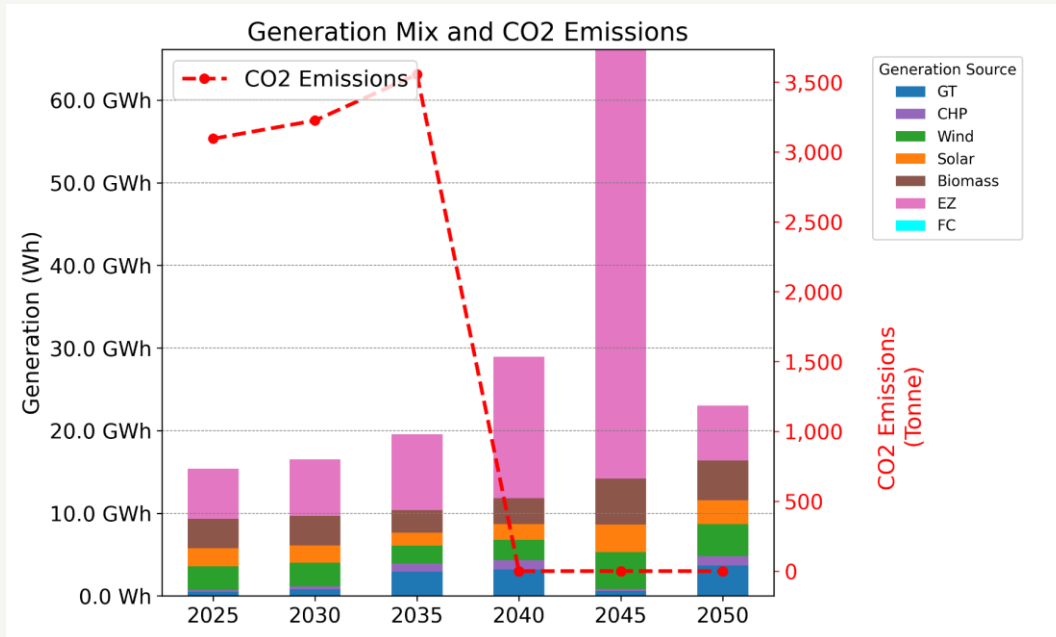

(B) Hydrogen Blending = **100 %** into the gas network,  
 with CCS deployment (2040 to 2050) and unlimited Renewables

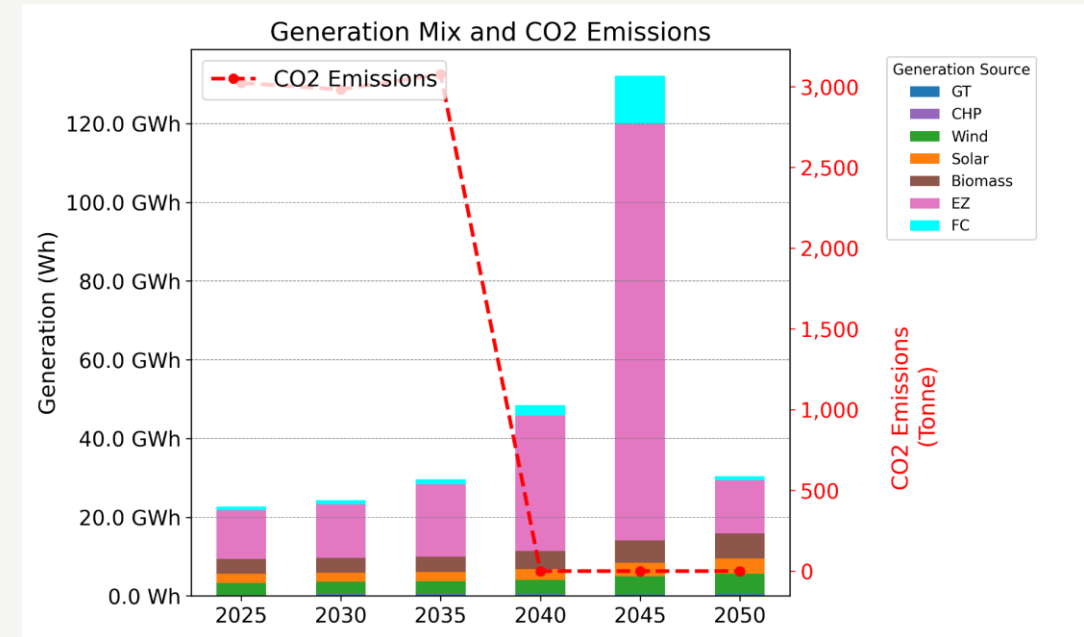


# Heat Decarbonisation: North of Tyne (NoT)

## Case Study


**7.2)** Economic planning for one day with heating interventions 50% of heat pumps and 50% hydrogen boilers (2025 & 2050).

**\*\*Energy Mix of the Hydrogen Technologies:**


(A) Hydrogen Blending = **10 %**

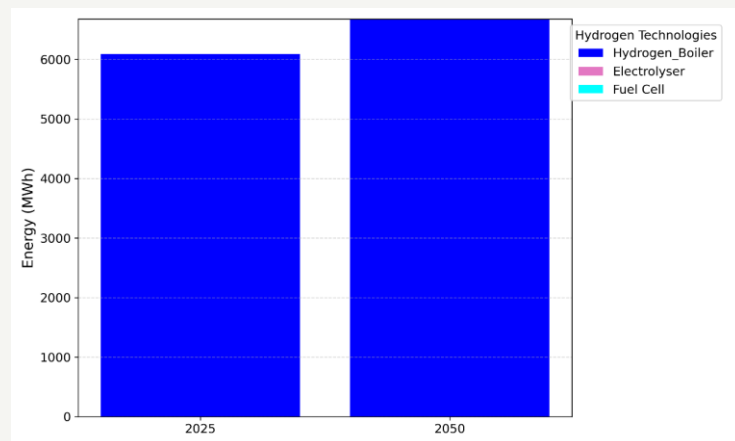

(A) Hydrogen Blending = **20 %**

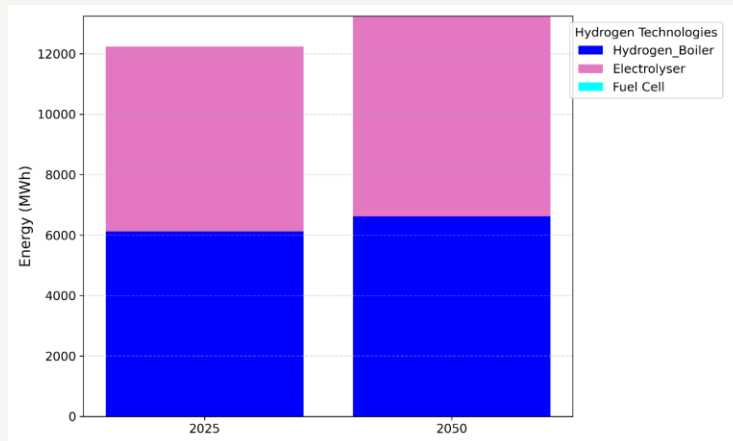

(A) Hydrogen Blending = **100 %**

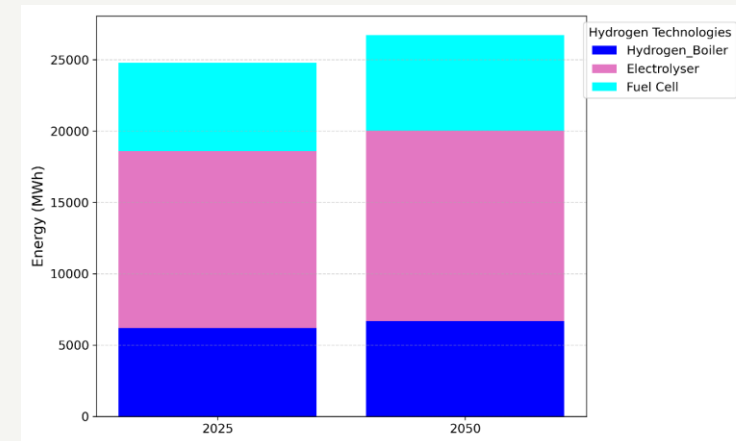

## Heat Decarbonisation: North of Tyne (NoT)

### Conclusion

- The system-wide modeling approach for residential heating in the NoT region demonstrates that while the applied social and technical interventions effectively reduce gas demand, their impact on overall CO<sub>2</sub> emissions remains limited with the existing system infrastructure.
- Prioritising solutions that minimise lifestyle and cost impacts for residents is vital for supporting heat decarbonisation efforts.
- The significant gap between gas and electricity demand during peak heating periods indicates the need for substantial infrastructure upgrades to support low-carbon technologies, such as renewables, heat pumps, and hydrogen boilers.
- In the NoT region, Carbon Capture and Storage (CCS) technology could play an important role as an effective option to decarbonise residential heating demand.
- Additionally, hydrogen blending into the gas network could help in reducing the emissions while still meeting heating demand.

**Thank you for your attention**