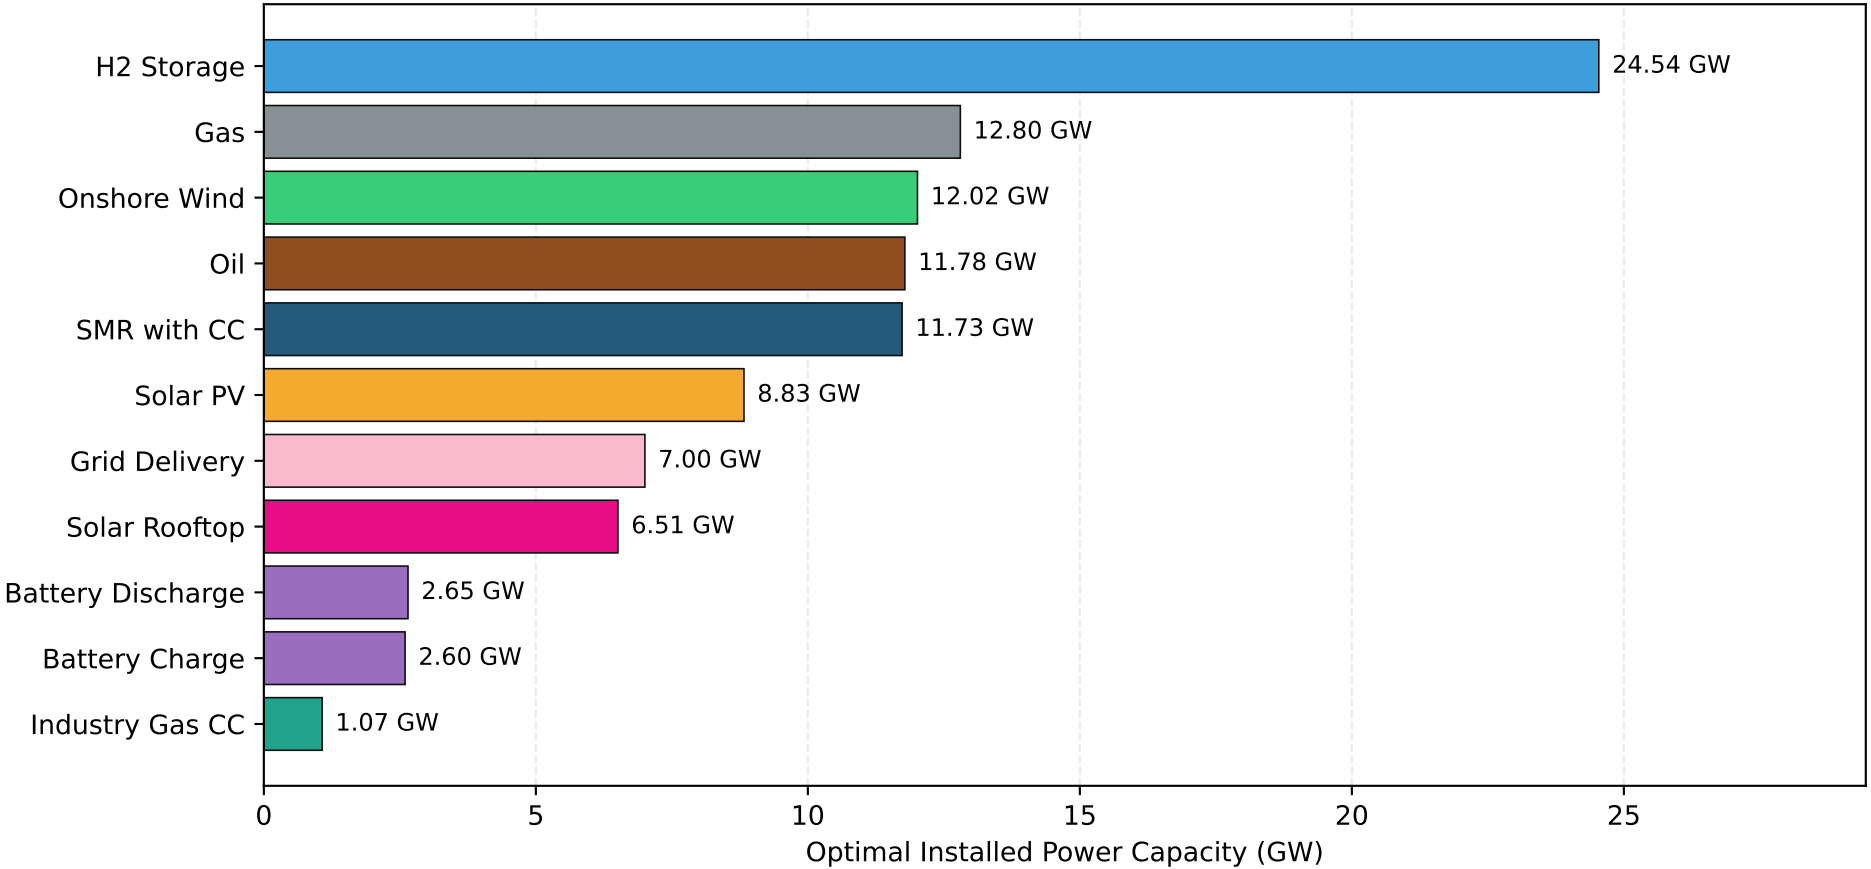
H2 Storage
Gas
Onshore Wind
Oil
SMR with CC
Solar PV
Grid Delivery
Solar Rooftop
Battery Discharge
Battery Charge
Industry Gas CC
24.54 GW
12.80 GW
12.02 GW
11.78 GW
11.73 GW
8.83 GW
7.00 GW
6.51 GW
2.65 GW
2.60 GW
1.07 GW
0
5
10
15
20
25
Optimal Installed Power Capacity (GW)