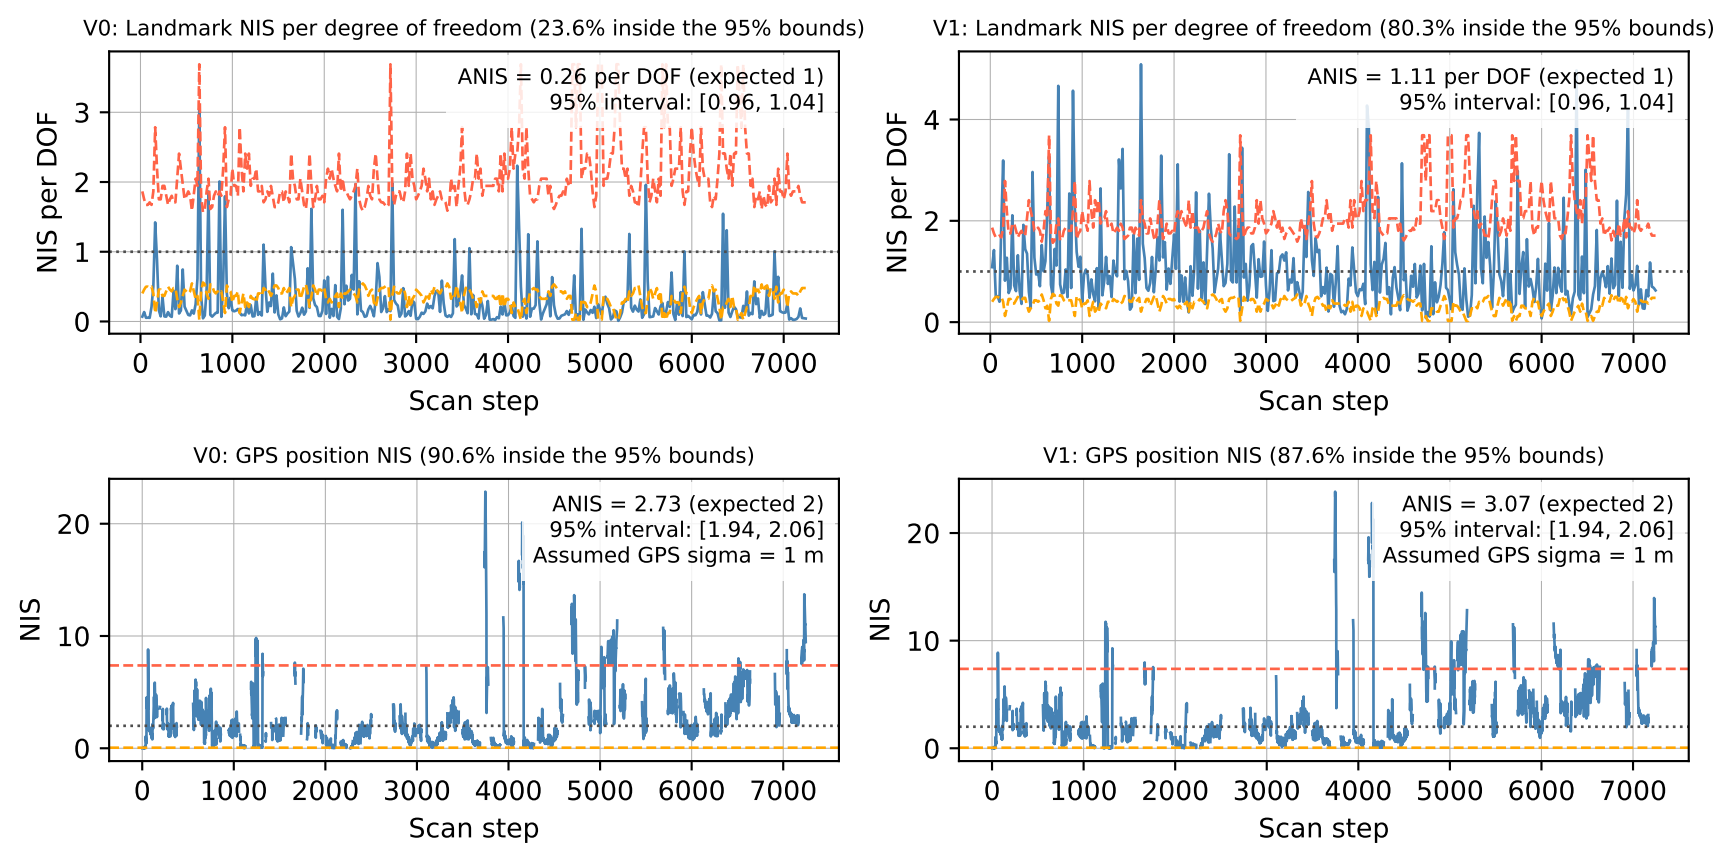

V0: Landmark NIS per degree of freedom (23.6% inside the 95% bounds)
ANIS = 0.26 per DOF (expected 1)
95% interval: [0.96, 1.04]
NIS per DOF
Scan step
V1: Landmark NIS per degree of freedom (80.3% inside the 95% bounds)
ANIS = 1.11 per DOF (expected 1)
95% interval: [0.96, 1.04]
NIS per DOF
Scan step
V0: GPS position NIS (90.6% inside the 95% bounds)
ANIS = 2.73 (expected 2)
95% interval: [1.94, 2.06]
Assumed GPS sigma = 1 m
NIS
Scan step
V1: GPS position NIS (87.6% inside the 95% bounds)
ANIS = 3.07 (expected 2)
95% interval: [1.94, 2.06]
Assumed GPS sigma = 1 m
NIS
Scan step