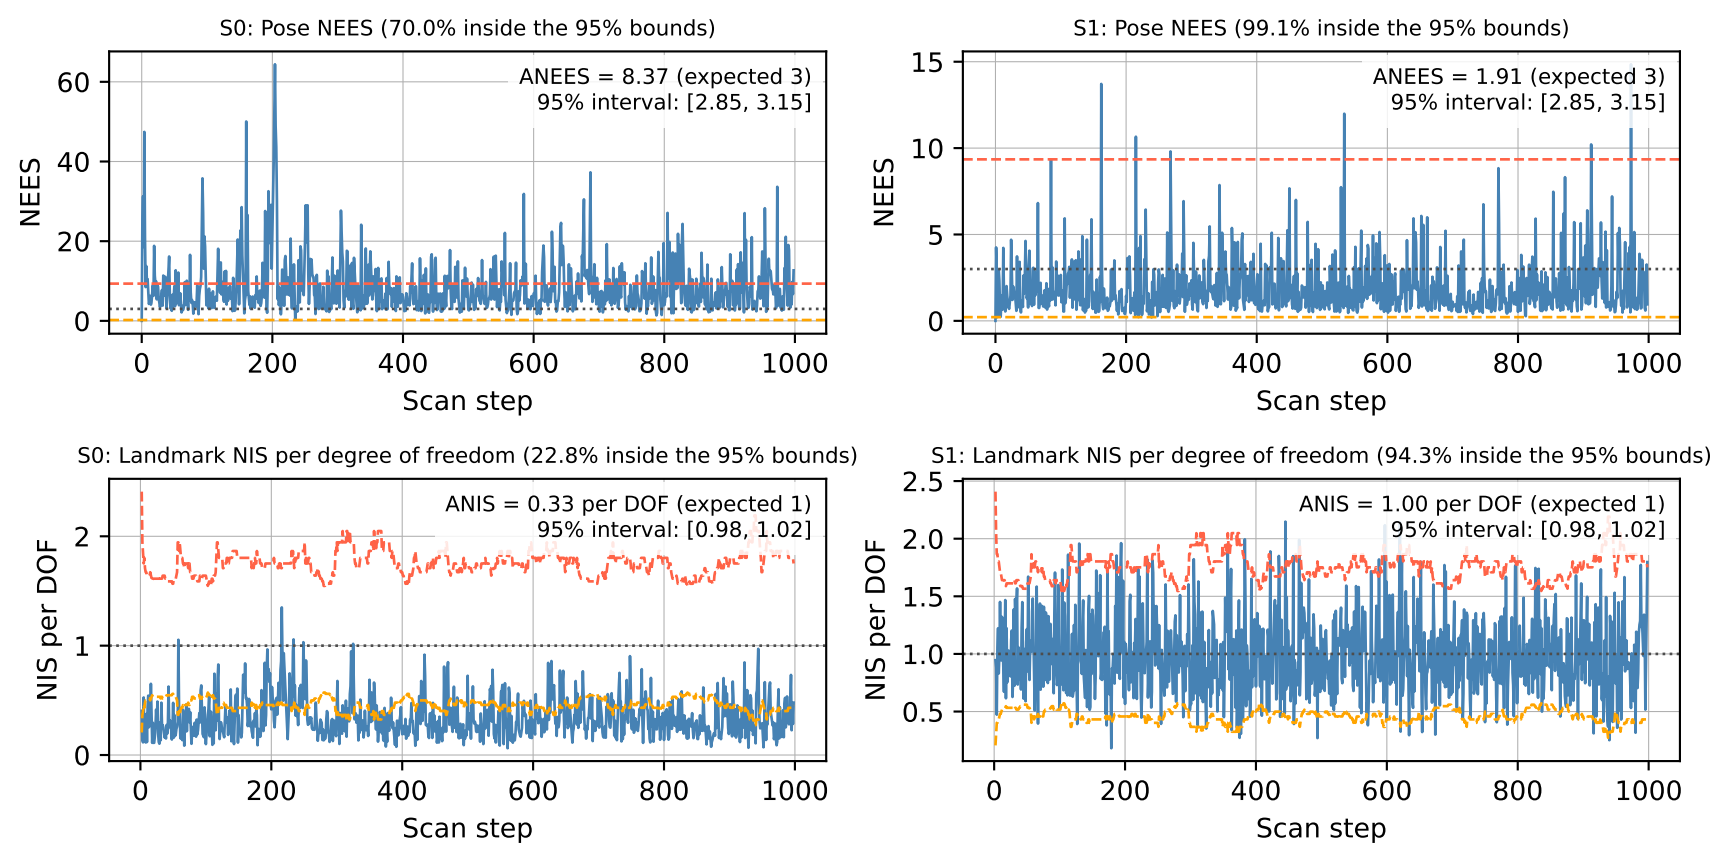

S0: Pose NEES (70.0% inside the 95% bounds)
ANEES = 8.37 (expected 3)
95% interval: [2.85, 3.15]
NEES
Scan step
S1: Pose NEES (99.1% inside the 95% bounds)
ANEES = 1.91 (expected 3)
95% interval: [2.85, 3.15]
NEES
Scan step
S0: Landmark NIS per degree of freedom (22.8% inside the 95% bounds)
ANIS = 0.33 per DOF (expected 1)
95% interval: [0.98, 1.02]
NIS per DOF
Scan step
S1: Landmark NIS per degree of freedom (94.3% inside the 95% bounds)
ANIS = 1.00 per DOF (expected 1)
95% interval: [0.98, 1.02]
NIS per DOF
Scan step