1DDM | apo 4683 / holo 4263

HN CSP ROC | 131 eligible residues

Binding site: 12 | Distal: 119

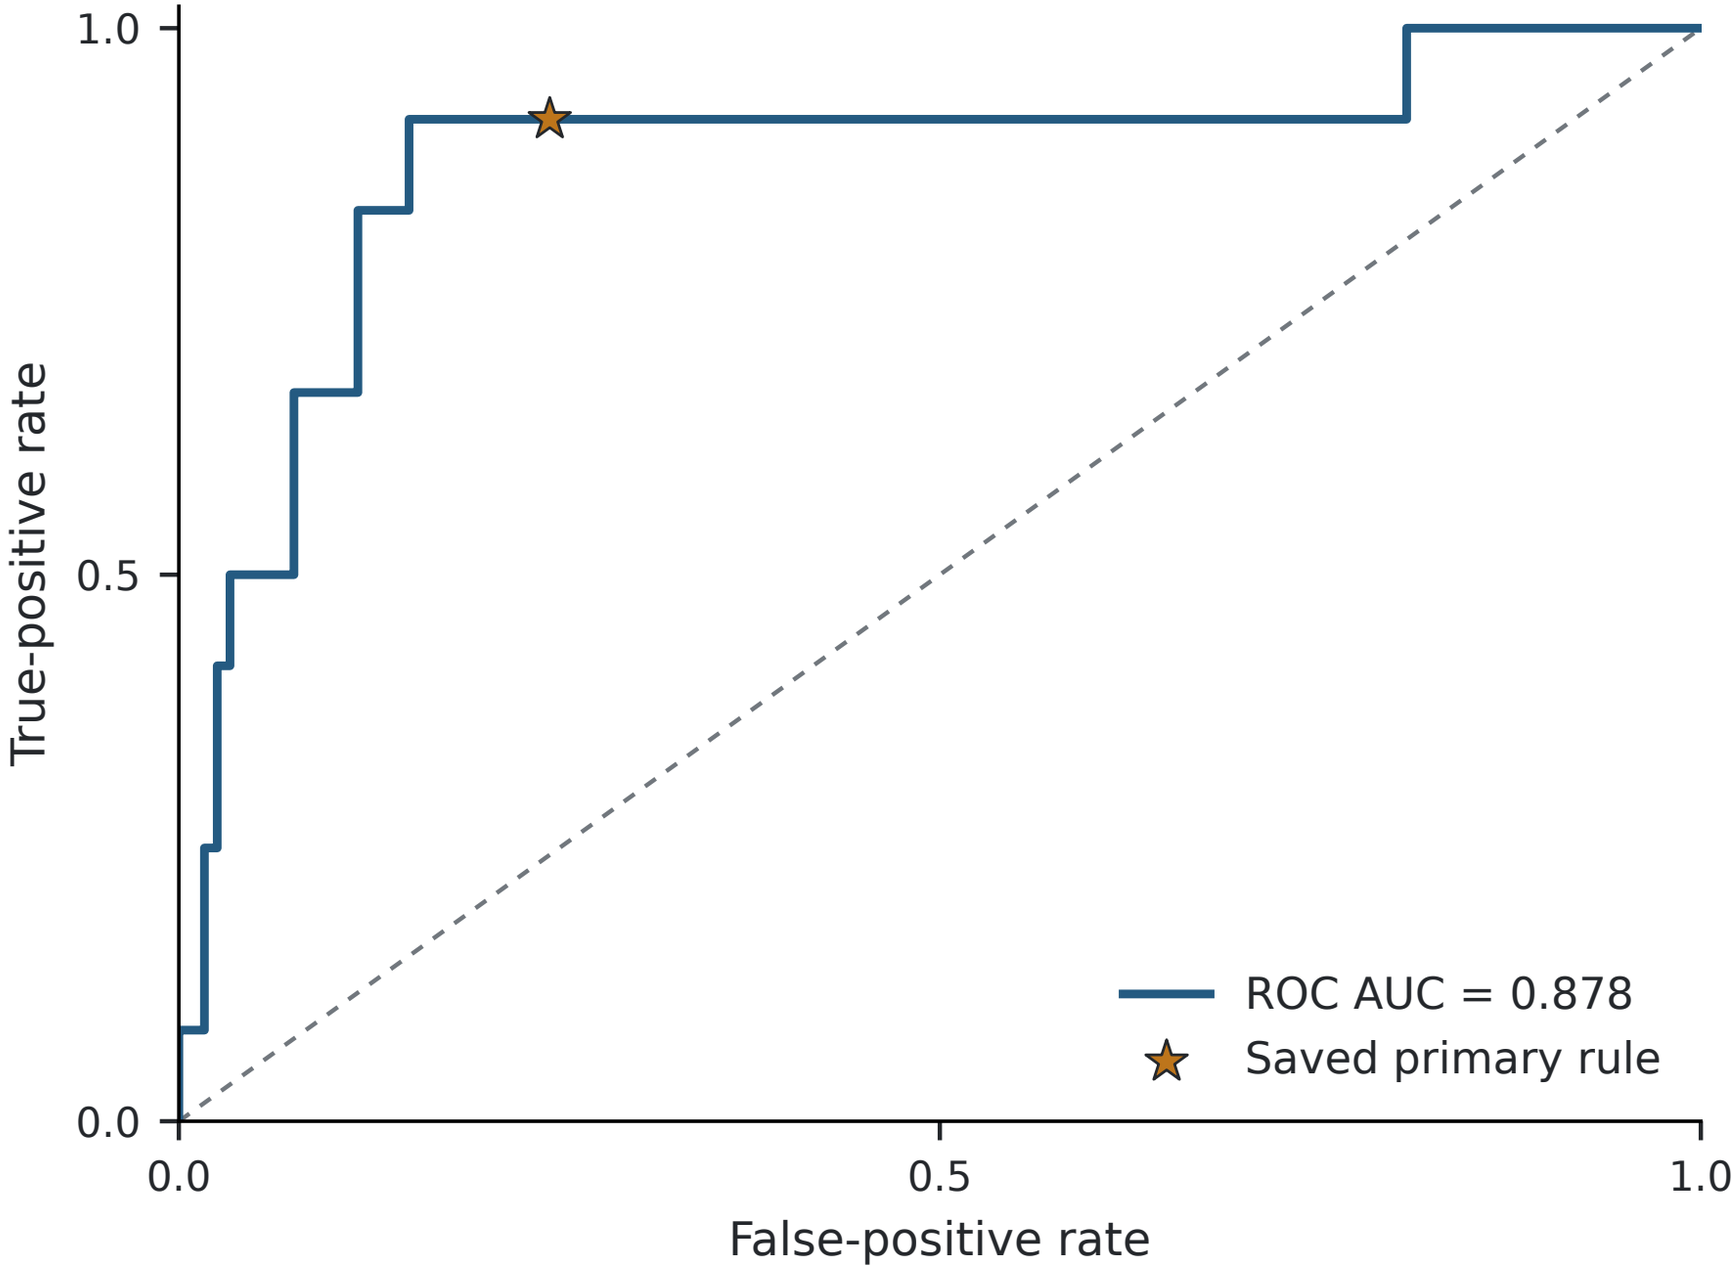

Primary cutoff: 0.0500 ppm

TP 11 | FP 29 | TN 90 | FN 1

Fixed structural labels and eligibility; all CSP cutoffs swept.
AUC measures binding-site localization of CSP magnitude.