1KLQ | apo 52275 / holo 5299

HN CSP ROC | 175 eligible residues

Binding site: 22 | Distal: 153

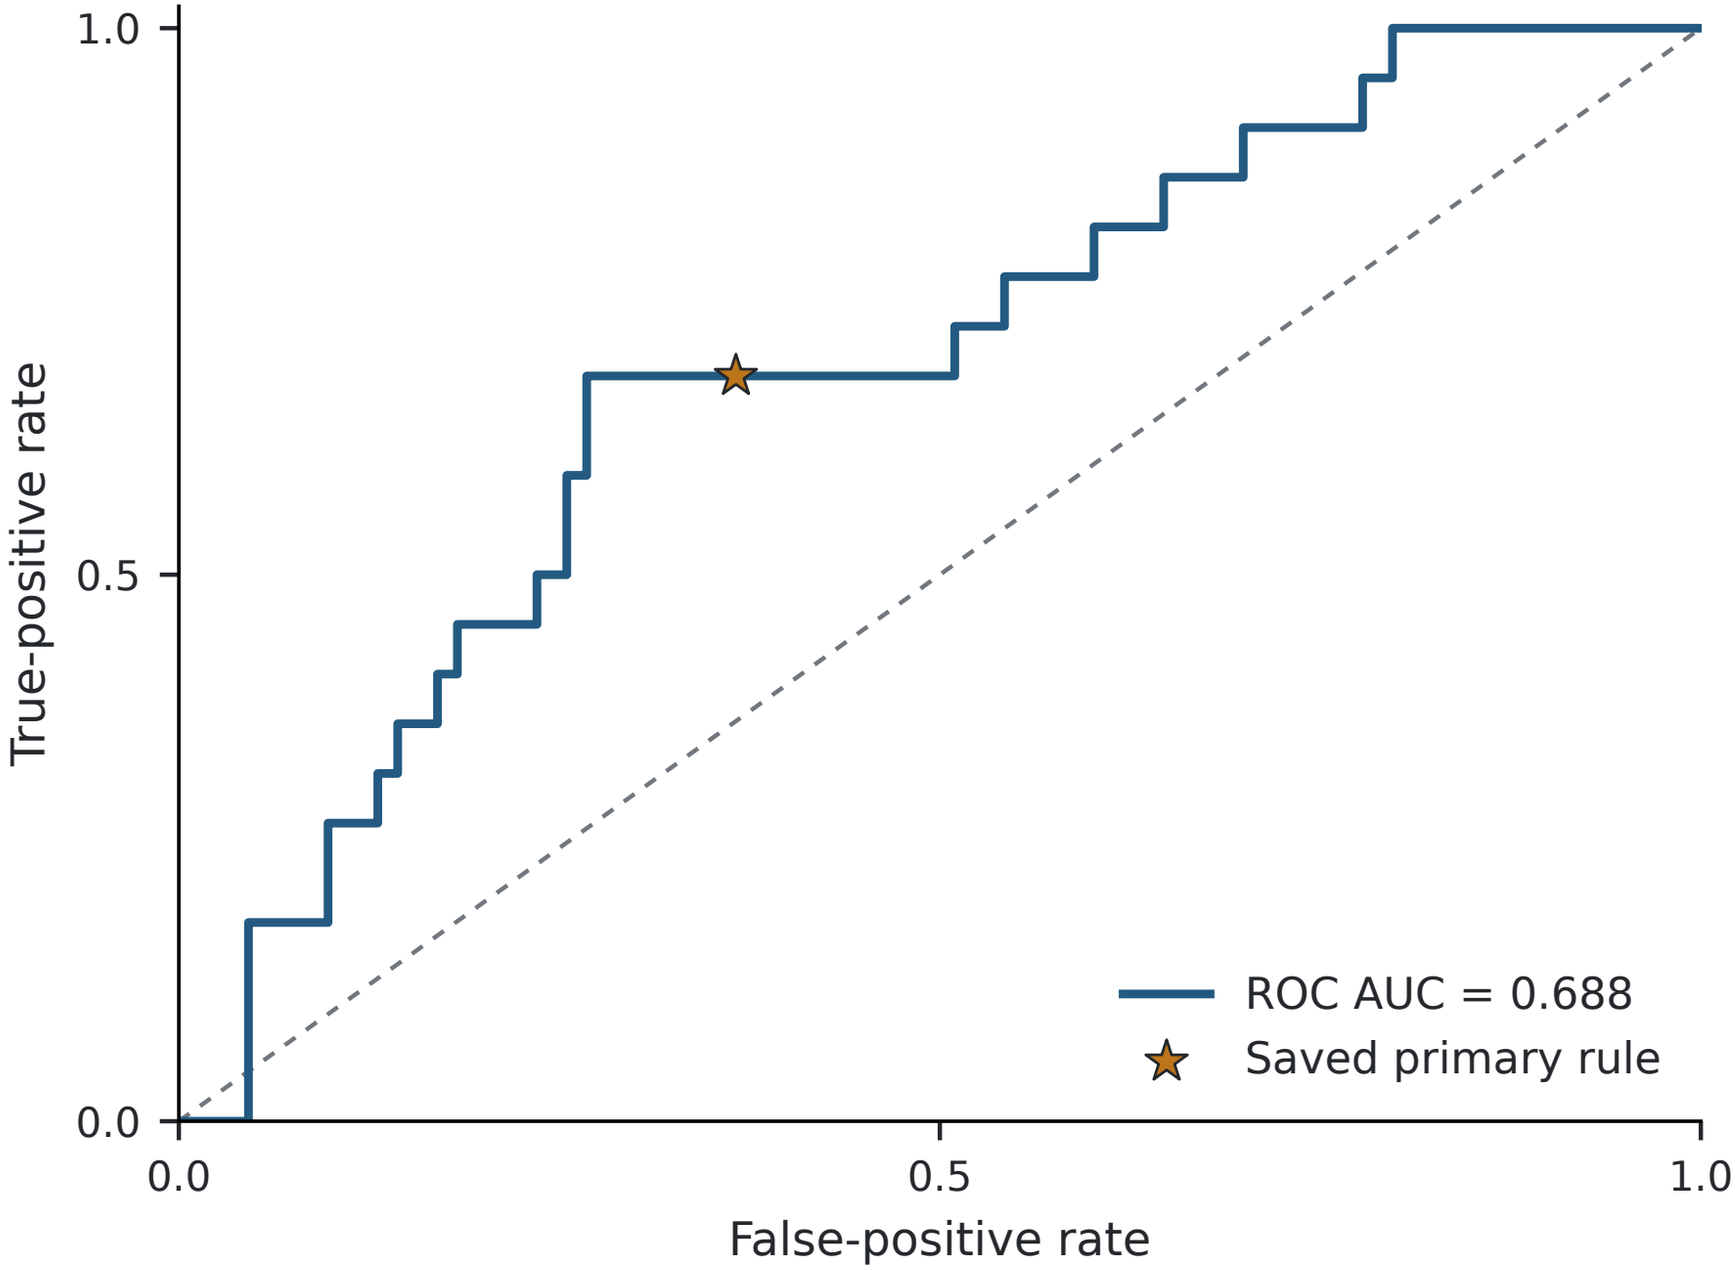

Primary cutoff: 0.3526 ppm

TP 15 | FP 56 | TN 97 | FN 7

Fixed structural labels and eligibility; all CSP cutoffs swept.
AUC measures binding-site localization of CSP magnitude.