1ONV | apo 27288 / holo 5685

HN CSP ROC | 61 eligible residues

Binding site: 12 | Distal: 49

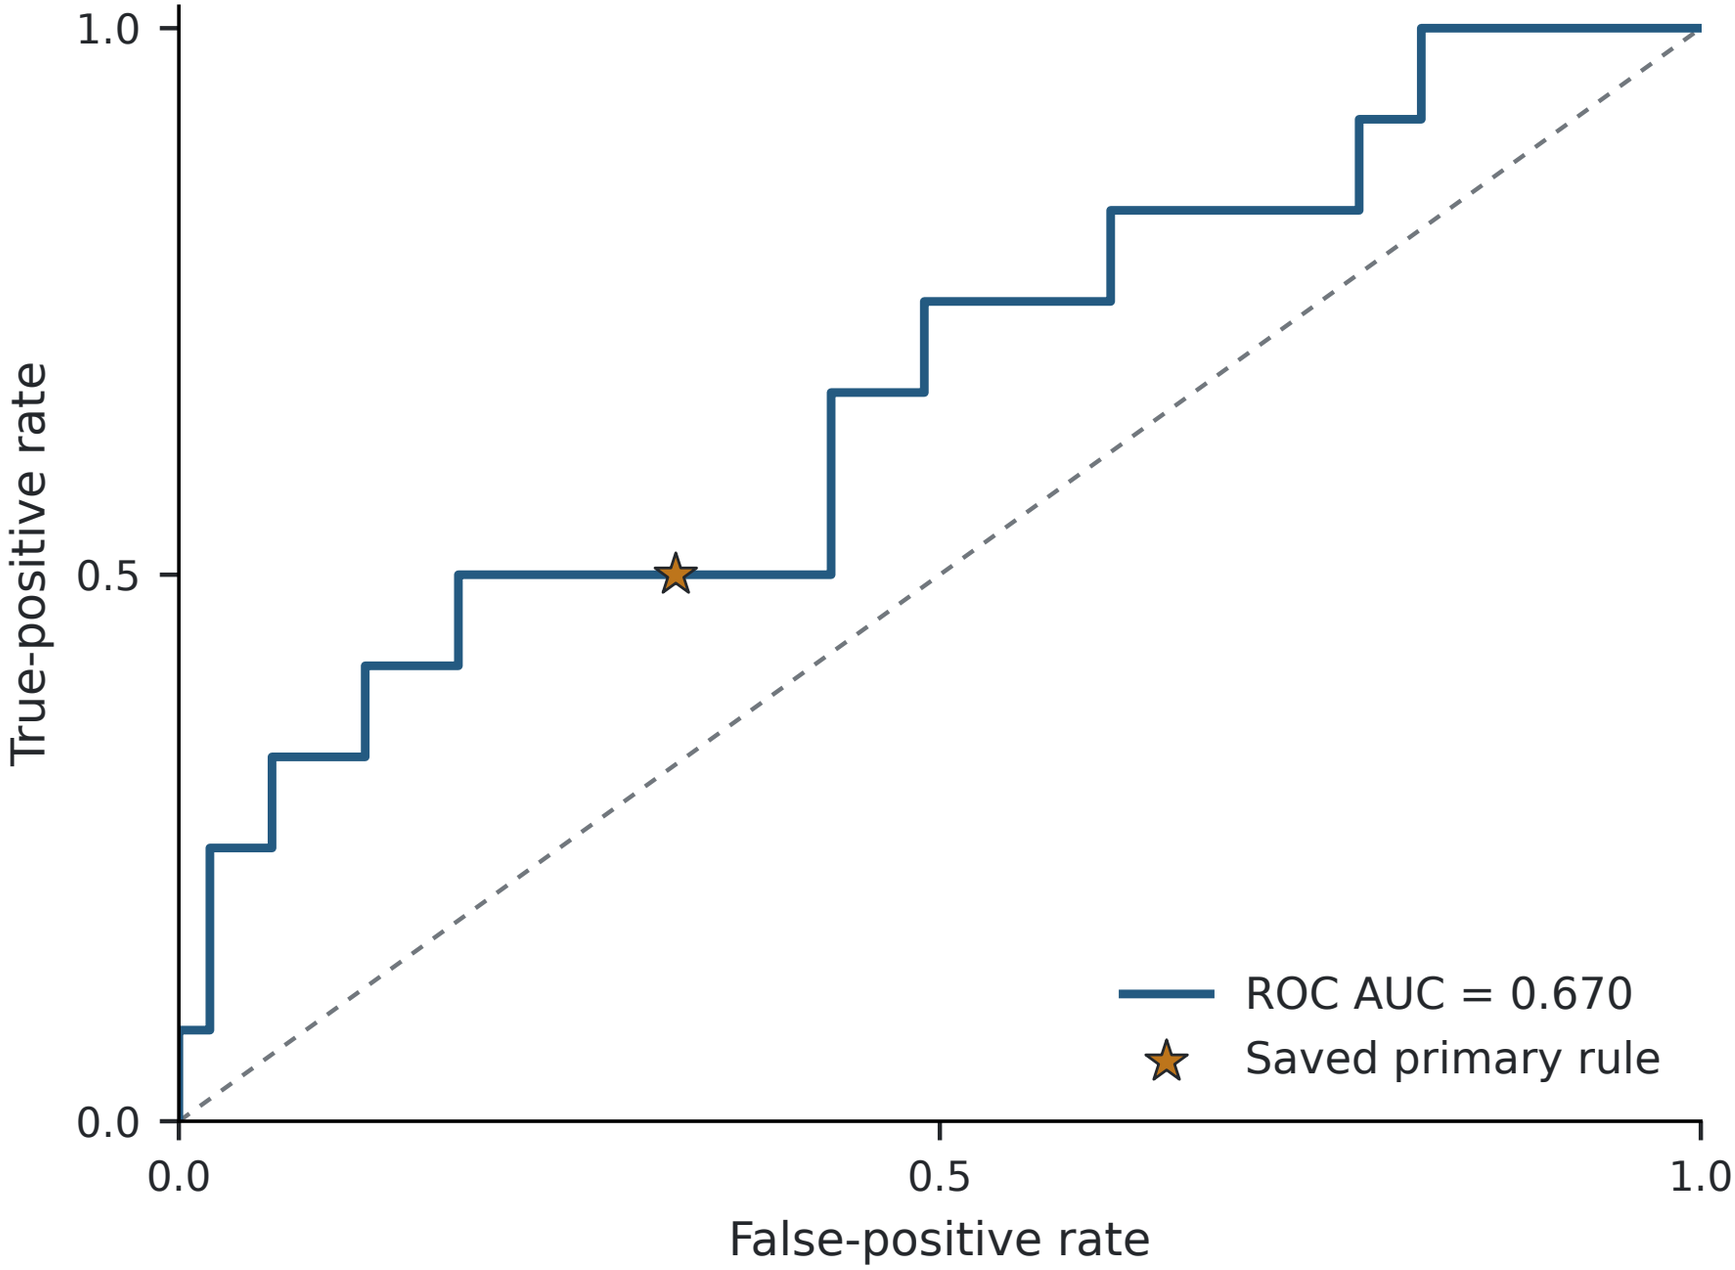

Primary cutoff: 0.1161 ppm

TP 6 | FP 16 | TN 33 | FN 6

Fixed structural labels and eligibility; all CSP cutoffs swept.
AUC measures binding-site localization of CSP magnitude.