1PD7 | apo 6899 / holo 5808

HN CSP ROC | 78 eligible residues

Binding site: 18 | Distal: 60

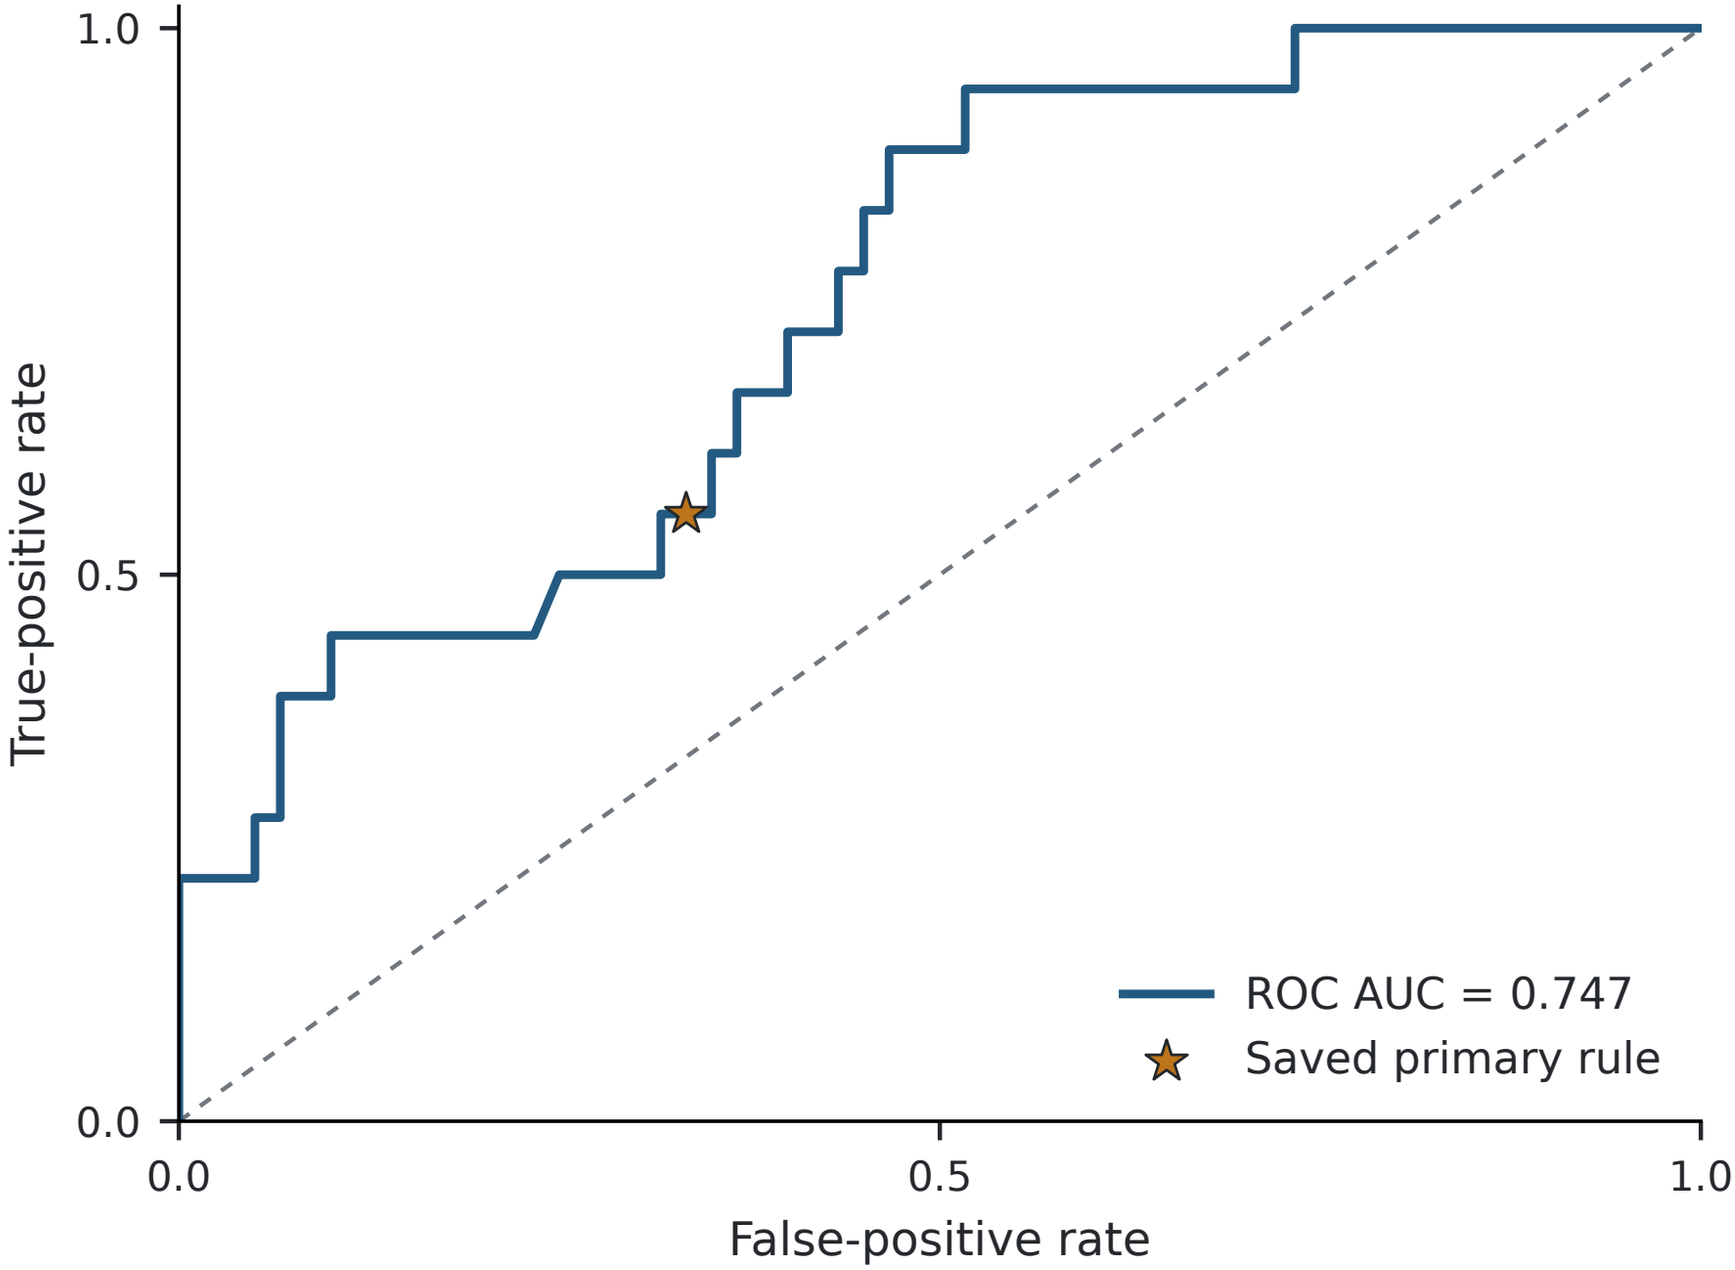

Primary cutoff: 0.1220 ppm

TP 10 | FP 20 | TN 40 | FN 8

Fixed structural labels and eligibility; all CSP cutoffs swept.
AUC measures binding-site localization of CSP magnitude.