1VJ6 | apo 5131 / holo 6060

HN CSP ROC | 83 eligible residues

Binding site: 11 | Distal: 72

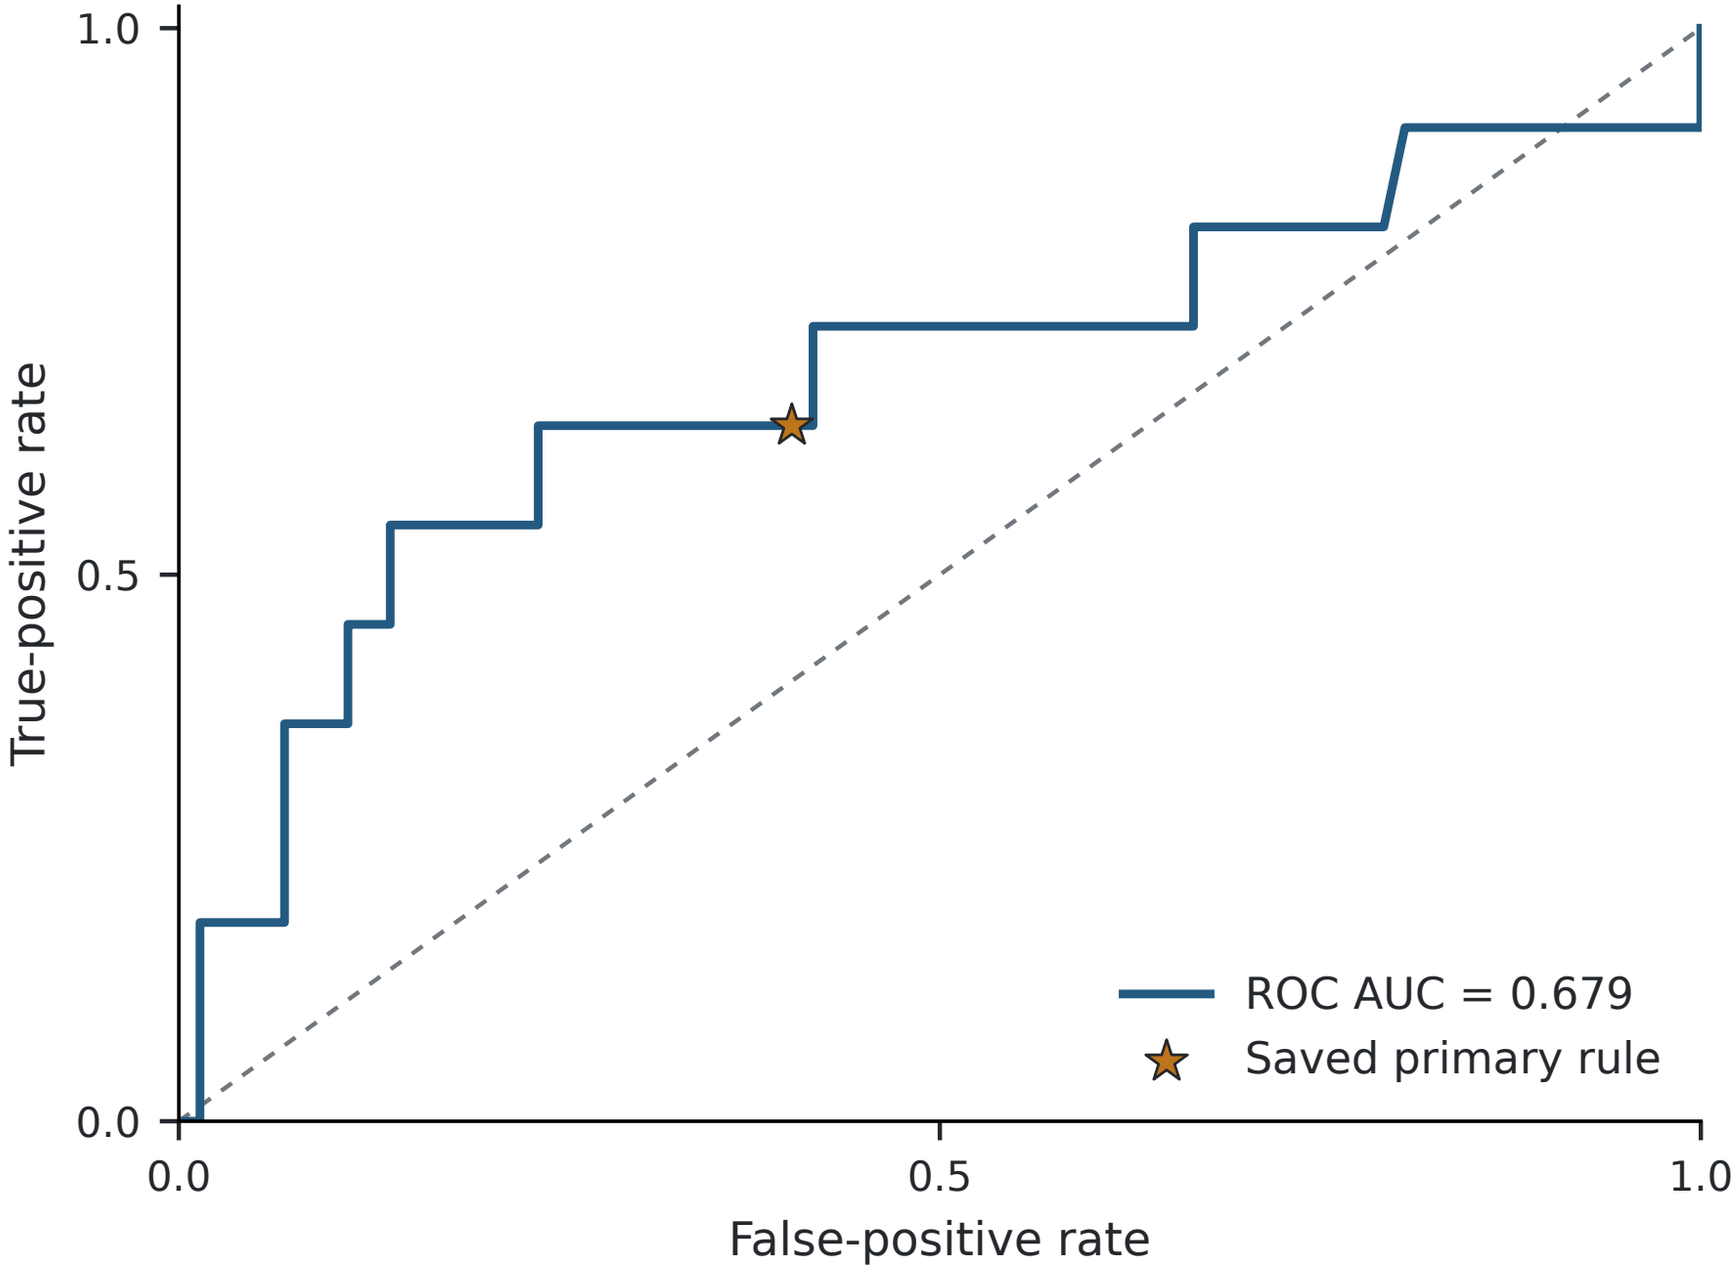

Primary cutoff: 0.0593 ppm

TP 7 | FP 29 | TN 43 | FN 4

Fixed structural labels and eligibility; all CSP cutoffs swept.
AUC measures binding-site localization of CSP magnitude.