1WA7 | apo 6261 / holo 6456

HN CSP ROC | 55 eligible residues

Binding site: 13 | Distal: 42

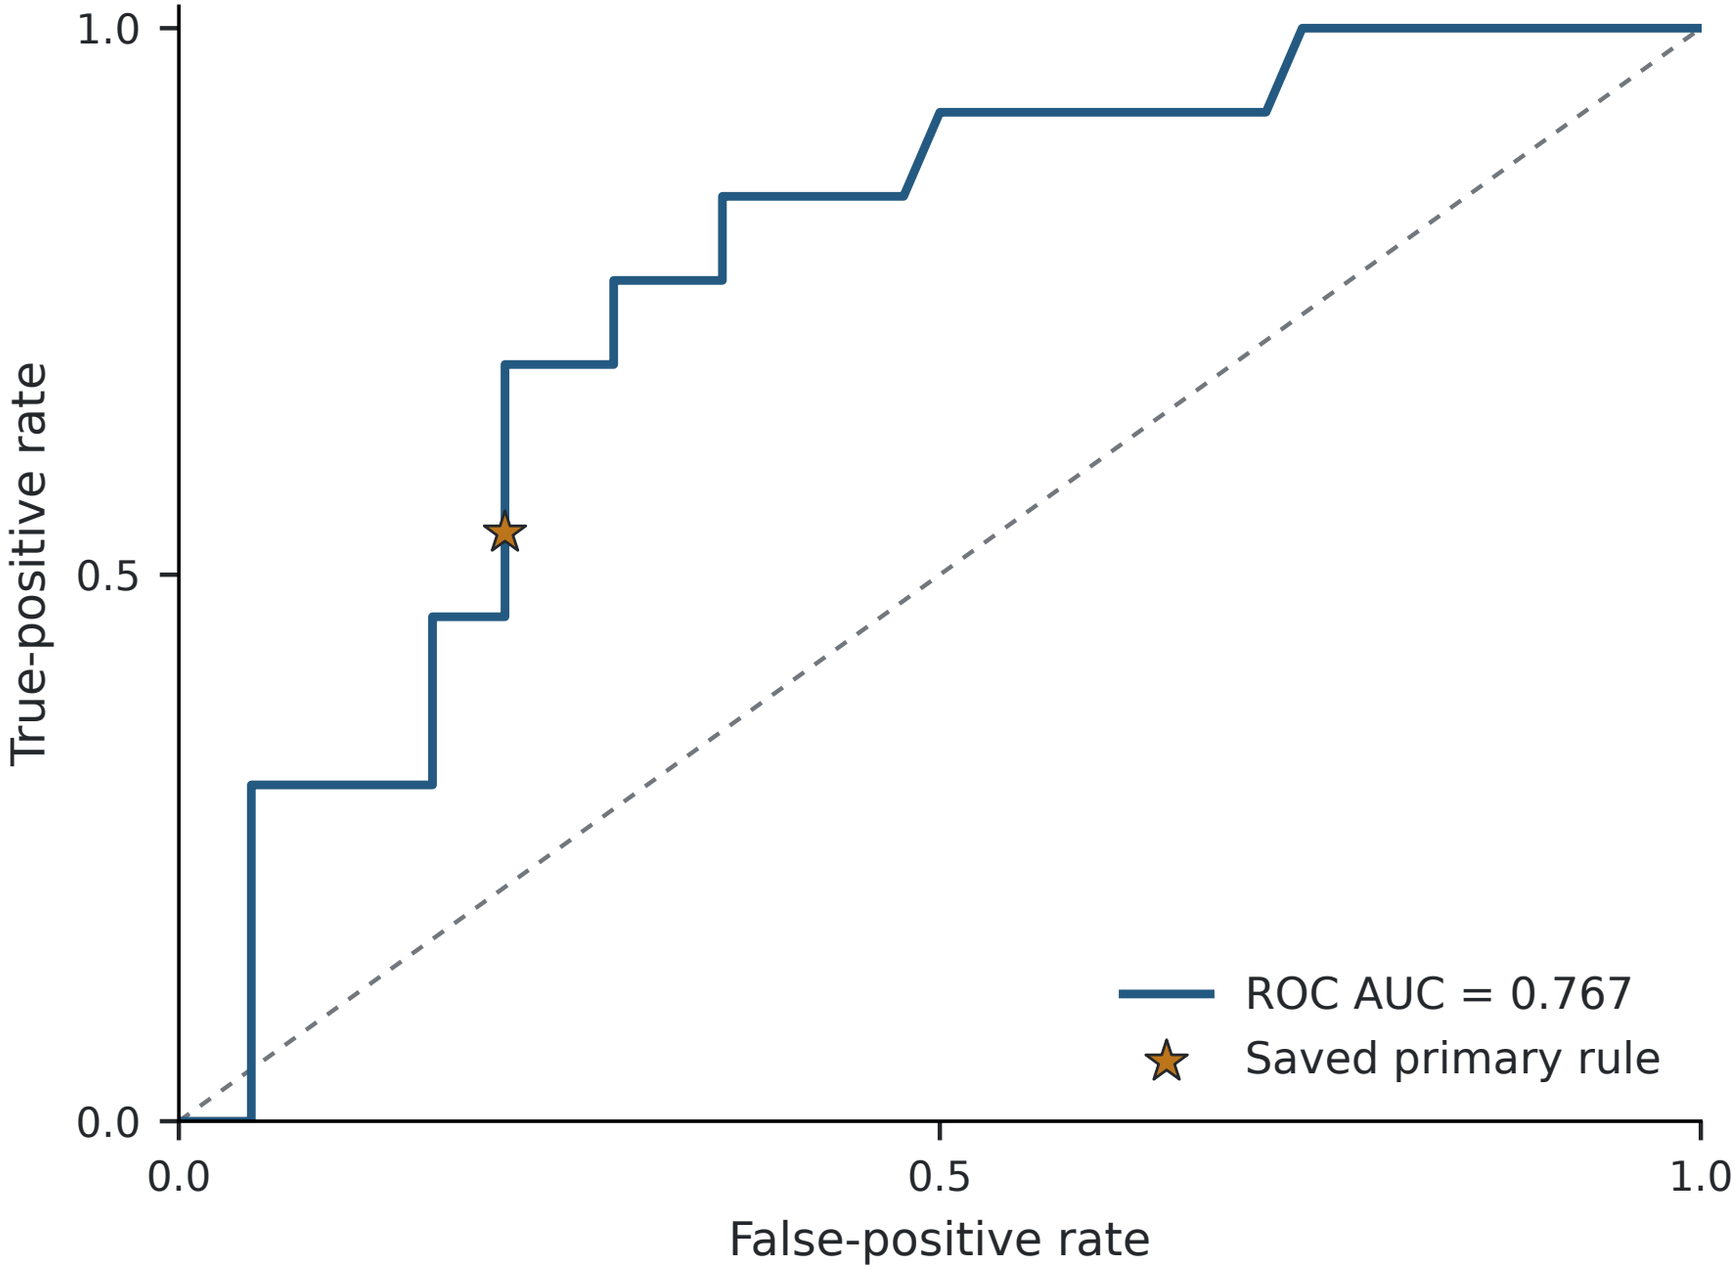

Primary cutoff: 0.0500 ppm

TP 7 | FP 9 | TN 33 | FN 6

Fixed structural labels and eligibility; all CSP cutoffs swept.
AUC measures binding-site localization of CSP magnitude.