1YWI | apo 6558 / holo 6559

HN CSP ROC | 26 eligible residues

Binding site: 8 | Distal: 18

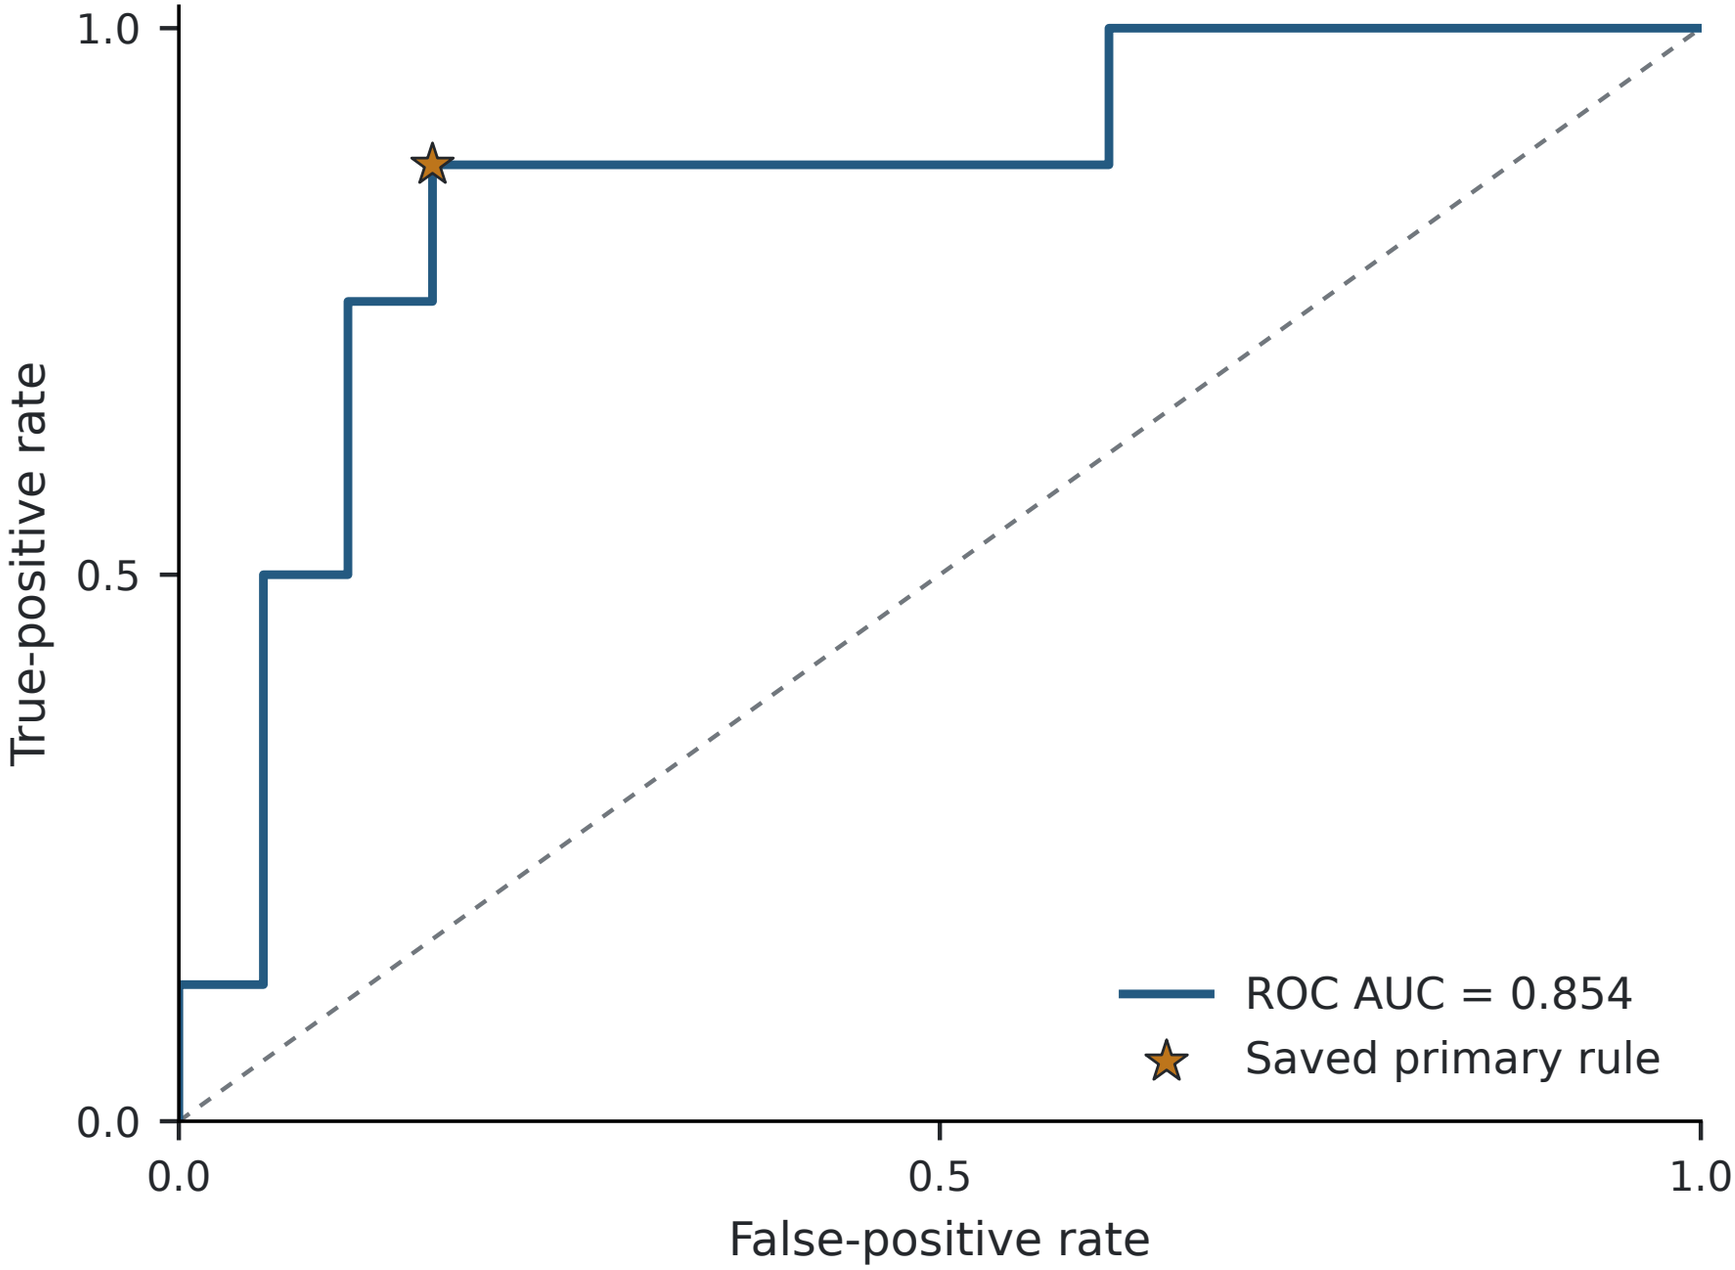

Primary cutoff: 0.0581 ppm

TP 7 | FP 3 | TN 15 | FN 1

Fixed structural labels and eligibility; all CSP cutoffs swept.
AUC measures binding-site localization of CSP magnitude.