2FFK | apo 6809 / holo 7024

HN CSP ROC | 190 eligible residues

Binding site: 13 | Distal: 177

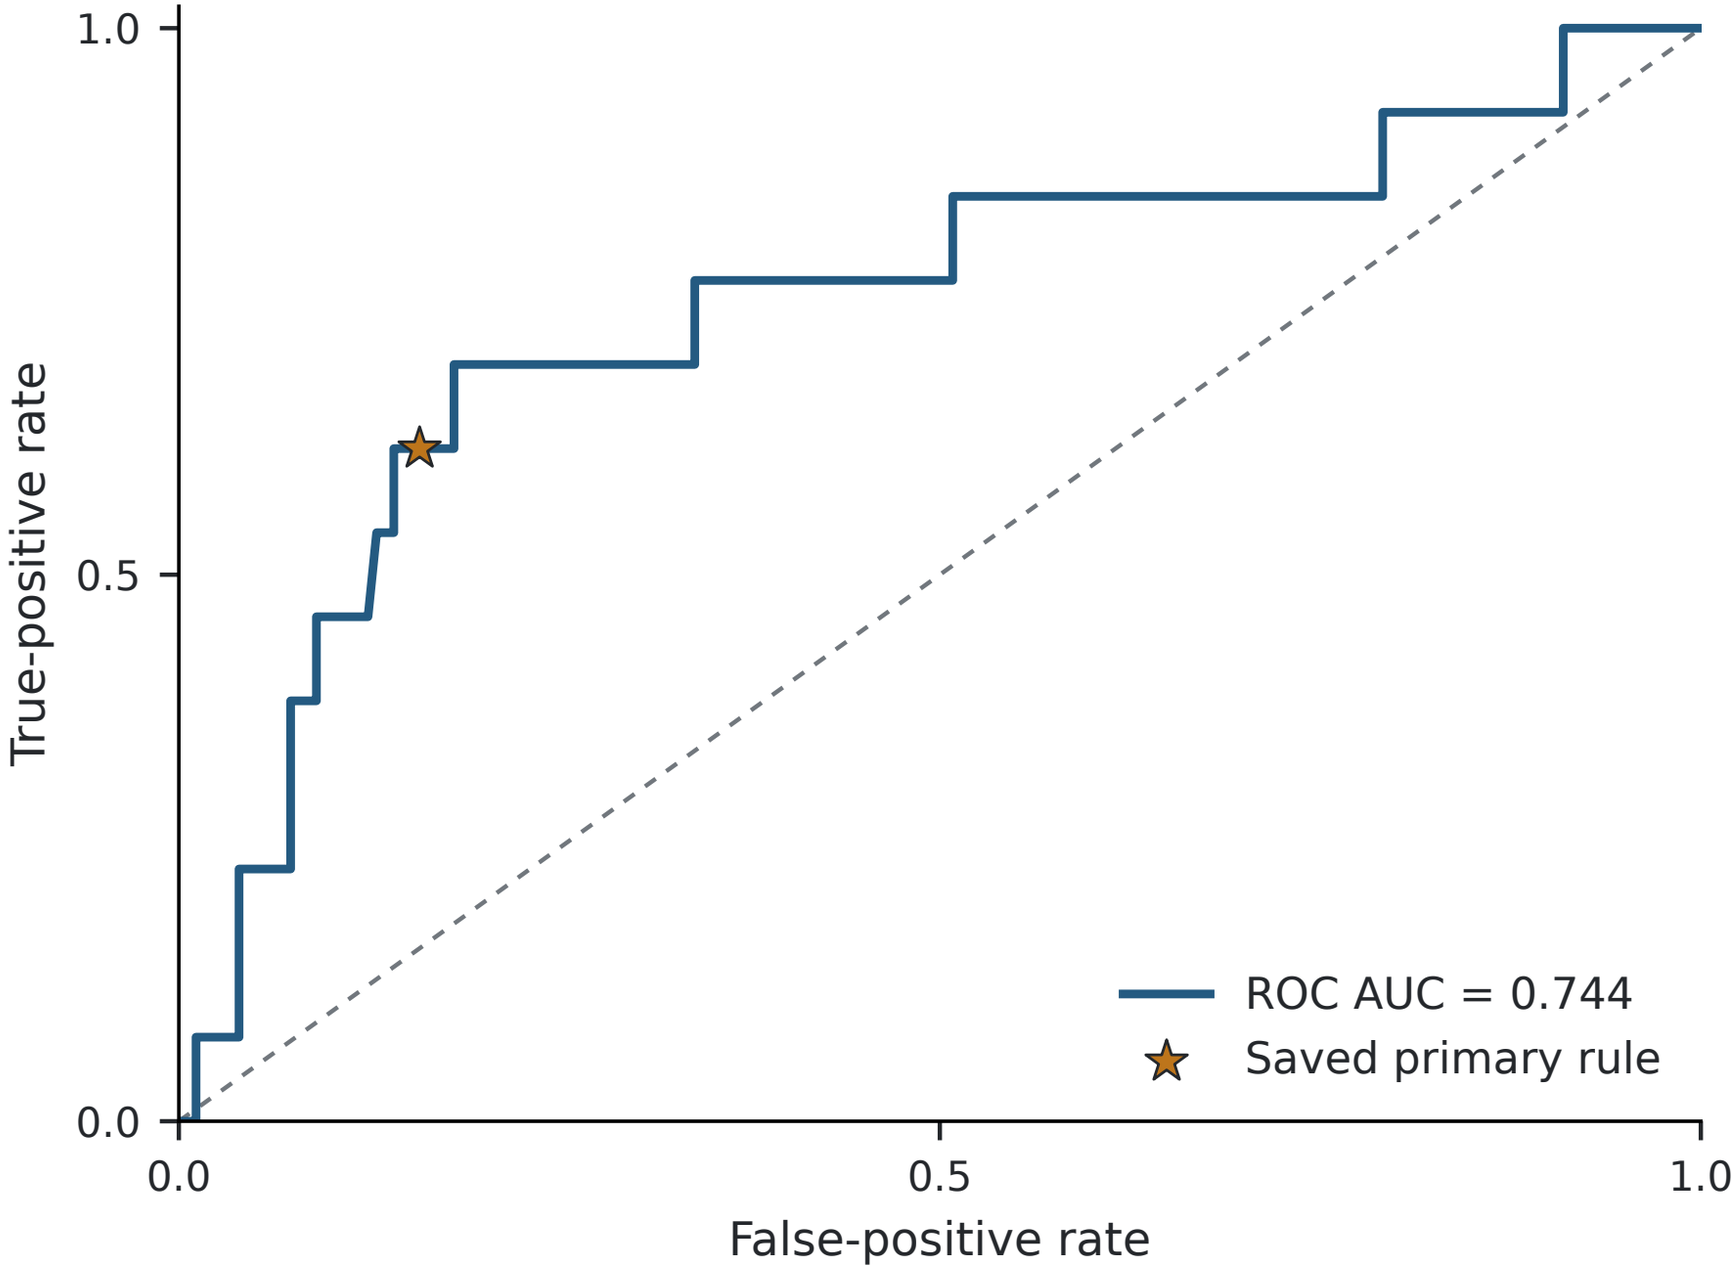

Primary cutoff: 0.0500 ppm

TP 8 | FP 28 | TN 149 | FN 5

Fixed structural labels and eligibility; all CSP cutoffs swept.
AUC measures binding-site localization of CSP magnitude.