# 2FIN | apo 6809 / holo 7024

HN CSP ROC | 190 eligible residues

Binding site: 7 | Distal: 183

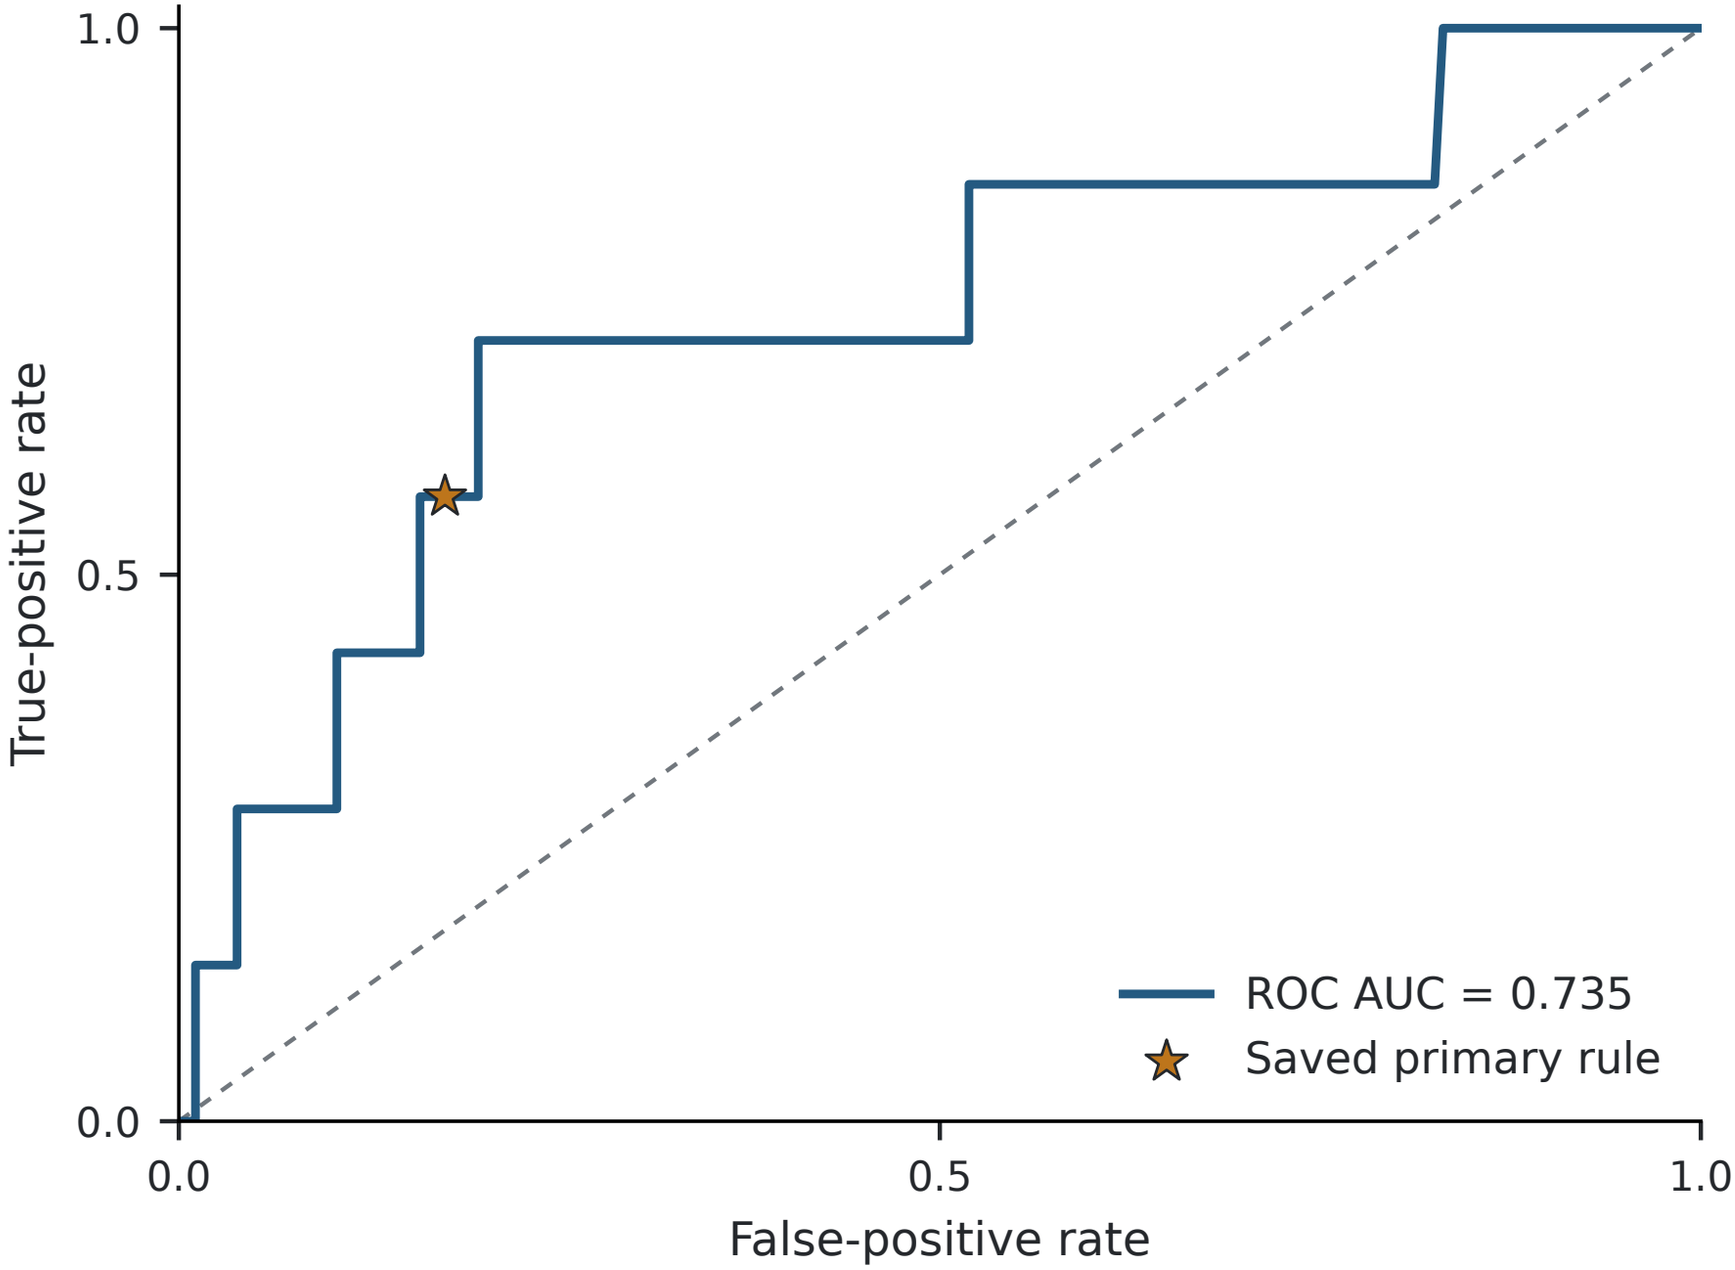


Primary cutoff: 0.0500 ppm

TP 4 | FP 32 | TN 151 | FN 3

Fixed structural labels and eligibility; all CSP cutoffs swept.
AUC measures binding-site localization of CSP magnitude.