# 2I94 | apo 5332 / holo 7293

HN CSP ROC | 154 eligible residues

Binding site: 20 | Distal: 134

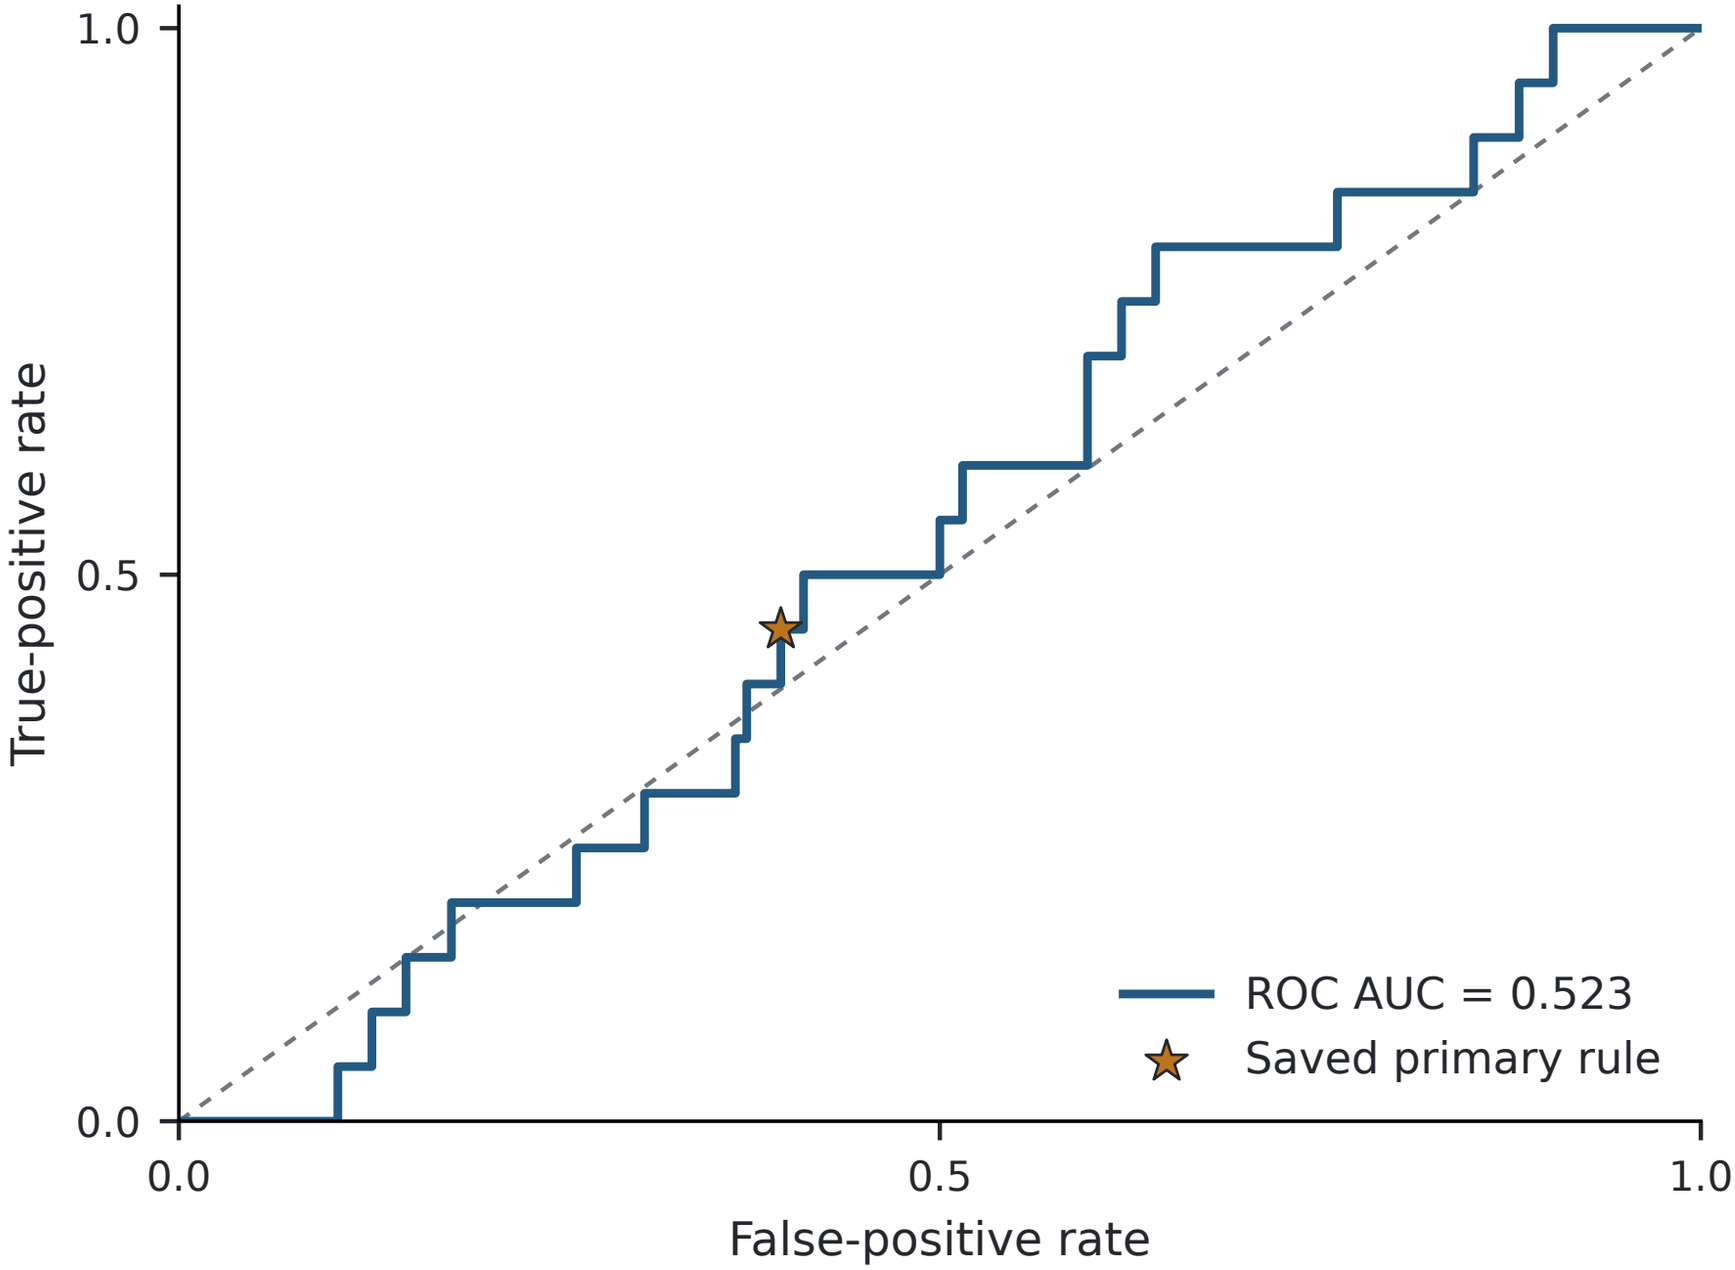


Primary cutoff: 0.2046 ppm

TP 9 | FP 53 | TN 81 | FN 11

Fixed structural labels and eligibility; all CSP cutoffs swept.
AUC measures binding-site localization of CSP magnitude.