2IPA | apo 6075 / holo 15028

HN CSP ROC | 124 eligible residues

Binding site: 7 | Distal: 117

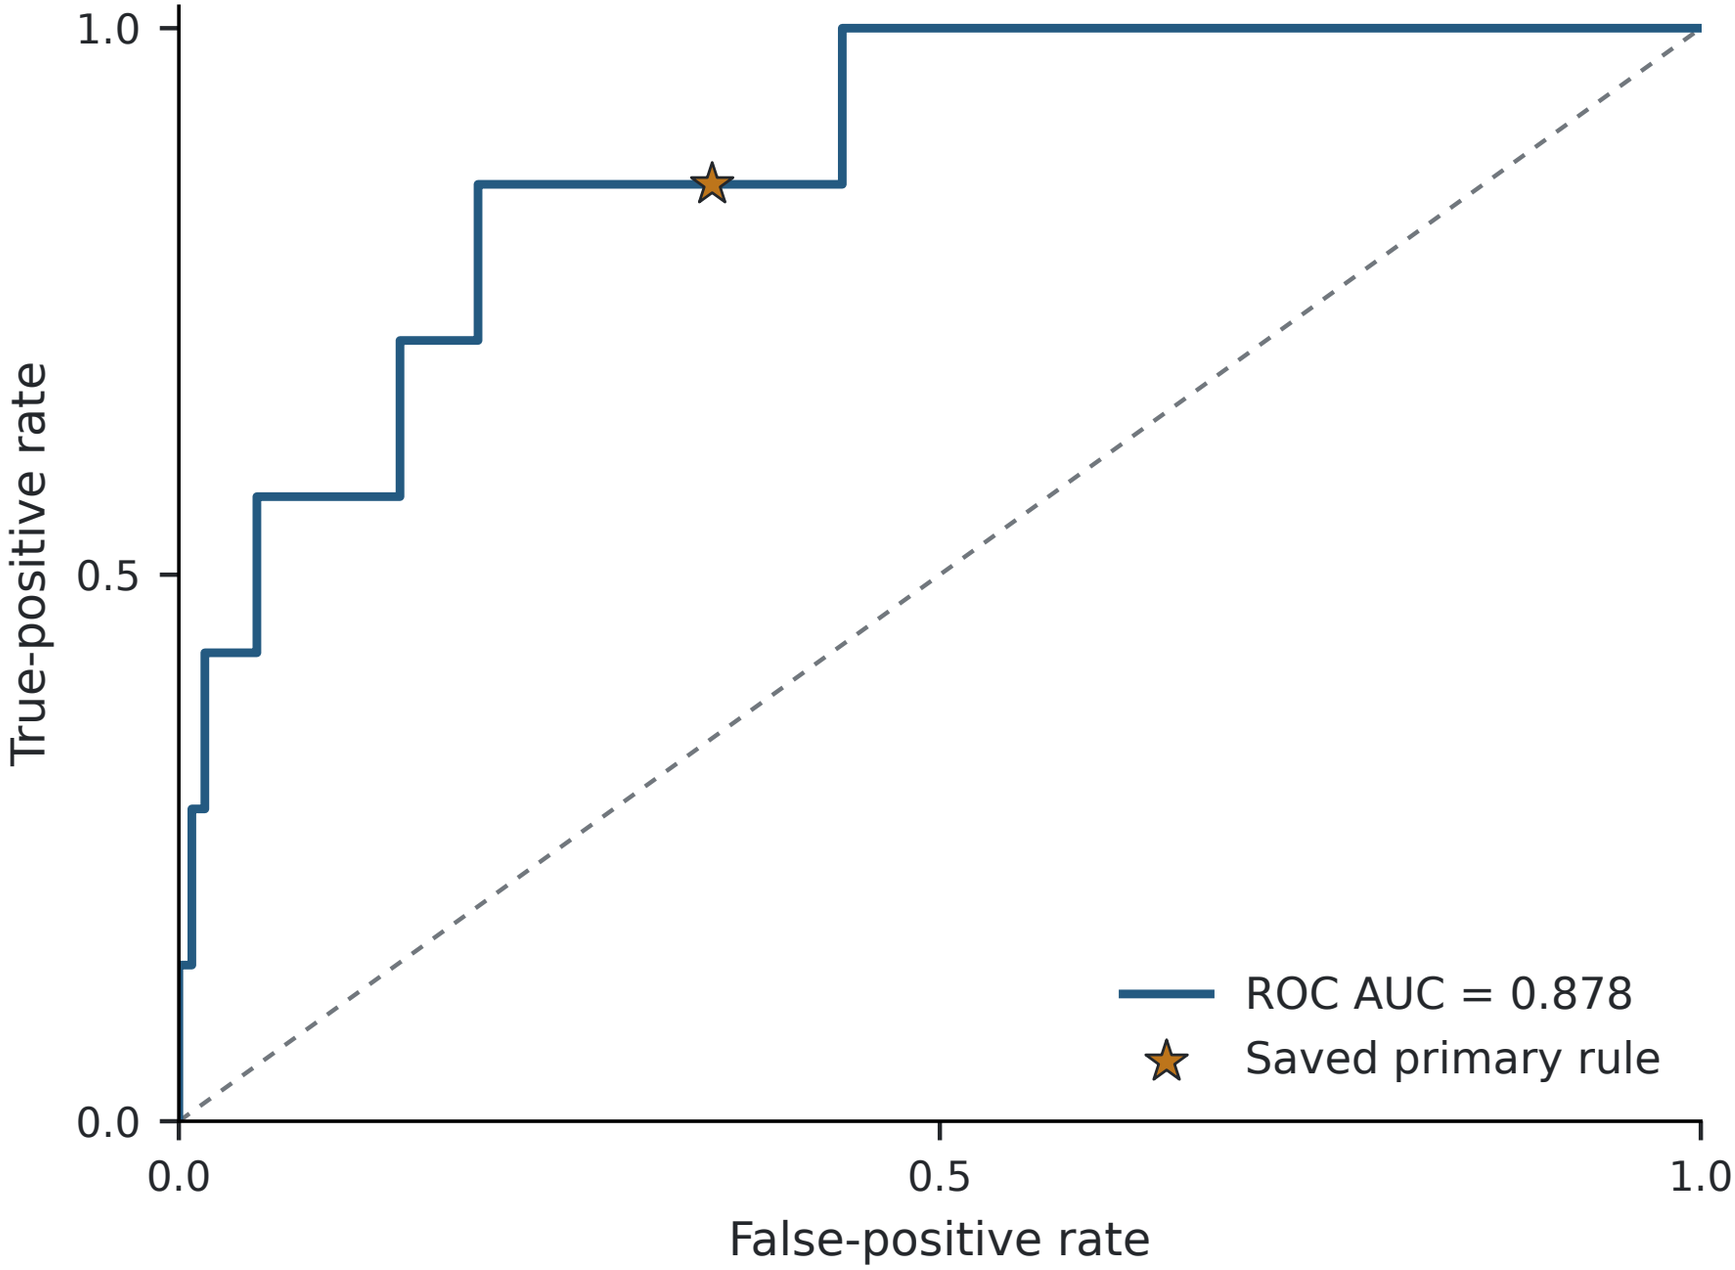

Primary cutoff: 0.0500 ppm

TP 6 | FP 41 | TN 76 | FN 1

Fixed structural labels and eligibility; all CSP cutoffs swept.
AUC measures binding-site localization of CSP magnitude.