2JMX | apo 6564 / holo 15072

HN CSP ROC | 92 eligible residues

Binding site: 4 | Distal: 88

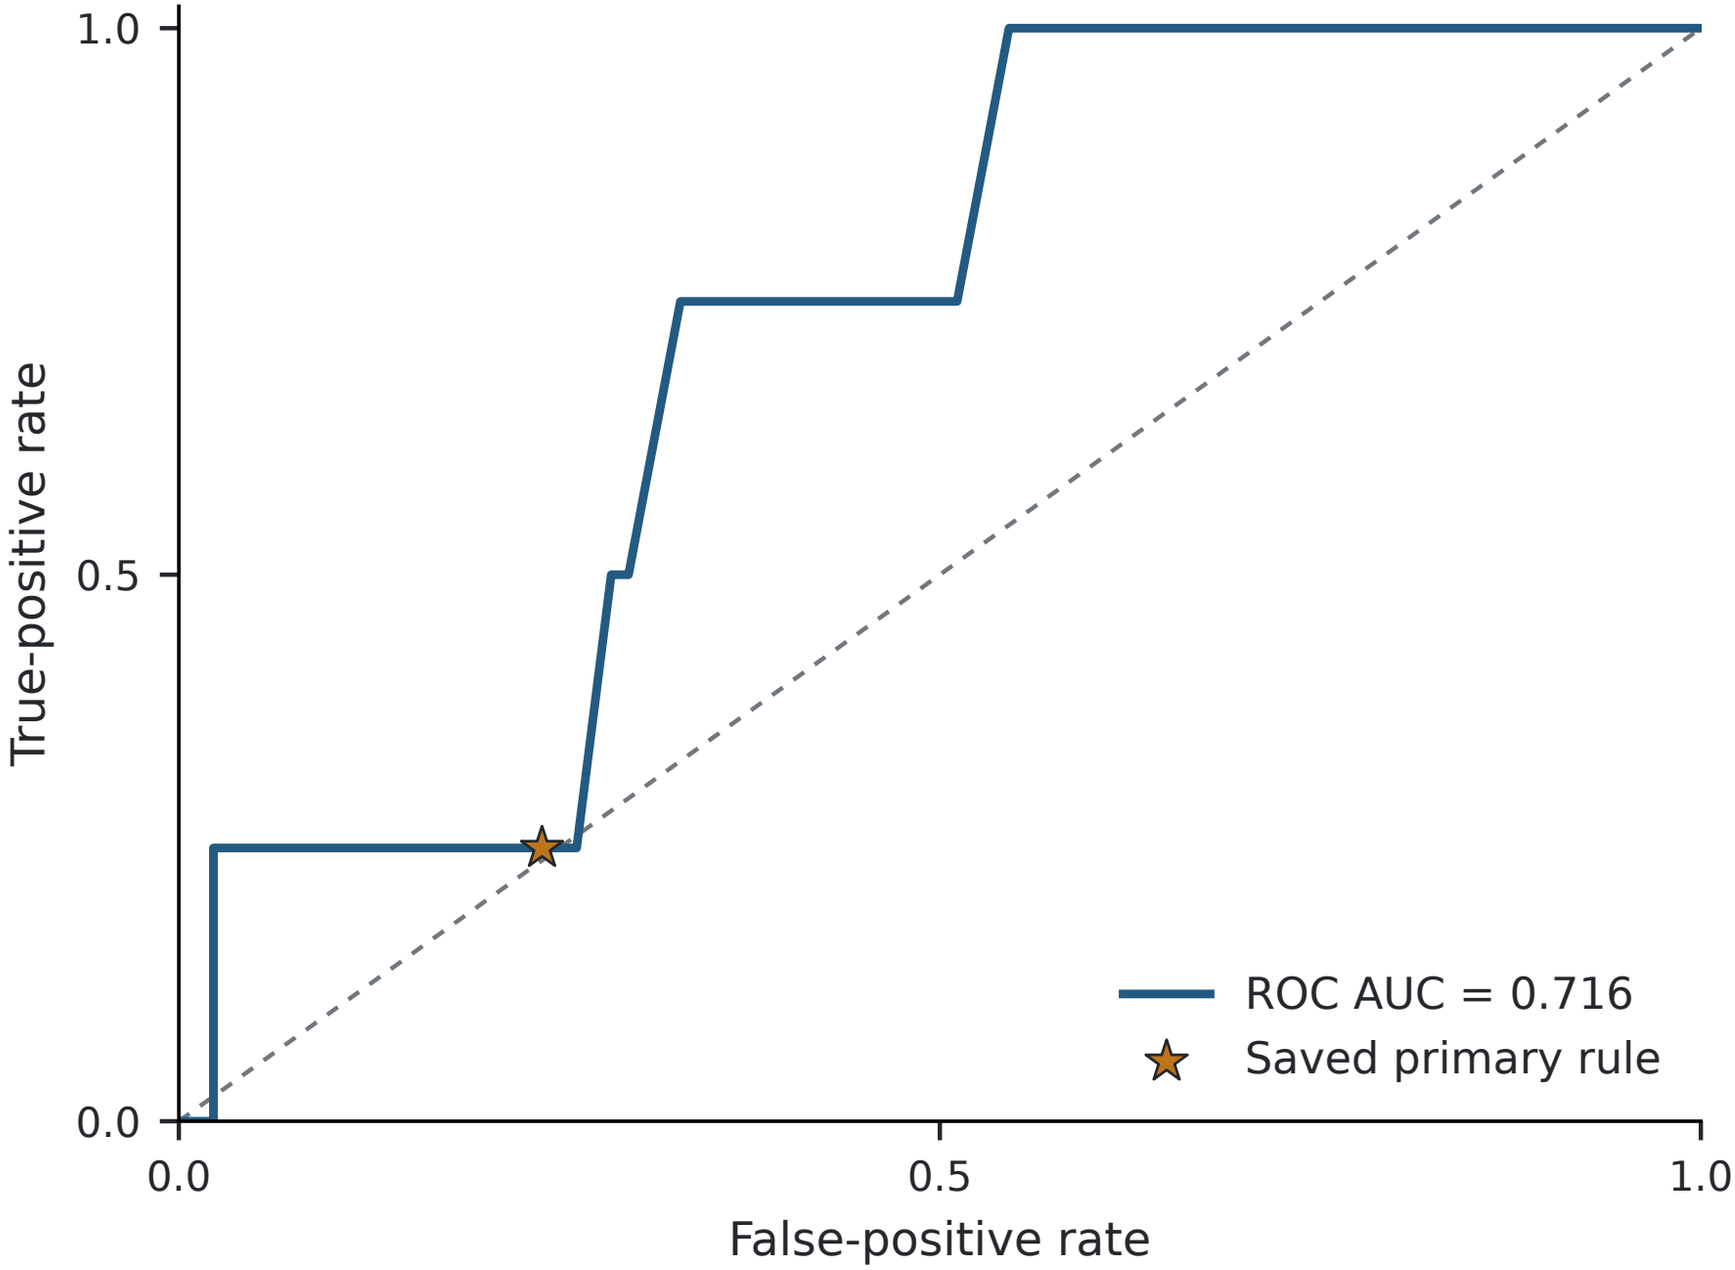

Primary cutoff: 0.0500 ppm

TP 1 | FP 21 | TN 67 | FN 3

Fixed structural labels and eligibility; all CSP cutoffs swept.
AUC measures binding-site localization of CSP magnitude.