2JXC | apo 4184 / holo 15554

HN CSP ROC | 81 eligible residues

Binding site: 26 | Distal: 55

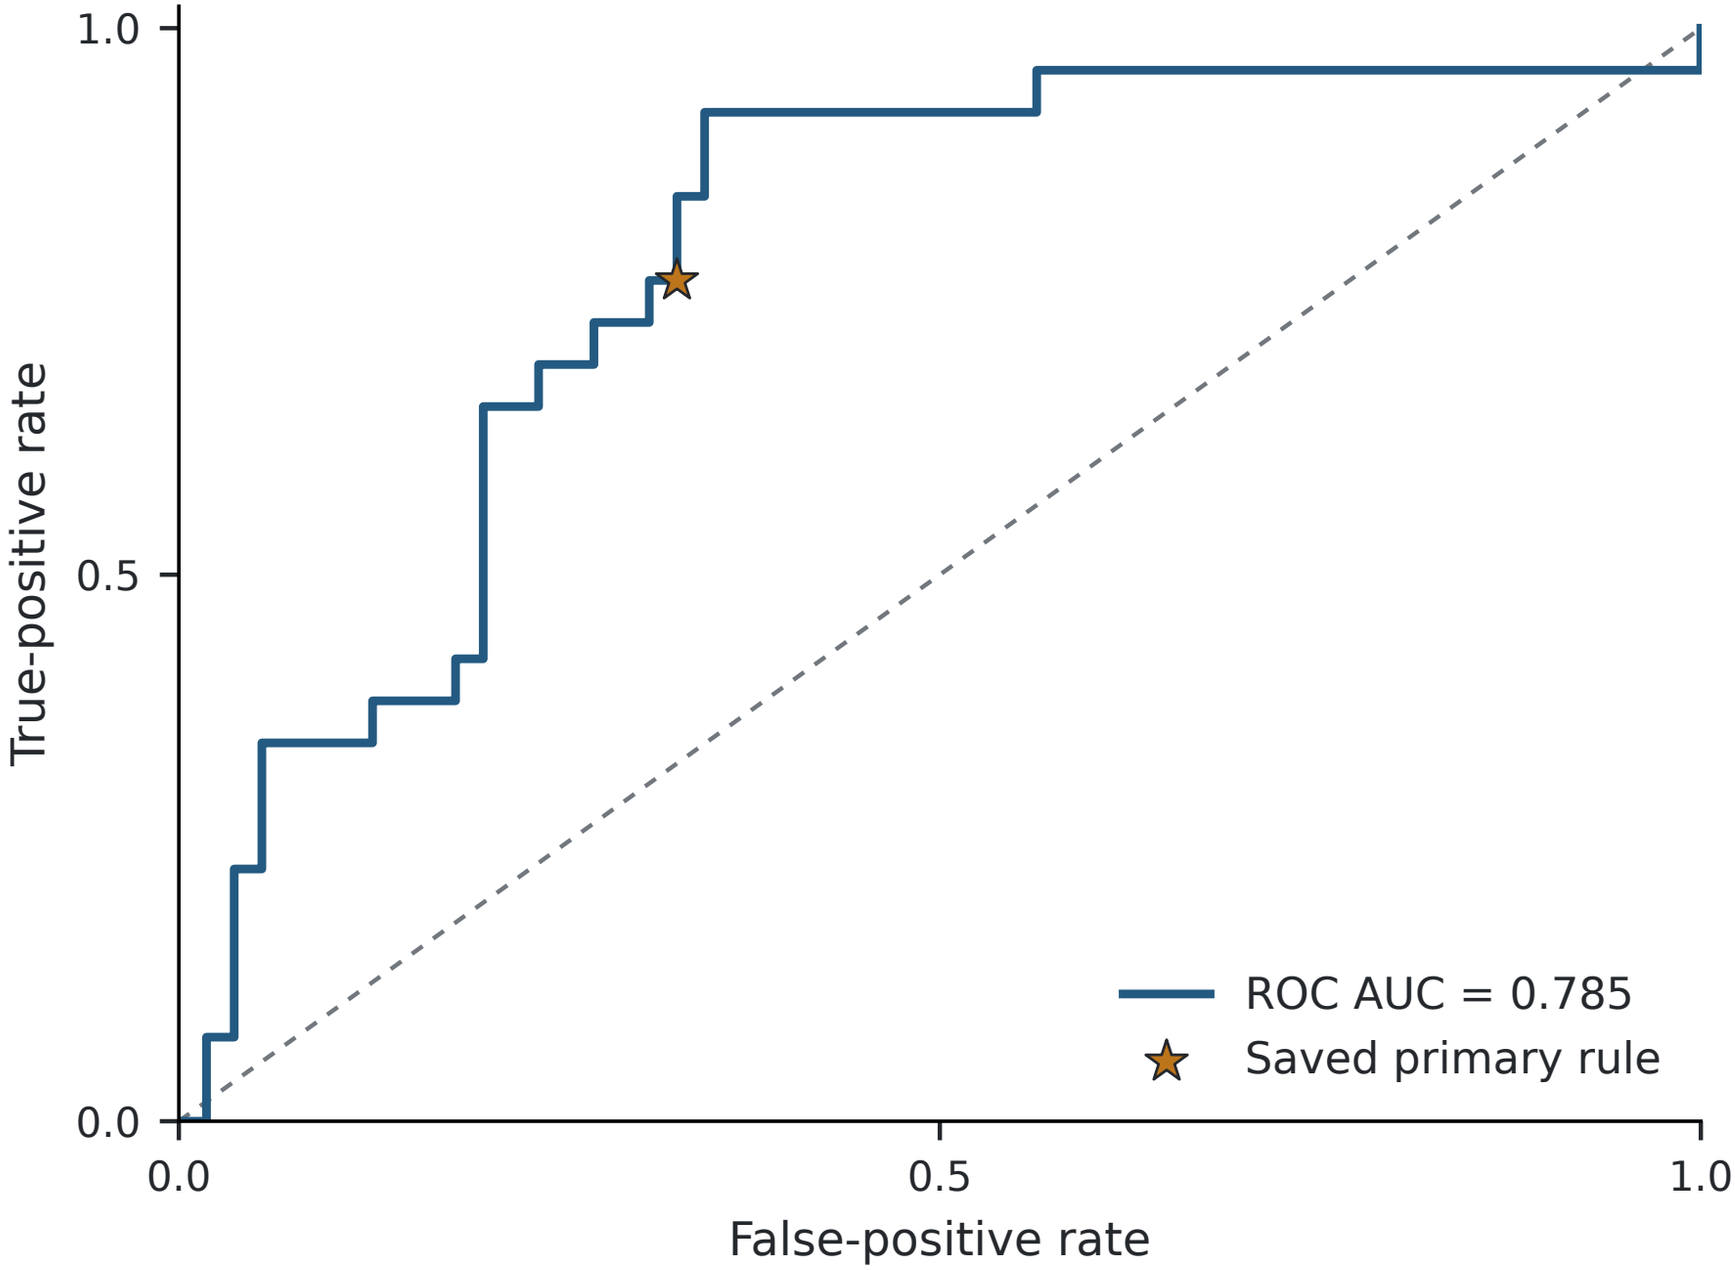

Primary cutoff: 0.0515 ppm

TP 20 | FP 18 | TN 37 | FN 6

Fixed structural labels and eligibility; all CSP cutoffs swept.
AUC measures binding-site localization of CSP magnitude.