2JZI | apo 51289 / holo 15624

HN CSP ROC | 143 eligible residues

Binding site: 38 | Distal: 105

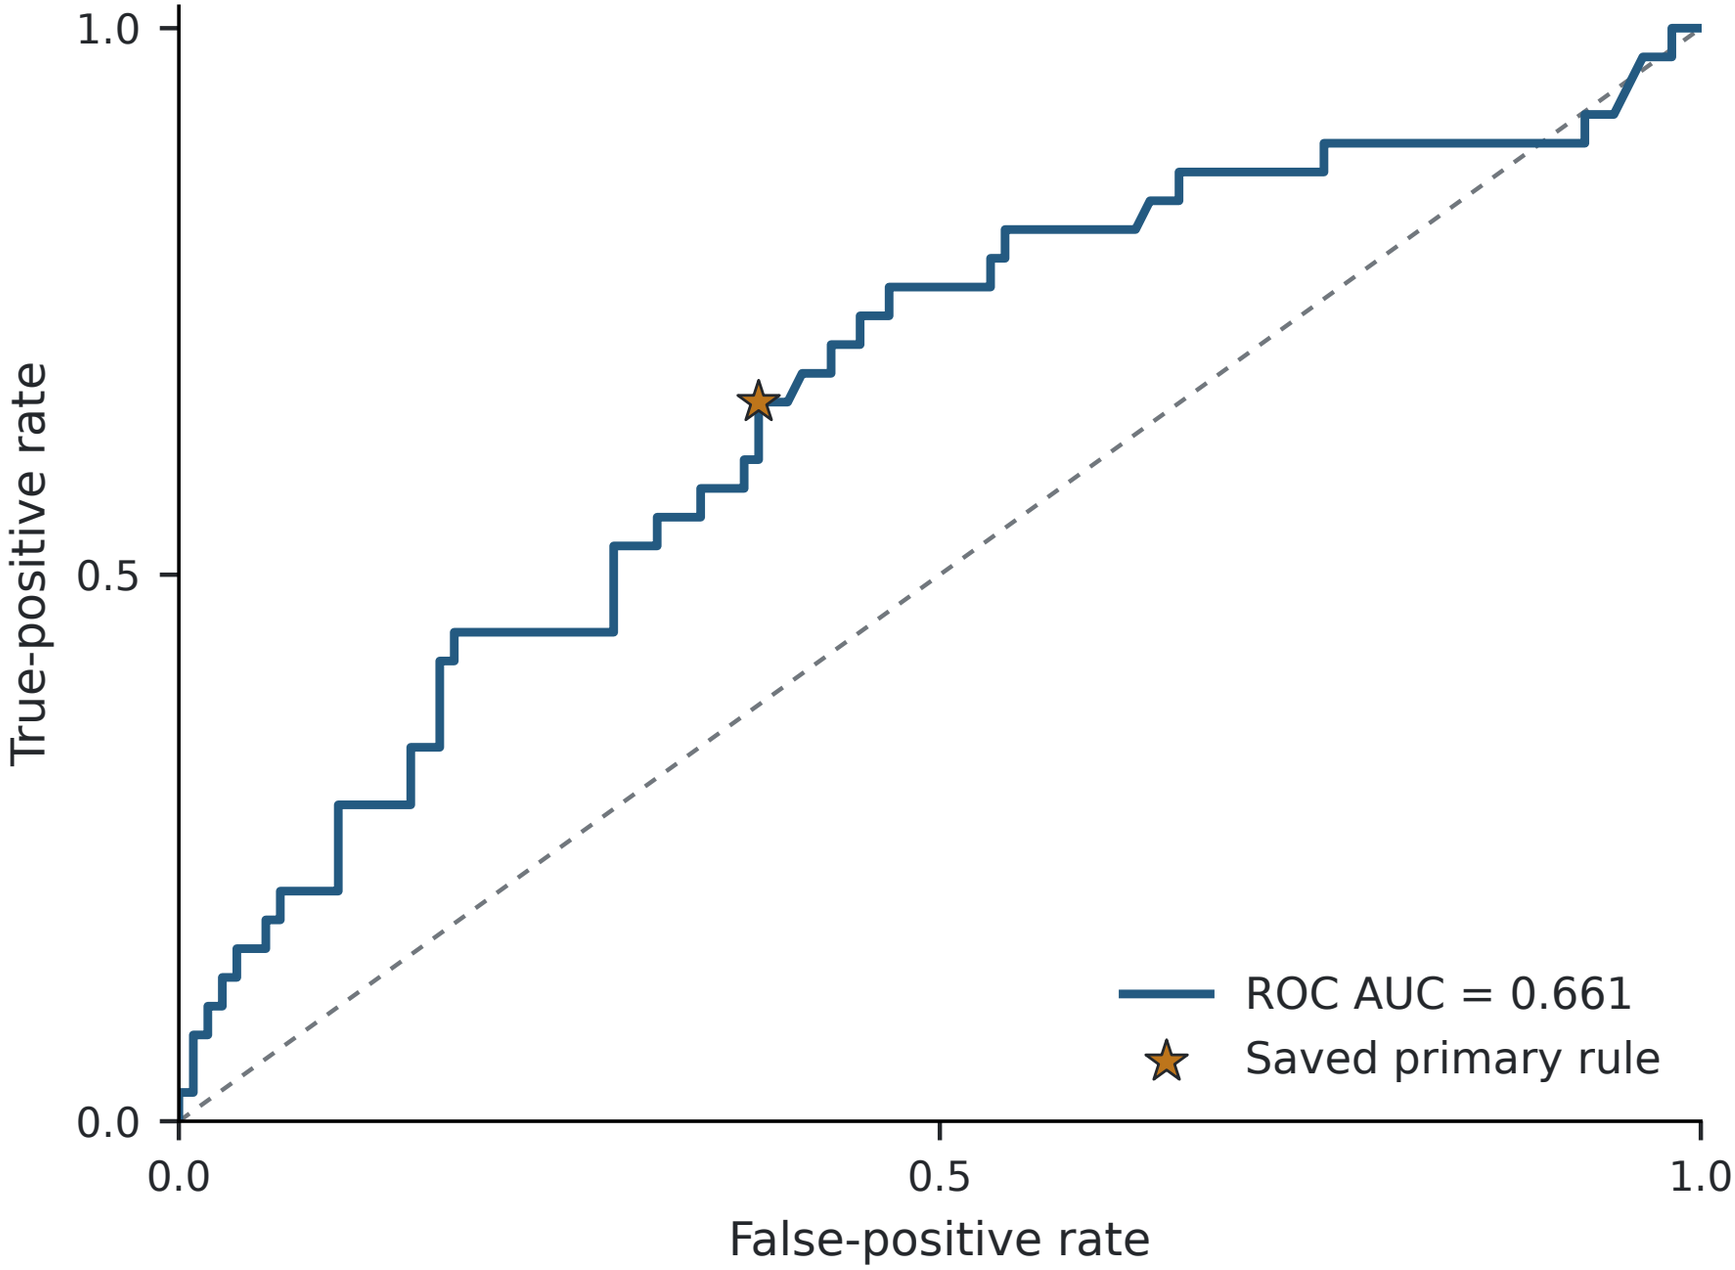

Primary cutoff: 0.1048 ppm

TP 25 | FP 40 | TN 65 | FN 13

Fixed structural labels and eligibility; all CSP cutoffs swept.
AUC measures binding-site localization of CSP magnitude.