2KGI | apo 16209 / holo 16210

HN CSP ROC | 48 eligible residues

Binding site: 23 | Distal: 25

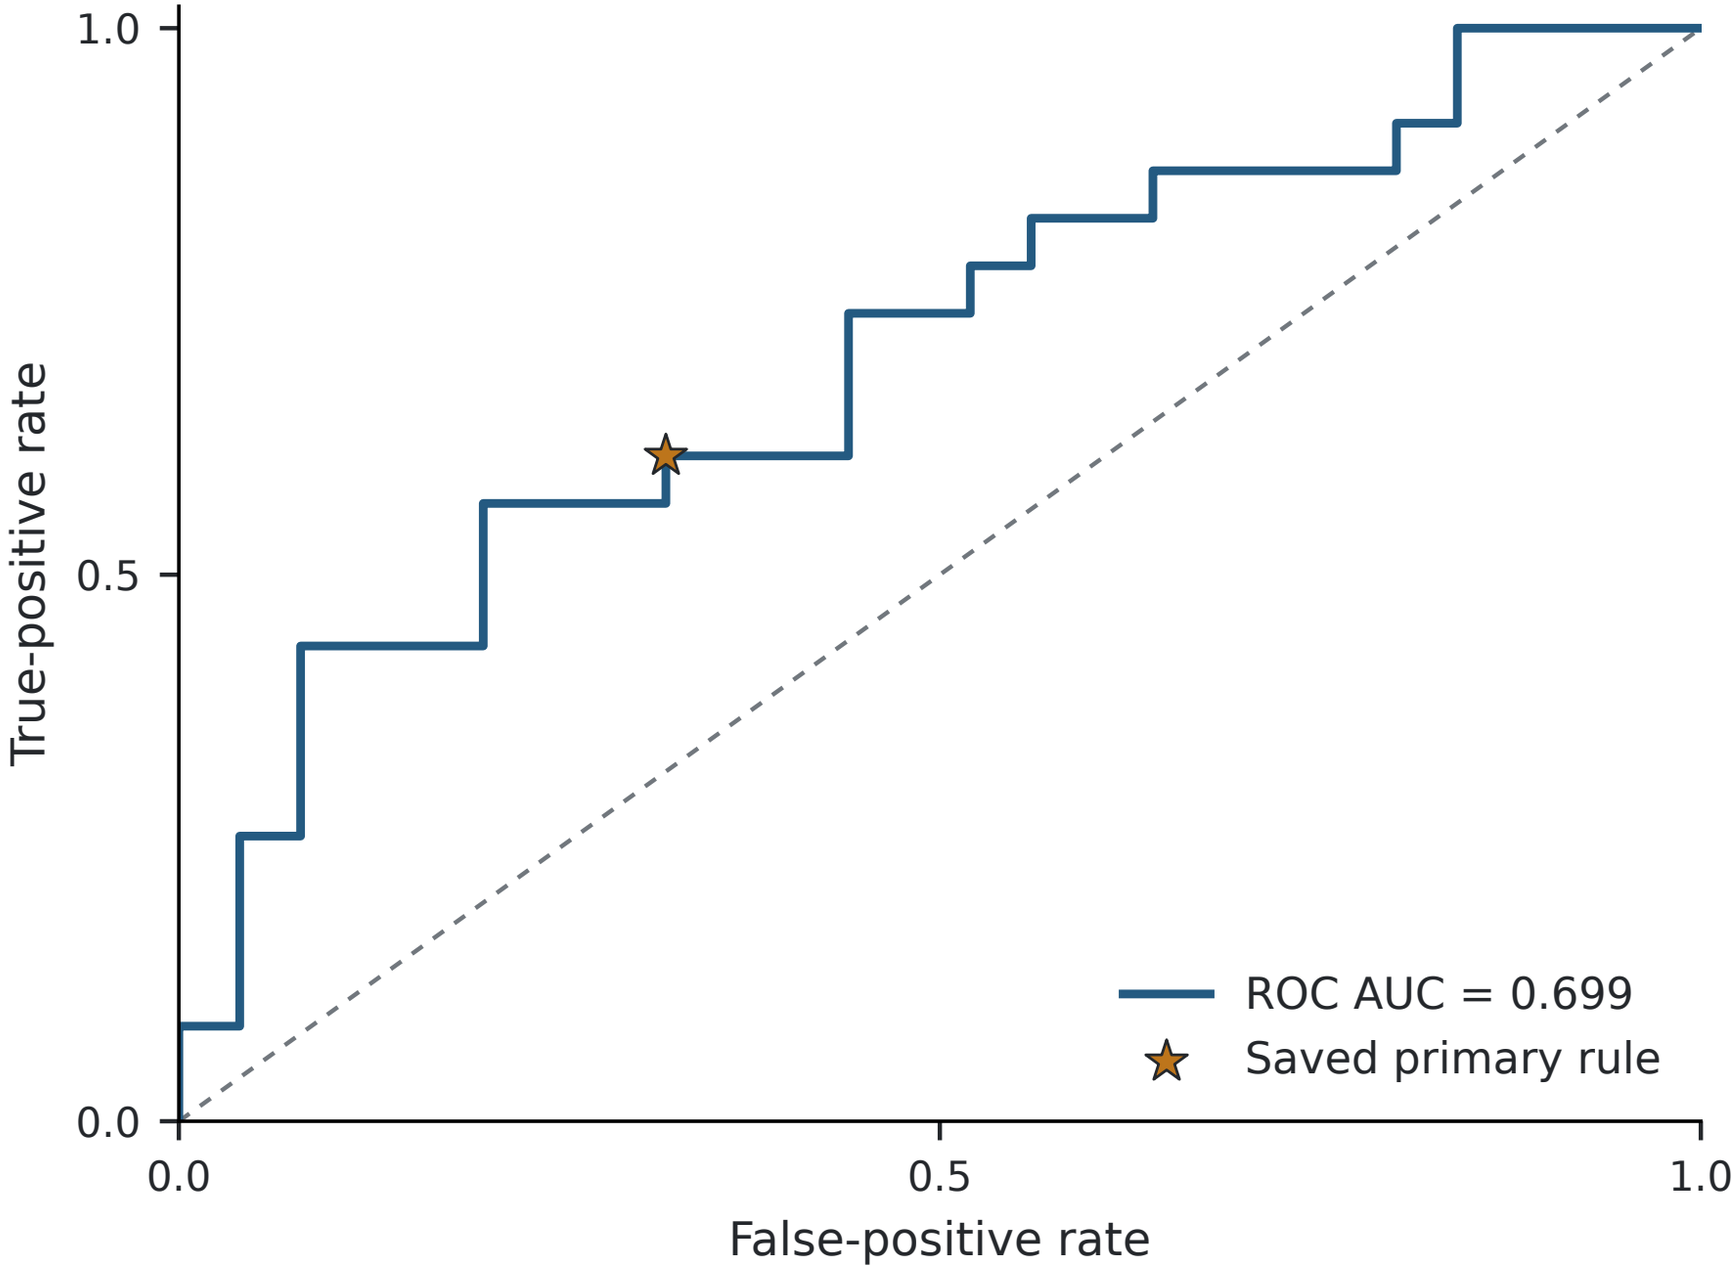

Primary cutoff: 0.1525 ppm

TP 14 | FP 8 | TN 17 | FN 9

Fixed structural labels and eligibility; all CSP cutoffs swept.
AUC measures binding-site localization of CSP magnitude.