2KPL | apo 6911 / holo 16559

HN CSP ROC | 88 eligible residues

Binding site: 15 | Distal: 73

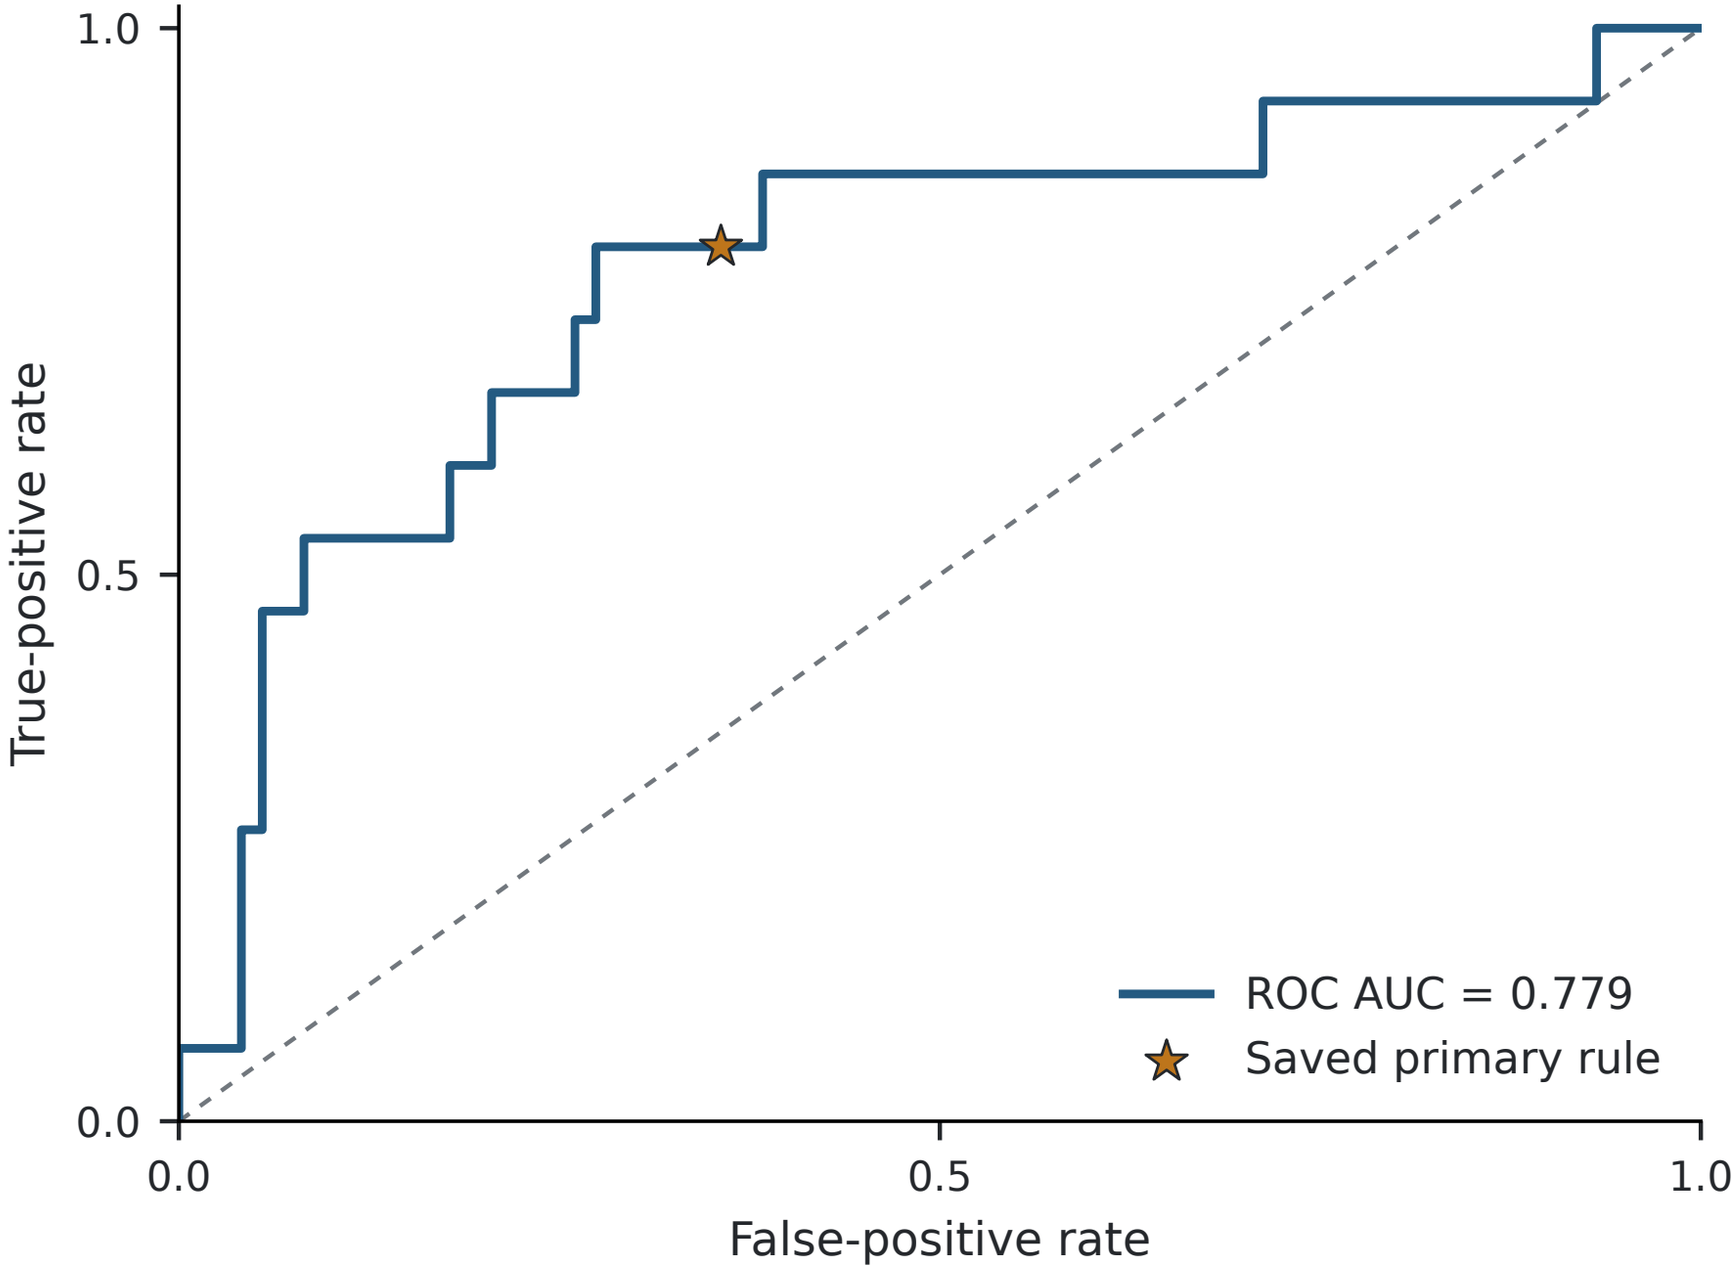

Primary cutoff: 0.0935 ppm

TP 12 | FP 26 | TN 47 | FN 3

Fixed structural labels and eligibility; all CSP cutoffs swept.
AUC measures binding-site localization of CSP magnitude.