# 2KVM | apo 15674 / holo 16778

HN CSP ROC | 46 eligible residues

Binding site: 15 | Distal: 31

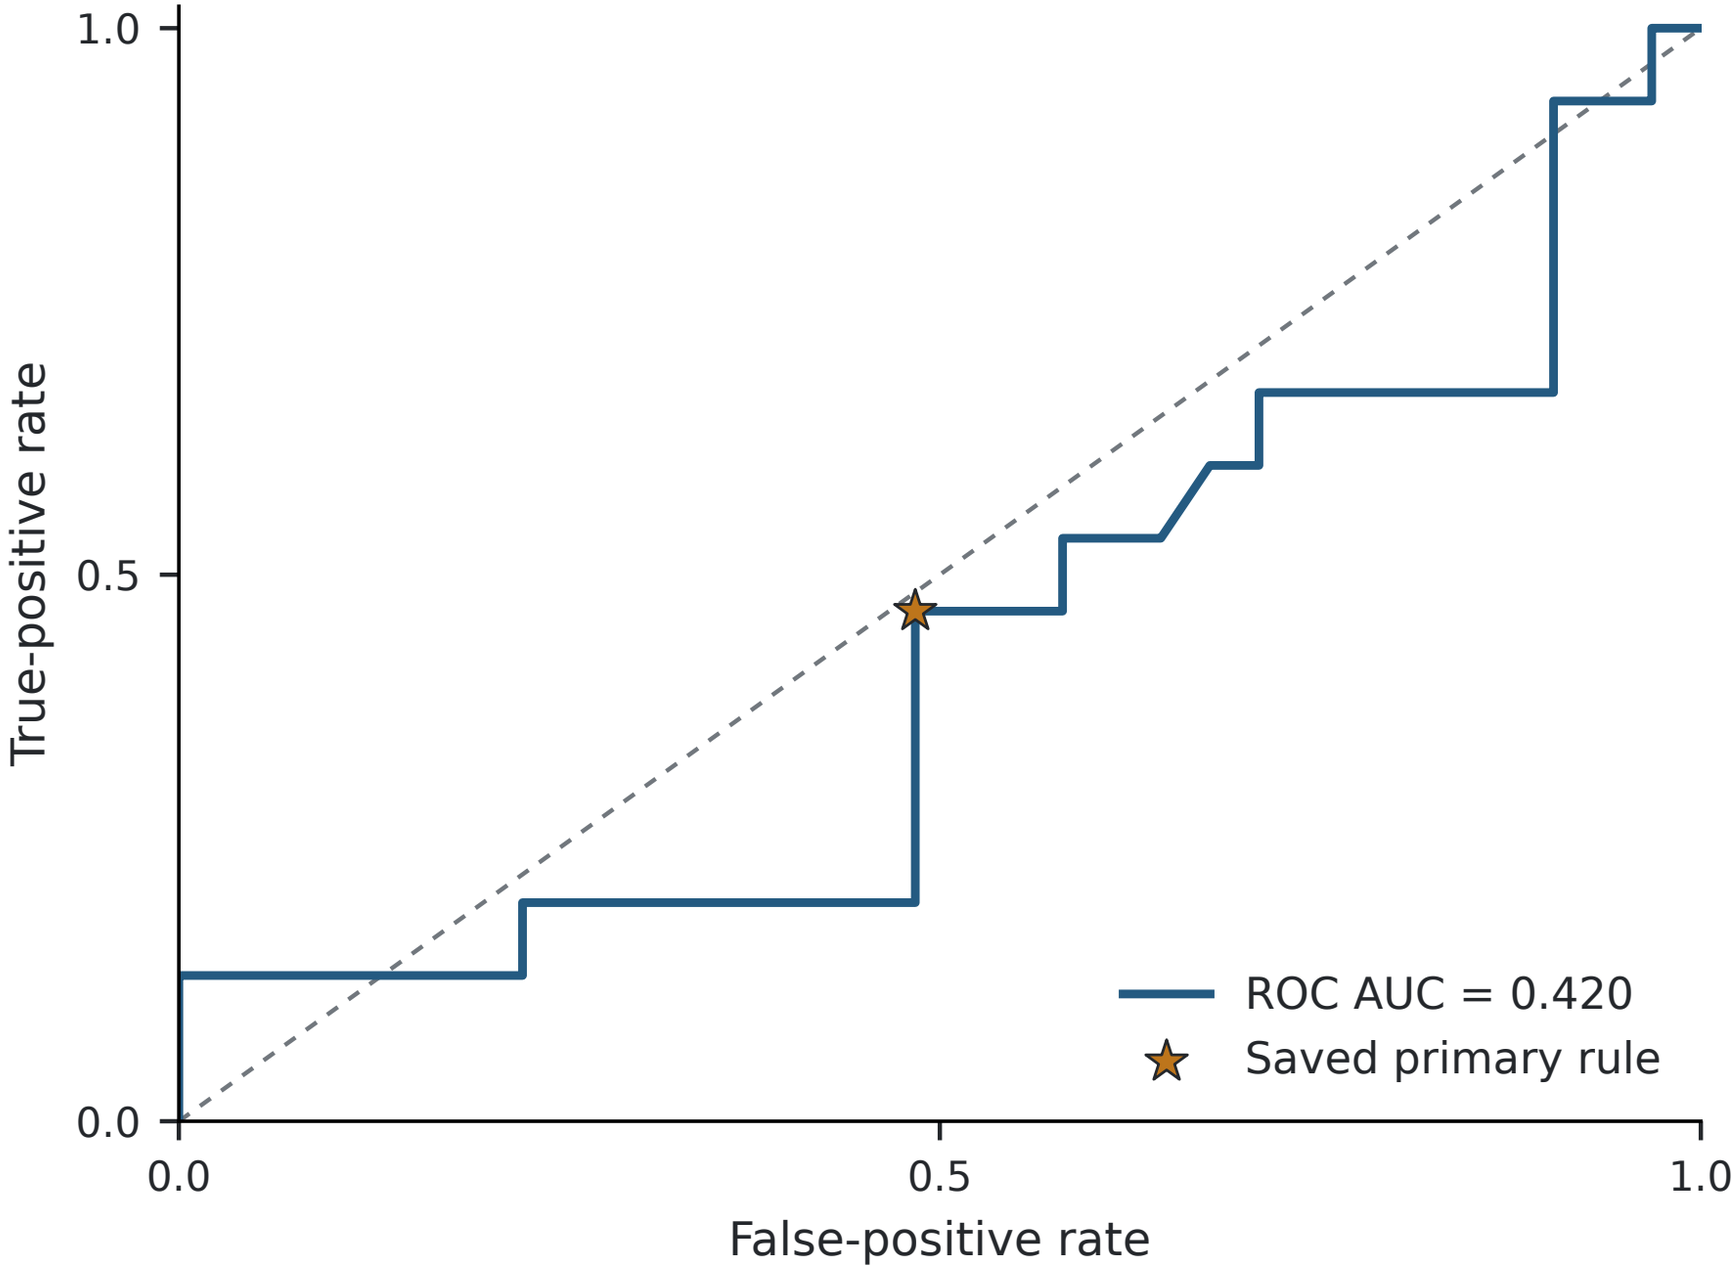


Primary cutoff: 0.0629 ppm

TP 7 | FP 15 | TN 16 | FN 8

Fixed structural labels and eligibility; all CSP cutoffs swept.
AUC measures binding-site localization of CSP magnitude.