2KWI | apo 15524 / holo 15525

HN CSP ROC | 51 eligible residues

Binding site: 14 | Distal: 37

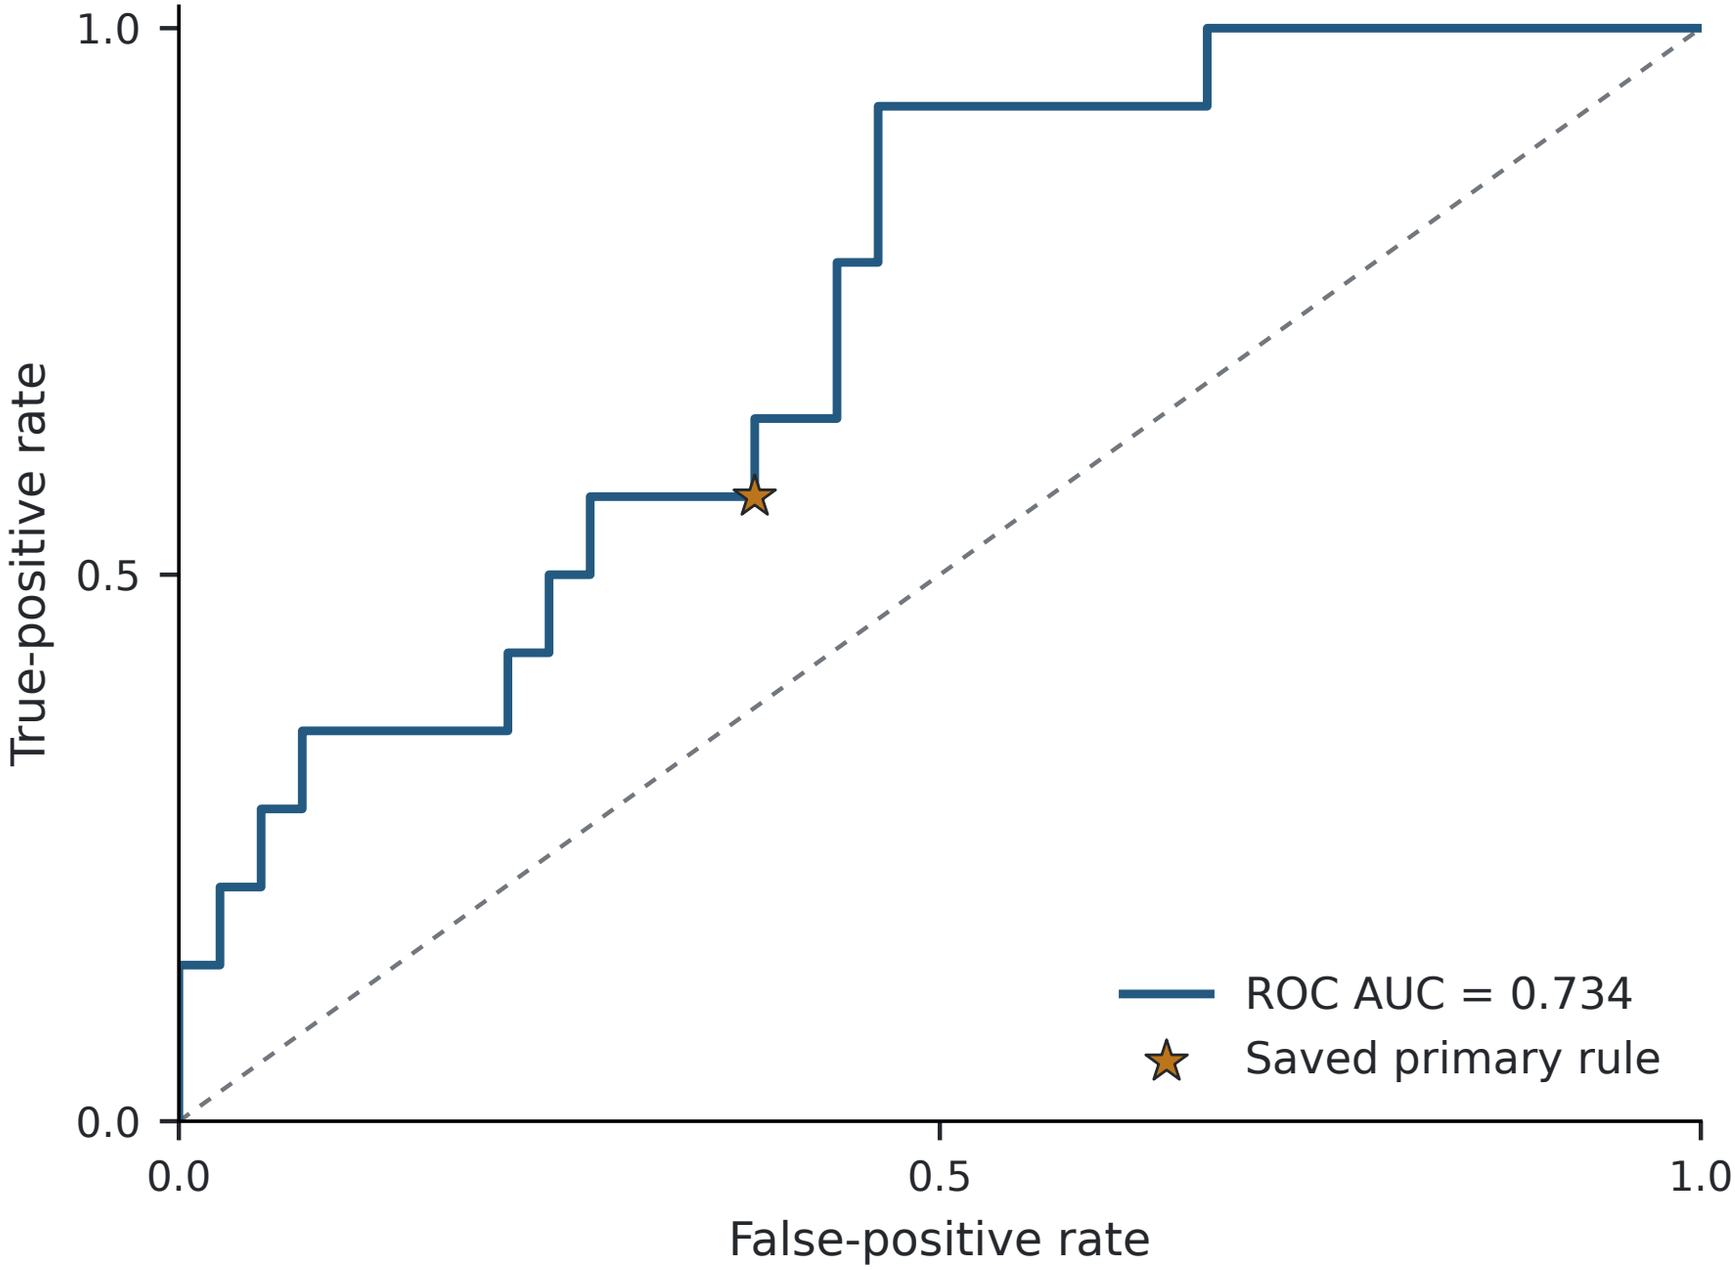

Primary cutoff: 0.1021 ppm

TP 8 | FP 14 | TN 23 | FN 6

Fixed structural labels and eligibility; all CSP cutoffs swept.
AUC measures binding-site localization of CSP magnitude.