2KYL | apo 15972 / holo 16967

HN CSP ROC | 88 eligible residues

Binding site: 18 | Distal: 70

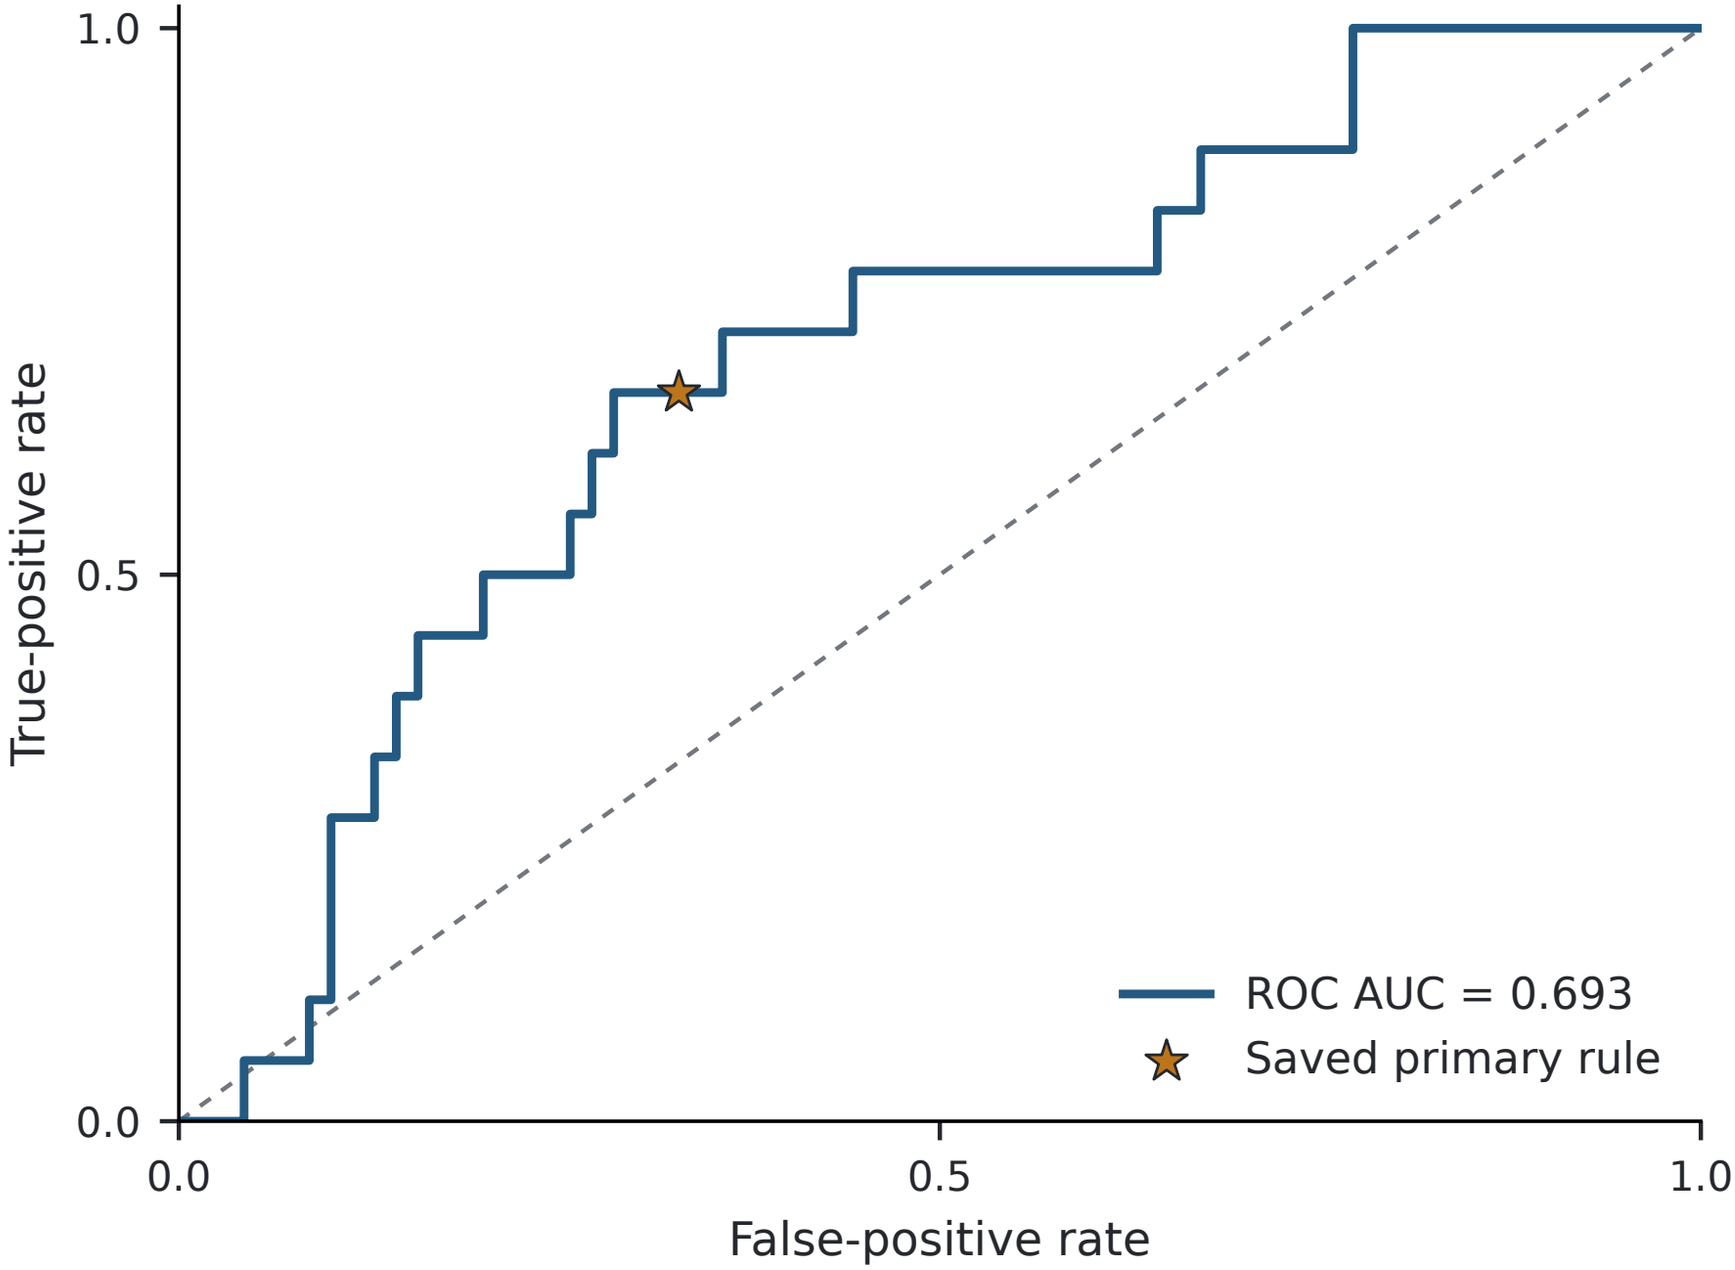

Primary cutoff: 0.0500 ppm

TP 12 | FP 23 | TN 47 | FN 6

Fixed structural labels and eligibility; all CSP cutoffs swept.
AUC measures binding-site localization of CSP magnitude.