2L0Y | apo 15763 / holo 17067

HN CSP ROC | 55 eligible residues

Binding site: 8 | Distal: 47

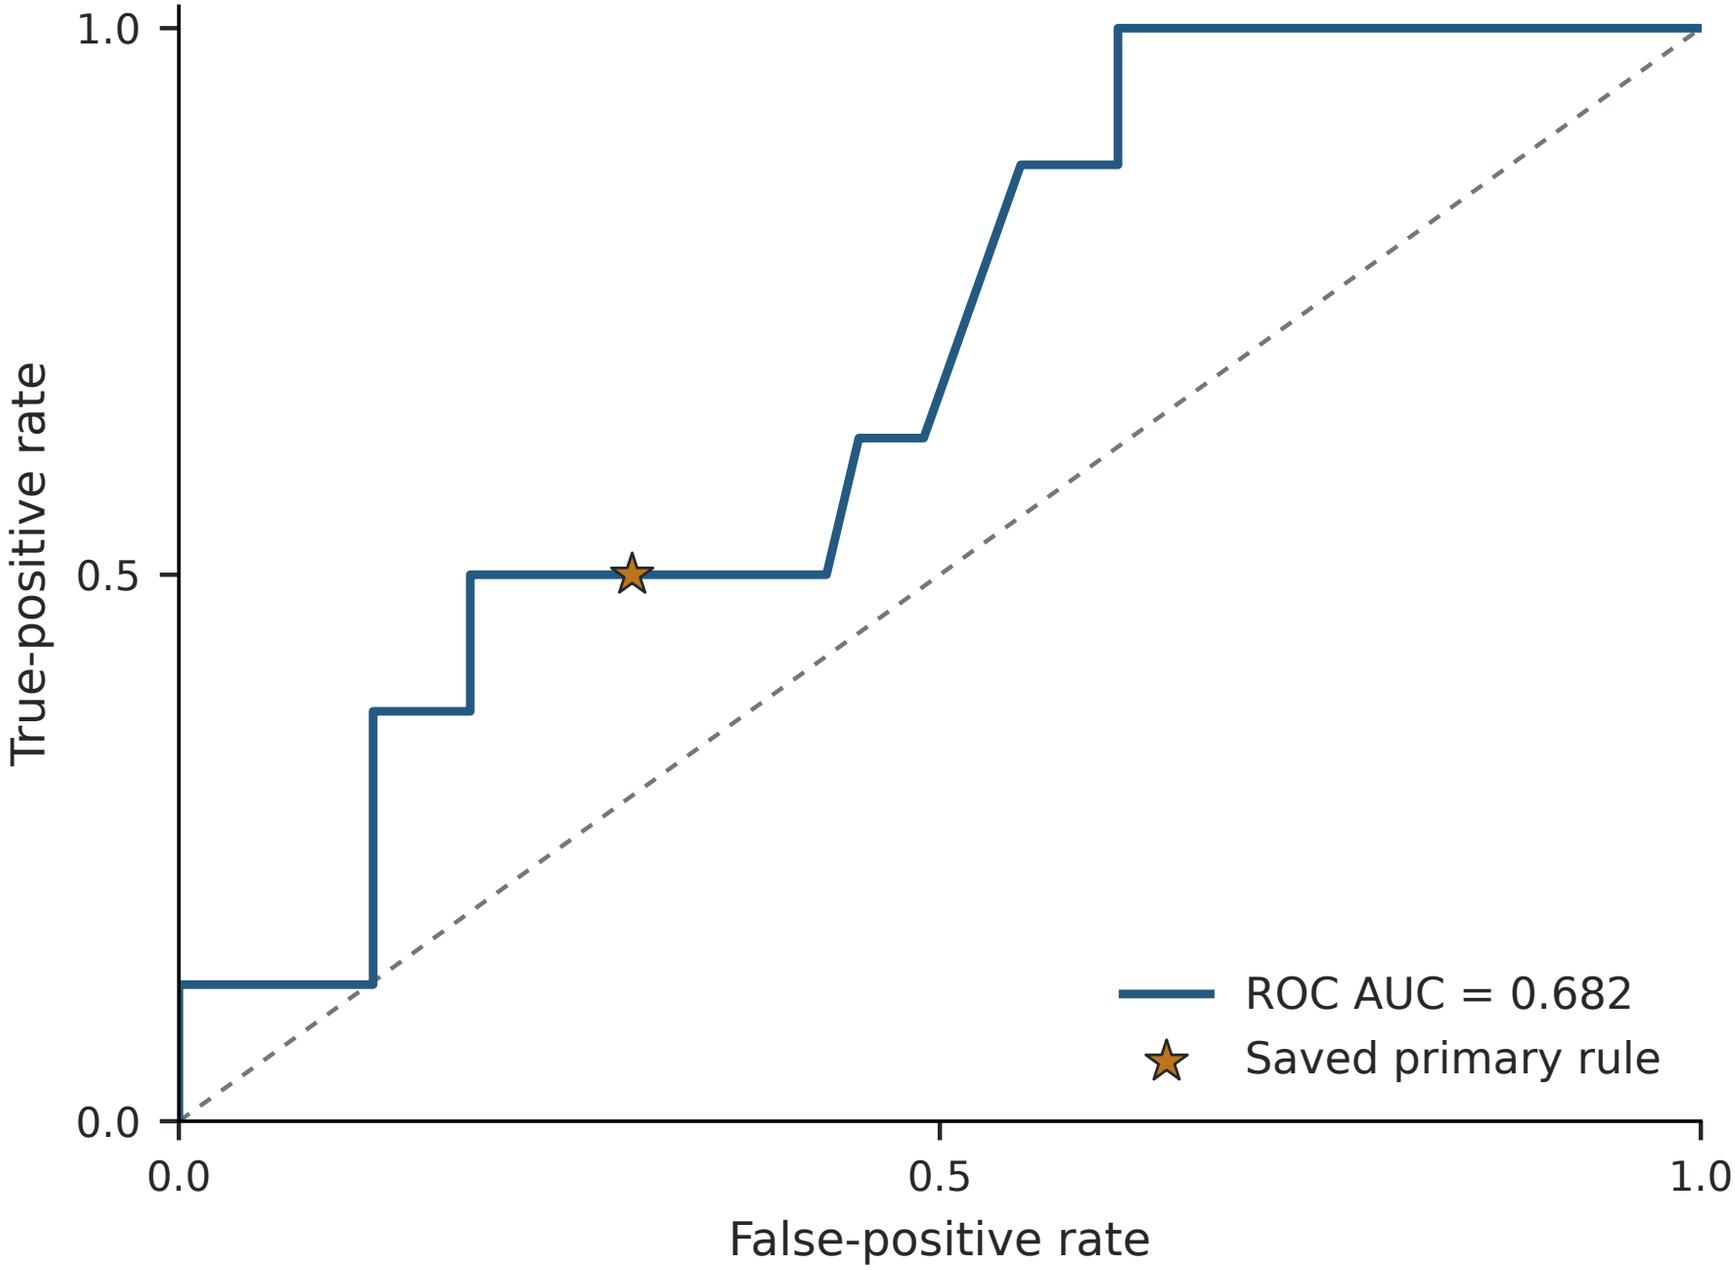

Primary cutoff: 0.0500 ppm

TP 4 | FP 14 | TN 33 | FN 4

Fixed structural labels and eligibility; all CSP cutoffs swept.
AUC measures binding-site localization of CSP magnitude.