2L6E | apo 16555 / holo 17307

HN CSP ROC | 76 eligible residues

Binding site: 16 | Distal: 60

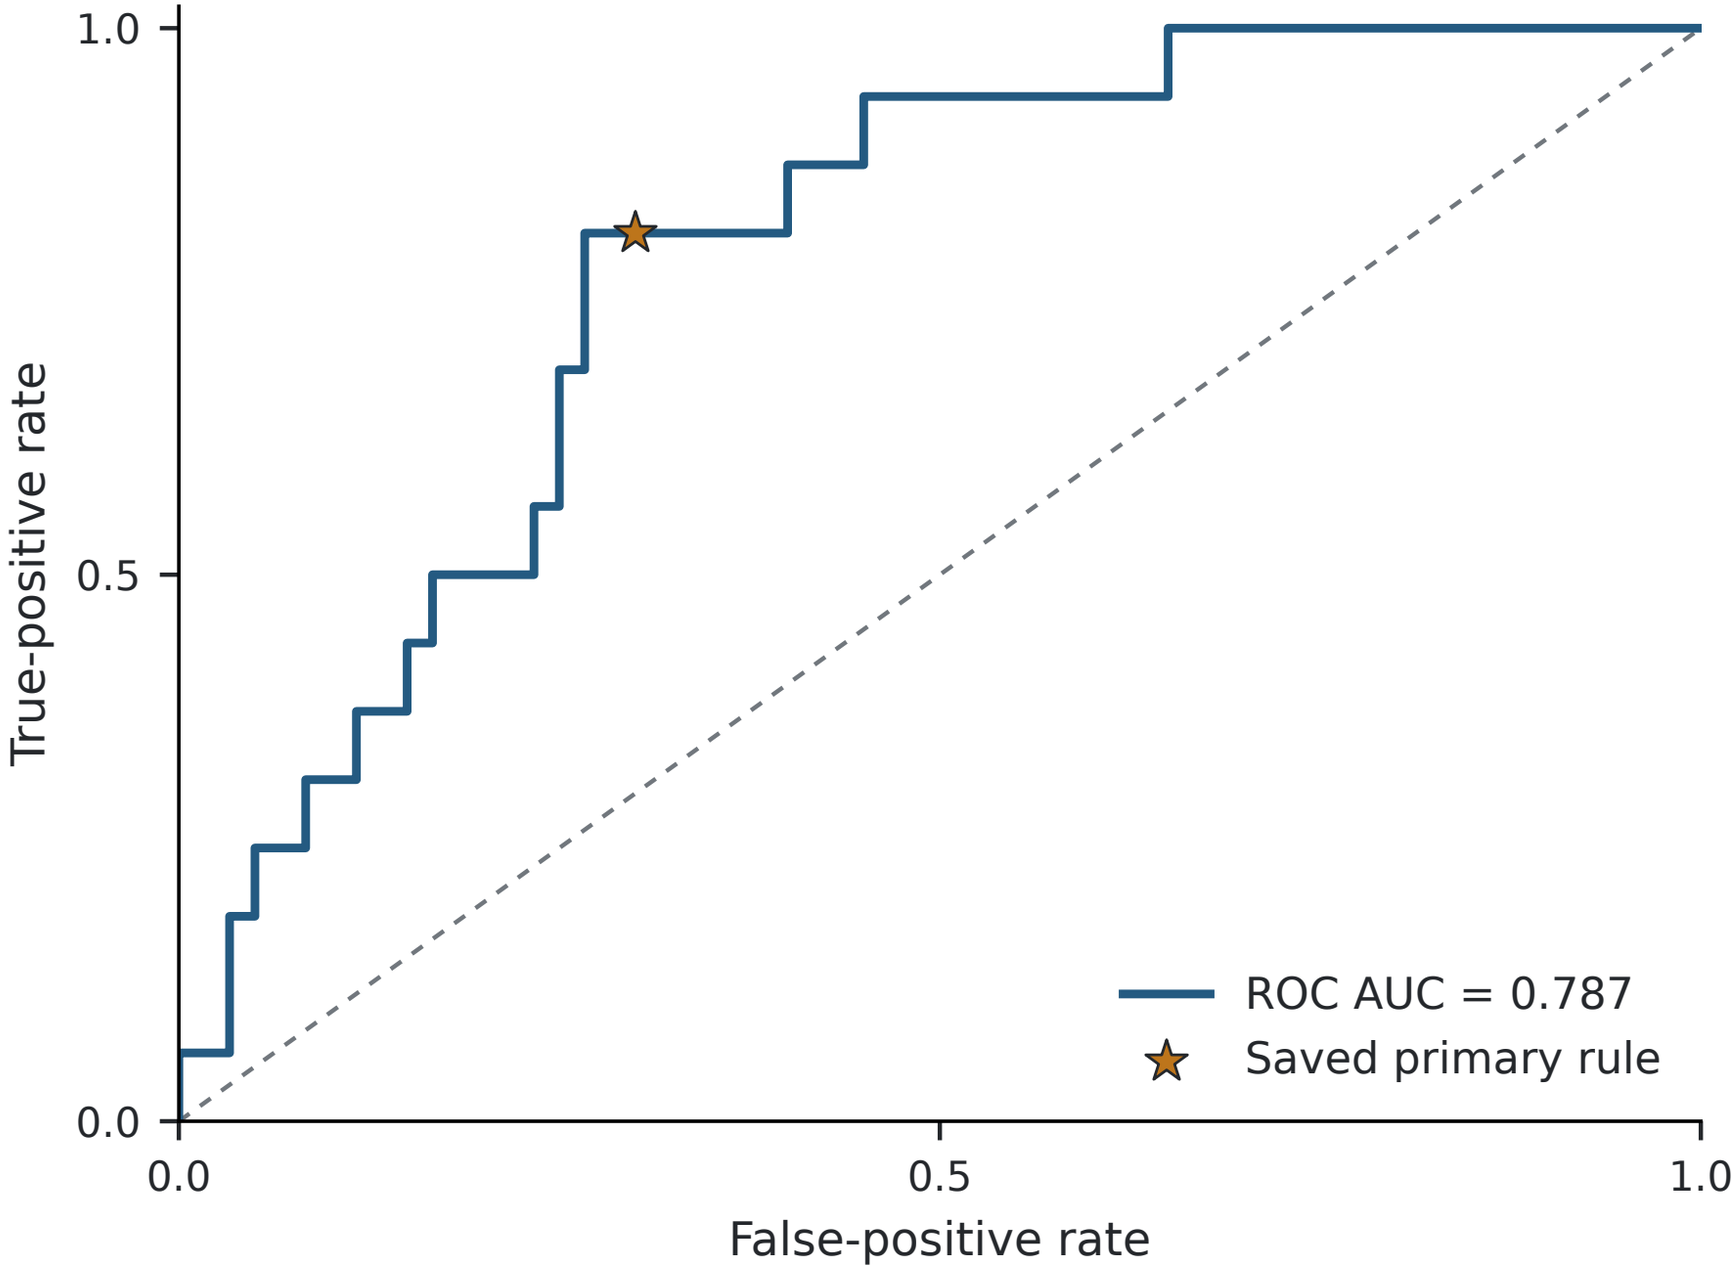

Primary cutoff: 0.1114 ppm

TP 13 | FP 18 | TN 42 | FN 3

Fixed structural labels and eligibility; all CSP cutoffs swept.
AUC measures binding-site localization of CSP magnitude.