2LI5 | apo 16835 / holo 17879

HN CSP ROC | 107 eligible residues

Binding site: 18 | Distal: 89

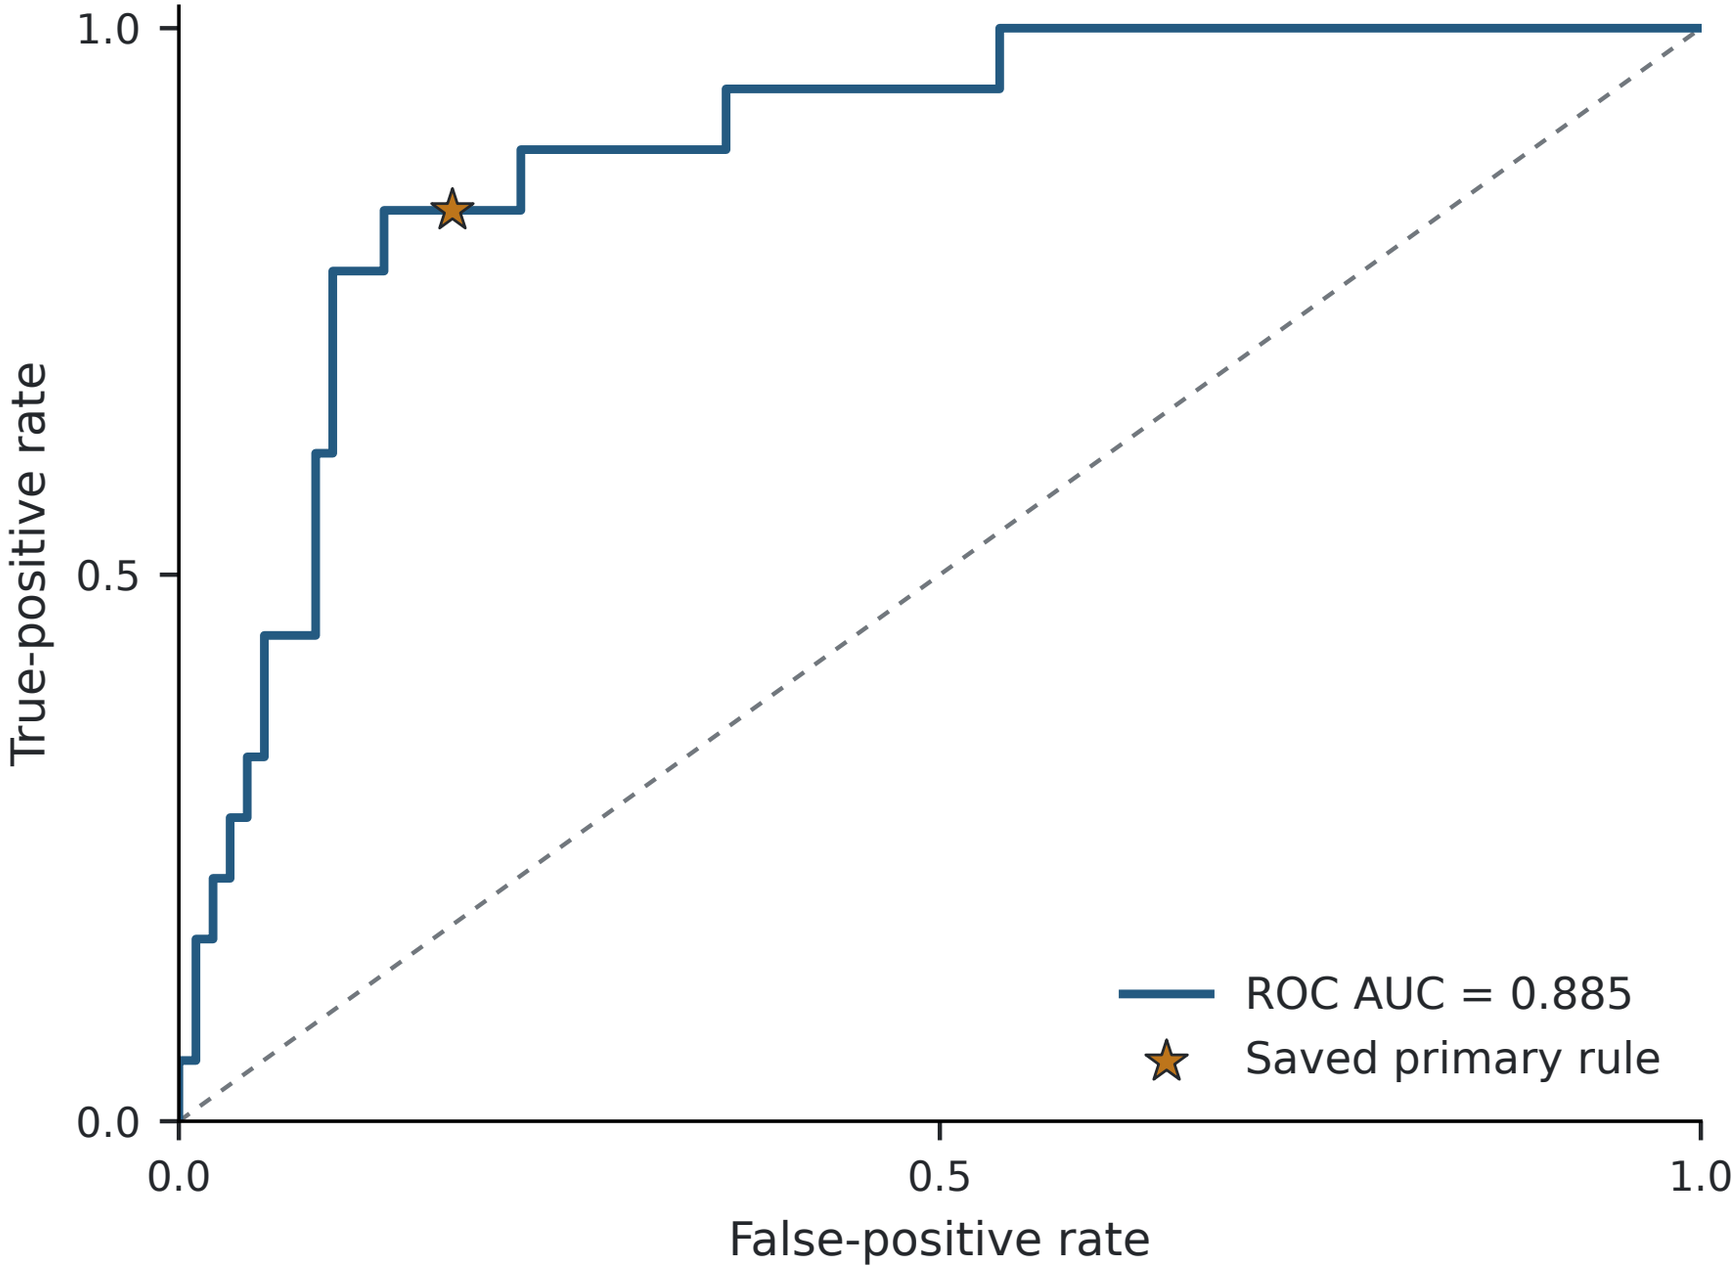

Primary cutoff: 0.0500 ppm

TP 15 | FP 16 | TN 73 | FN 3

Fixed structural labels and eligibility; all CSP cutoffs swept.
AUC measures binding-site localization of CSP magnitude.