2LOZ | apo 10318 / holo 17364

HN CSP ROC | 124 eligible residues

Binding site: 17 | Distal: 107

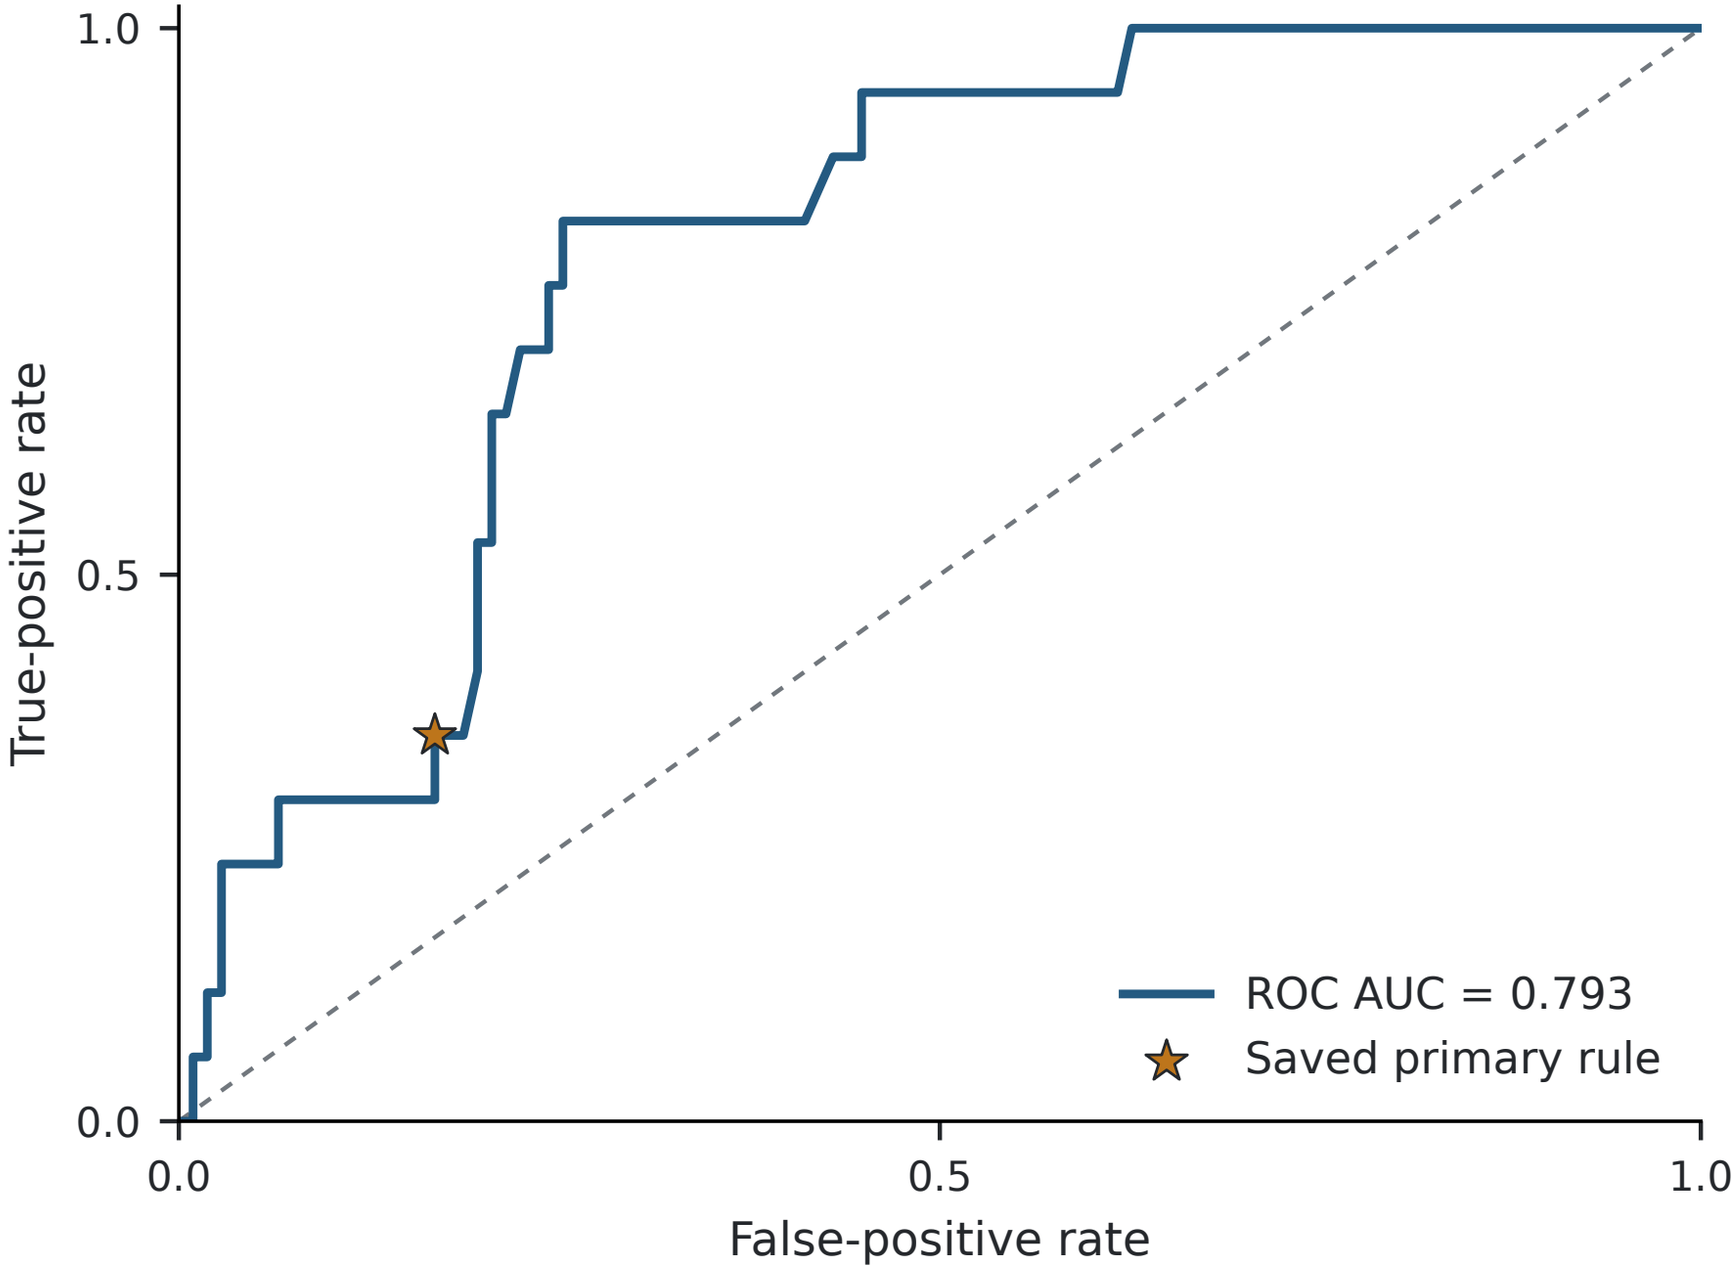

Primary cutoff: 0.0500 ppm

TP 6 | FP 18 | TN 89 | FN 11

Fixed structural labels and eligibility; all CSP cutoffs swept.
AUC measures binding-site localization of CSP magnitude.