# 2LP0 | apo 25142 / holo 17407

HN CSP ROC | 59 eligible residues

Binding site: 15 | Distal: 44

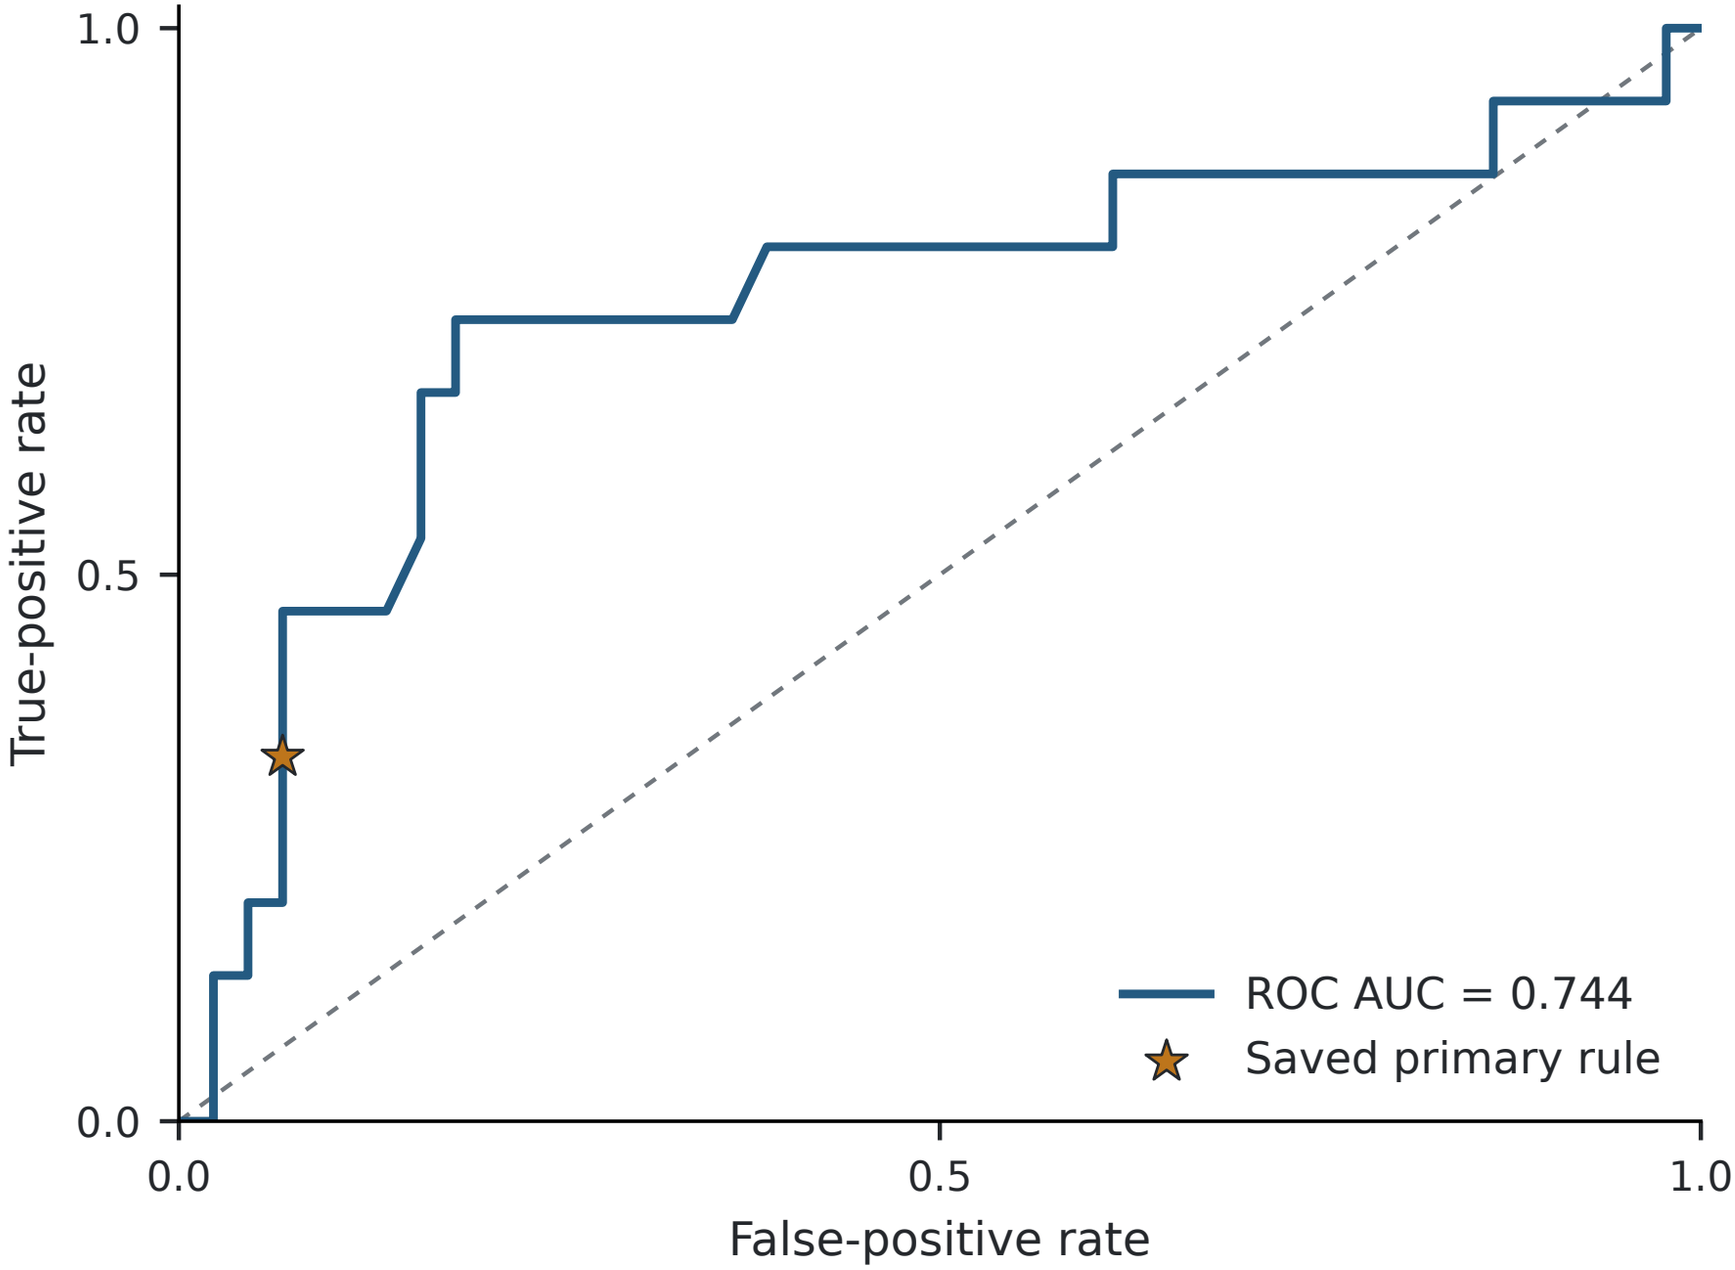


Primary cutoff: 0.0500 ppm

TP 5 | FP 3 | TN 41 | FN 10

Fixed structural labels and eligibility; all CSP cutoffs swept.
AUC measures binding-site localization of CSP magnitude.