2LSK | apo 18455 / holo 18434

HN CSP ROC | 81 eligible residues

Binding site: 10 | Distal: 71

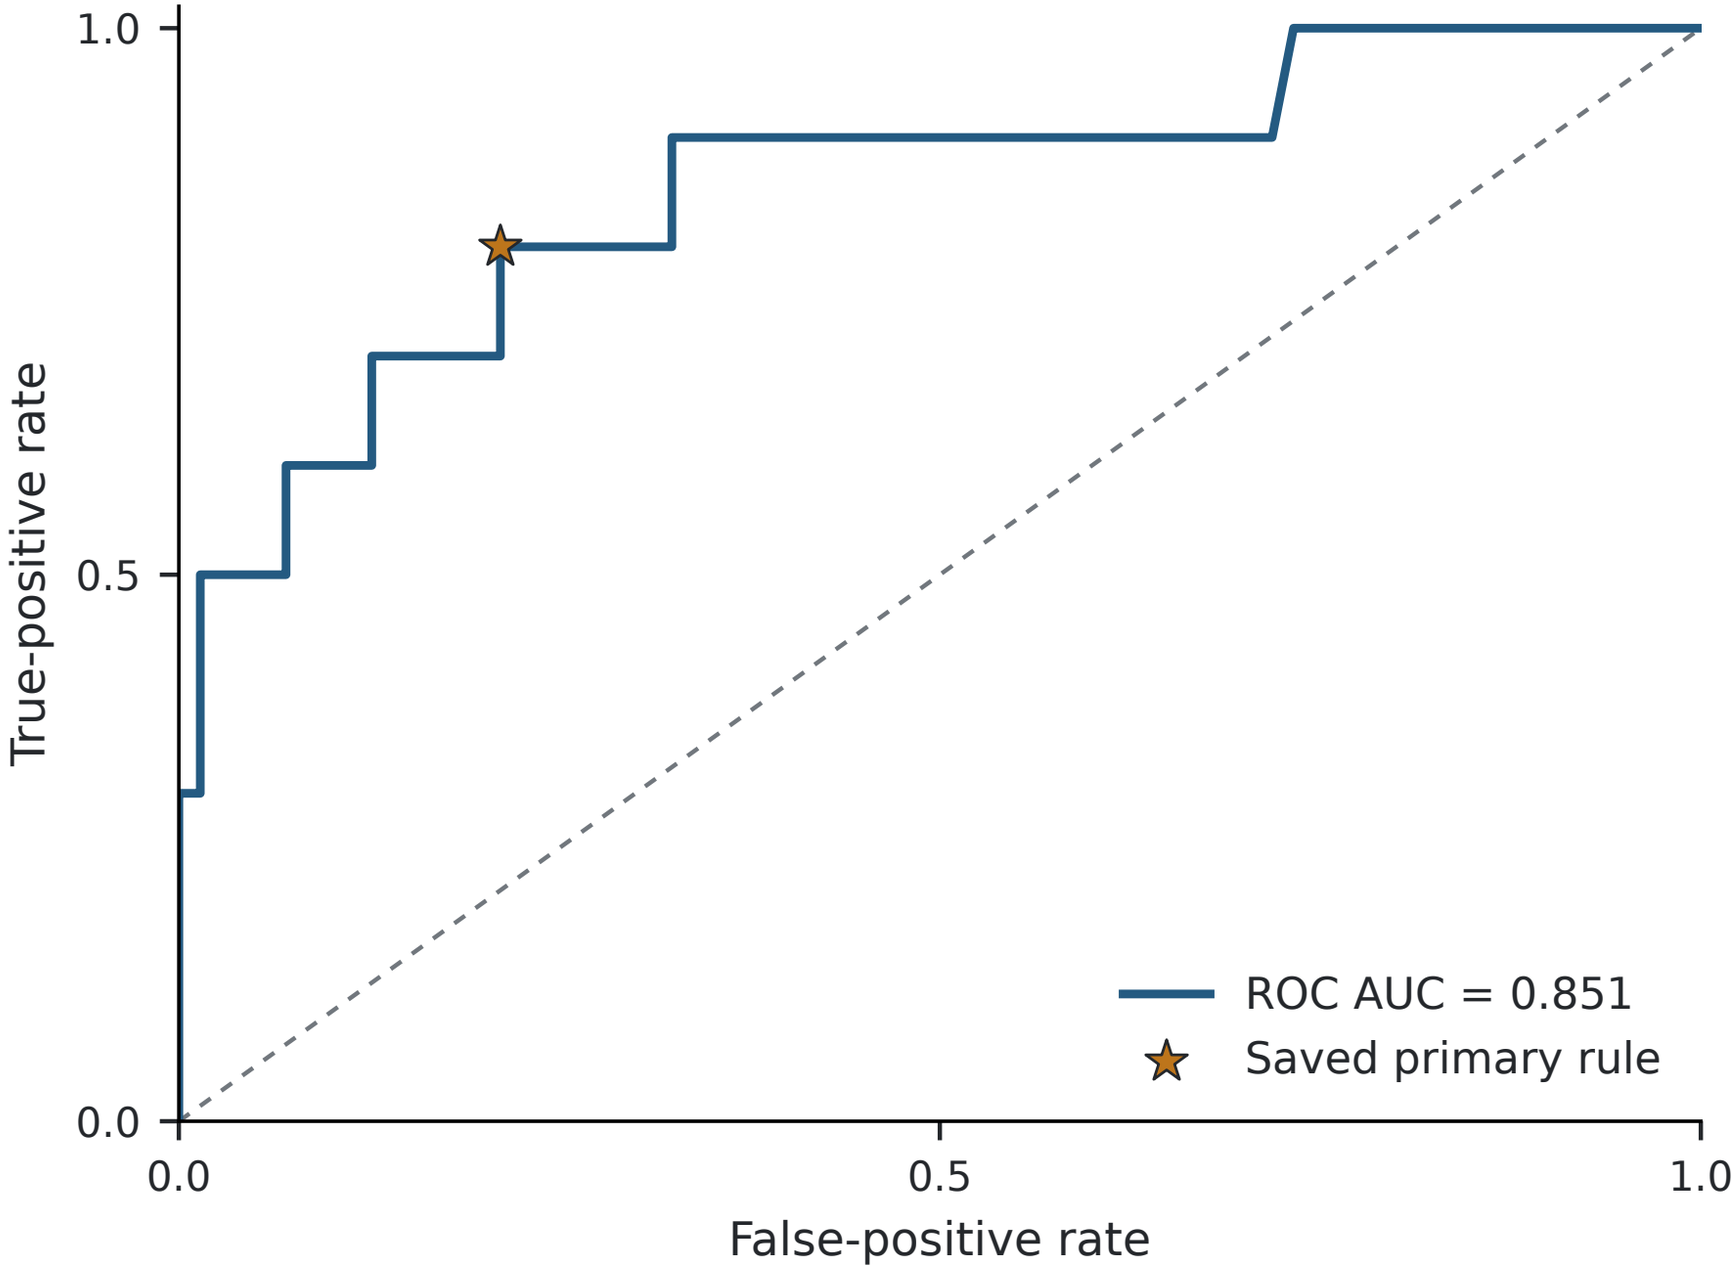

Primary cutoff: 0.0500 ppm

TP 8 | FP 15 | TN 56 | FN 2

Fixed structural labels and eligibility; all CSP cutoffs swept.
AUC measures binding-site localization of CSP magnitude.