2LSP | apo 15057 / holo 18439

HN CSP ROC | 88 eligible residues

Binding site: 11 | Distal: 77

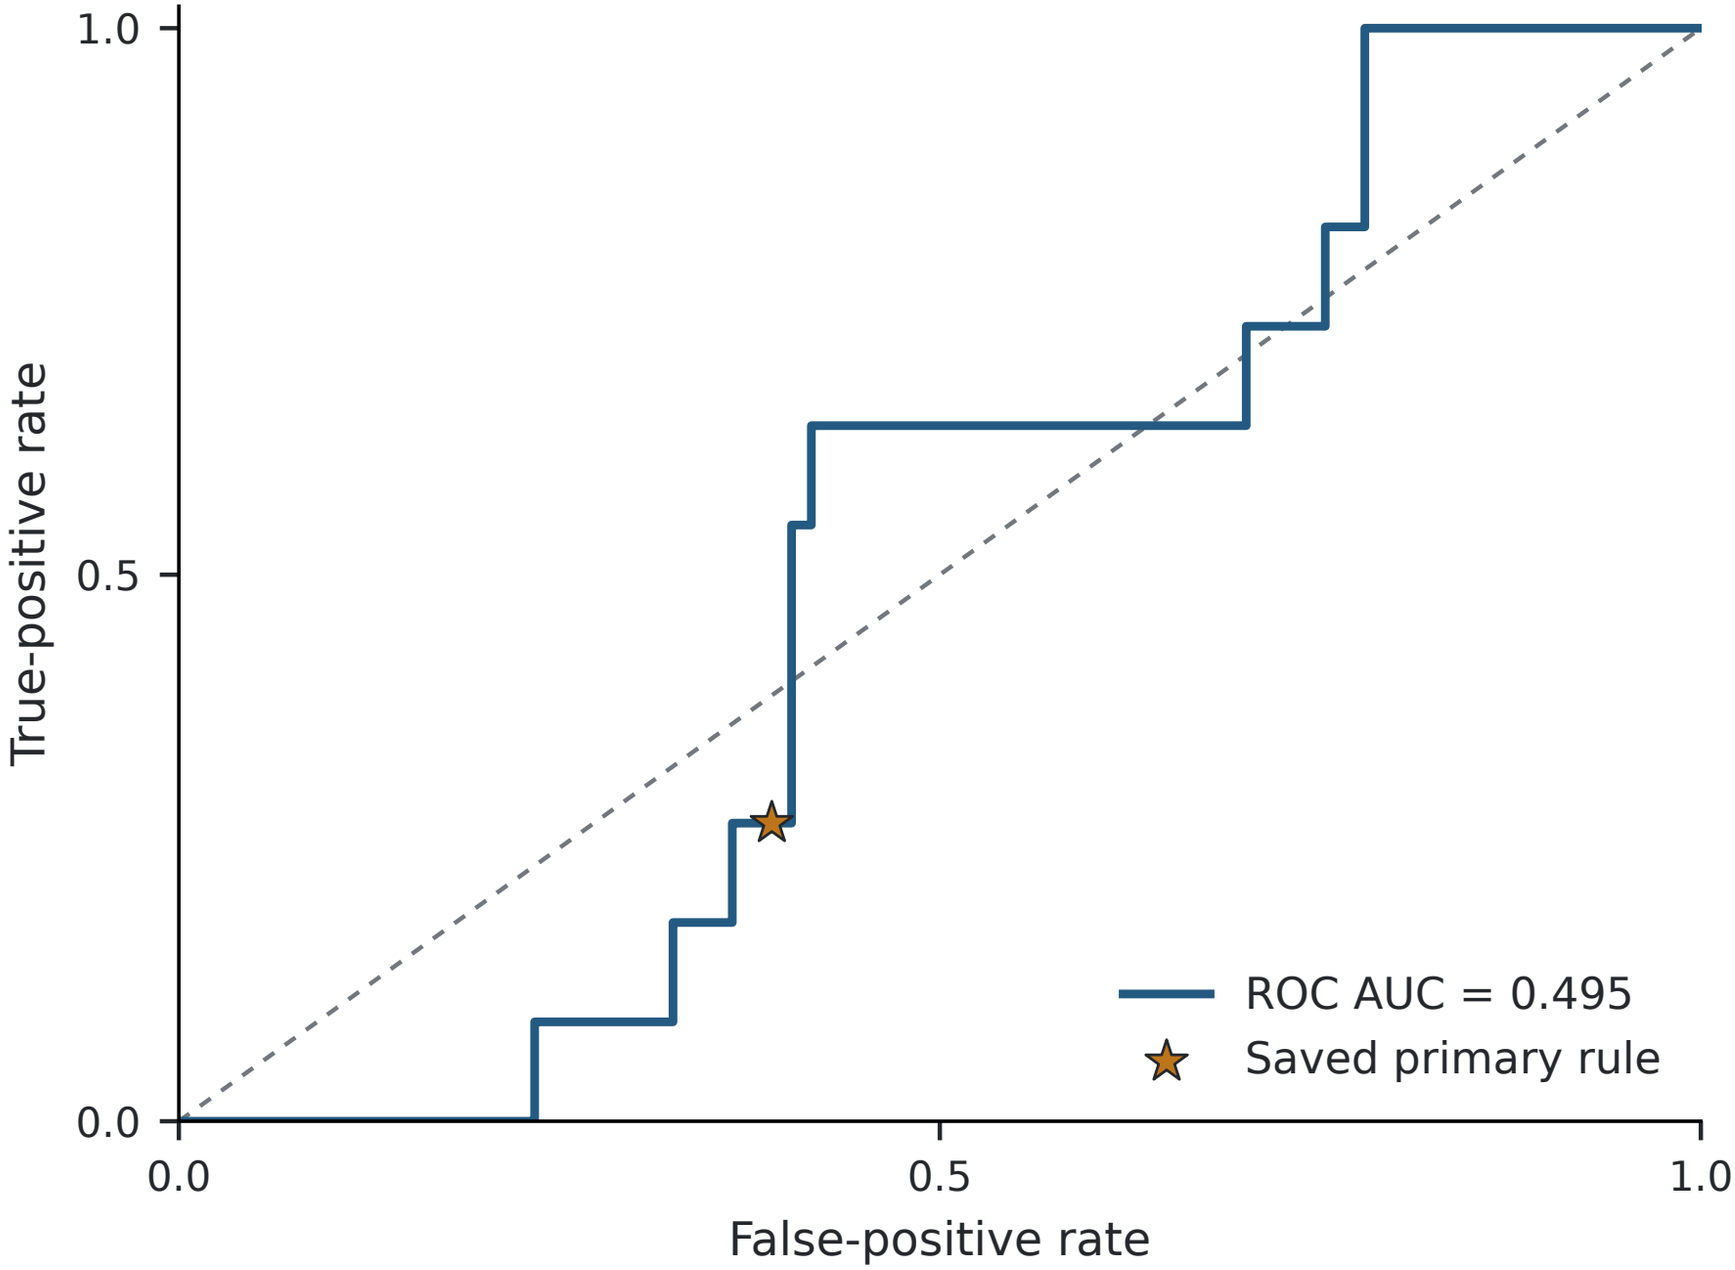

Primary cutoff: 0.0500 ppm

TP 3 | FP 30 | TN 47 | FN 8

Fixed structural labels and eligibility; all CSP cutoffs swept.
AUC measures binding-site localization of CSP magnitude.