2LVO | apo 18581 / holo 18582

HN CSP ROC | 45 eligible residues

Binding site: 11 | Distal: 34

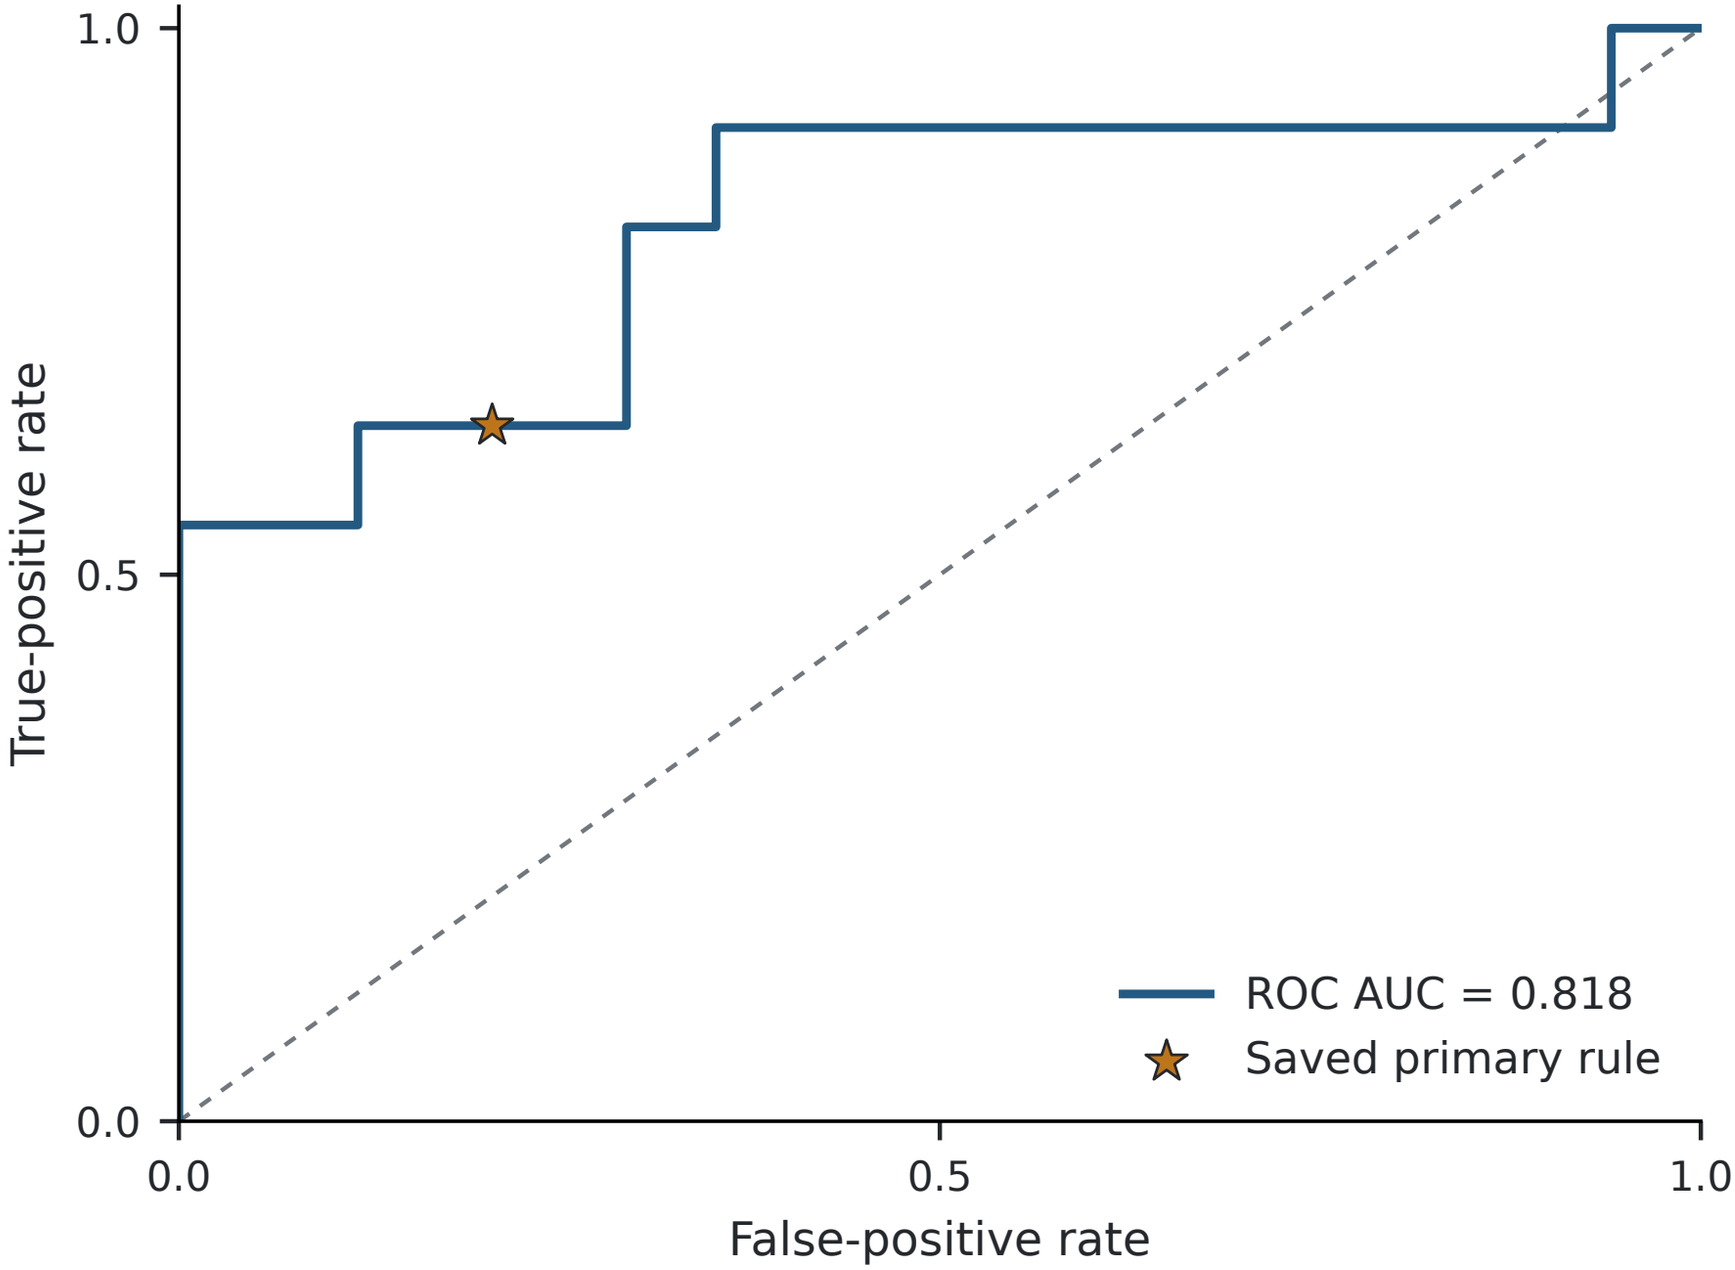

Primary cutoff: 0.0500 ppm

TP 7 | FP 7 | TN 27 | FN 4

Fixed structural labels and eligibility; all CSP cutoffs swept.
AUC measures binding-site localization of CSP magnitude.