2LXM | apo 18681 / holo 18682

HN CSP ROC | 146 eligible residues

Binding site: 16 | Distal: 130

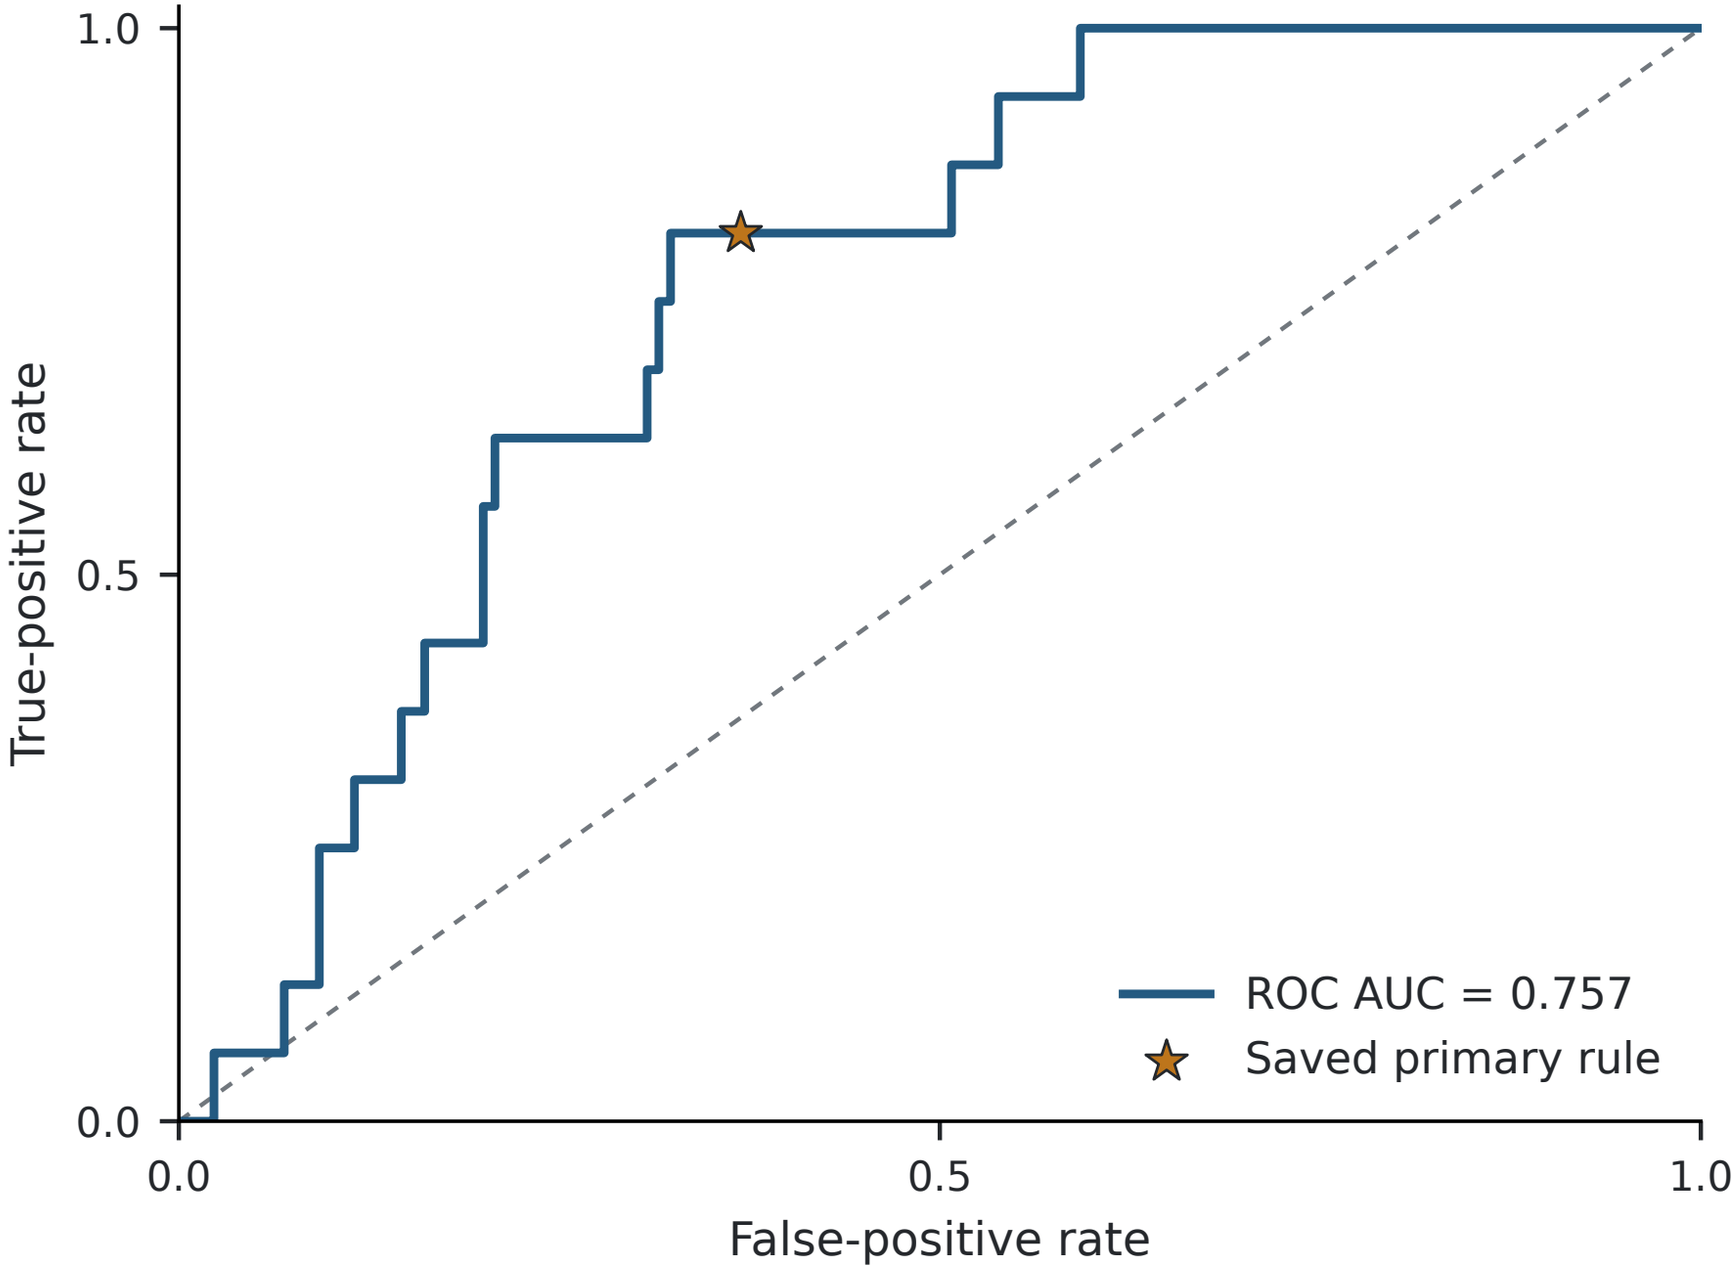

Primary cutoff: 0.0519 ppm

TP 13 | FP 48 | TN 82 | FN 3

Fixed structural labels and eligibility; all CSP cutoffs swept.
AUC measures binding-site localization of CSP magnitude.