# 2LXS | apo 6095 / holo 18694

HN CSP ROC | 83 eligible residues

Binding site: 12 | Distal: 71

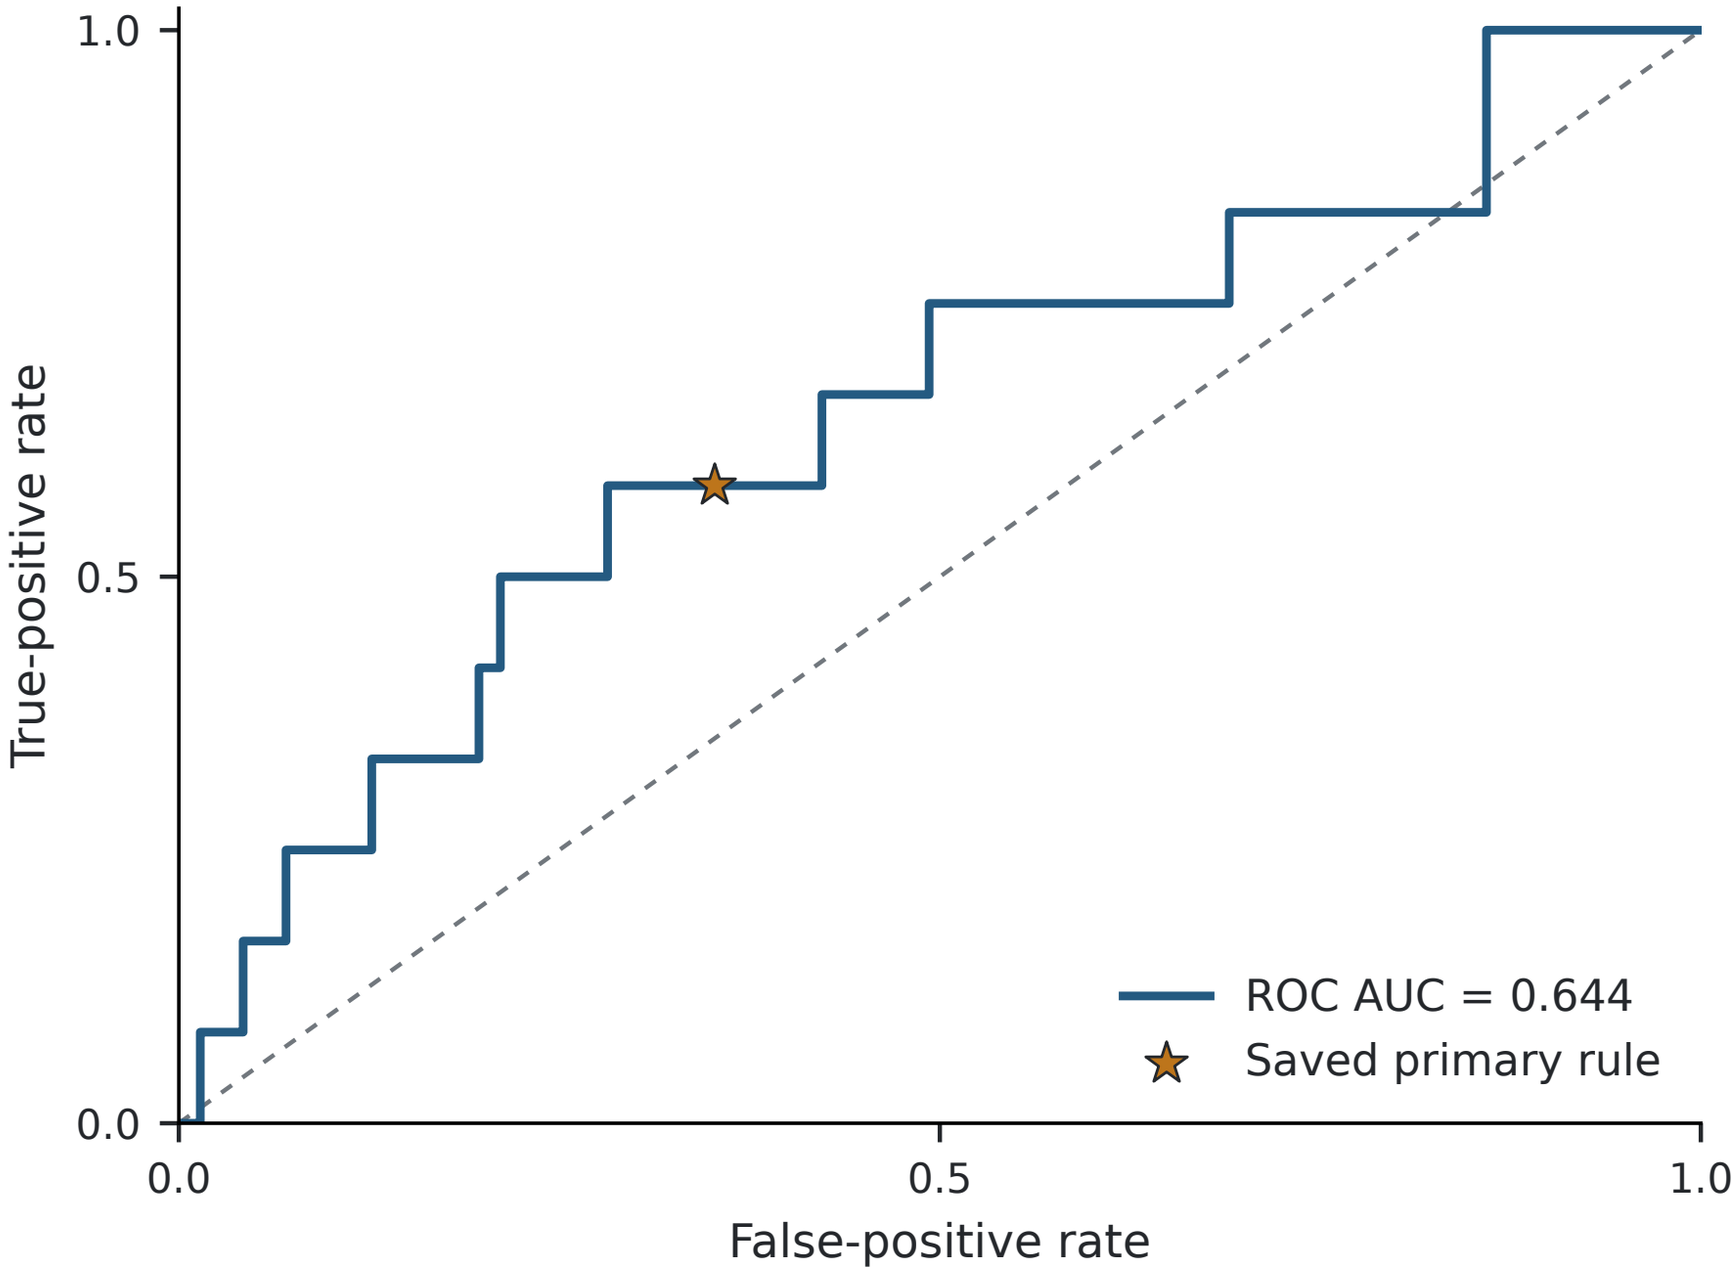


Primary cutoff: 0.1558 ppm

TP 7 | FP 25 | TN 46 | FN 5

Fixed structural labels and eligibility; all CSP cutoffs swept.
AUC measures binding-site localization of CSP magnitude.