2MES | apo 51289 / holo 19238

HN CSP ROC | 141 eligible residues

Binding site: 48 | Distal: 93

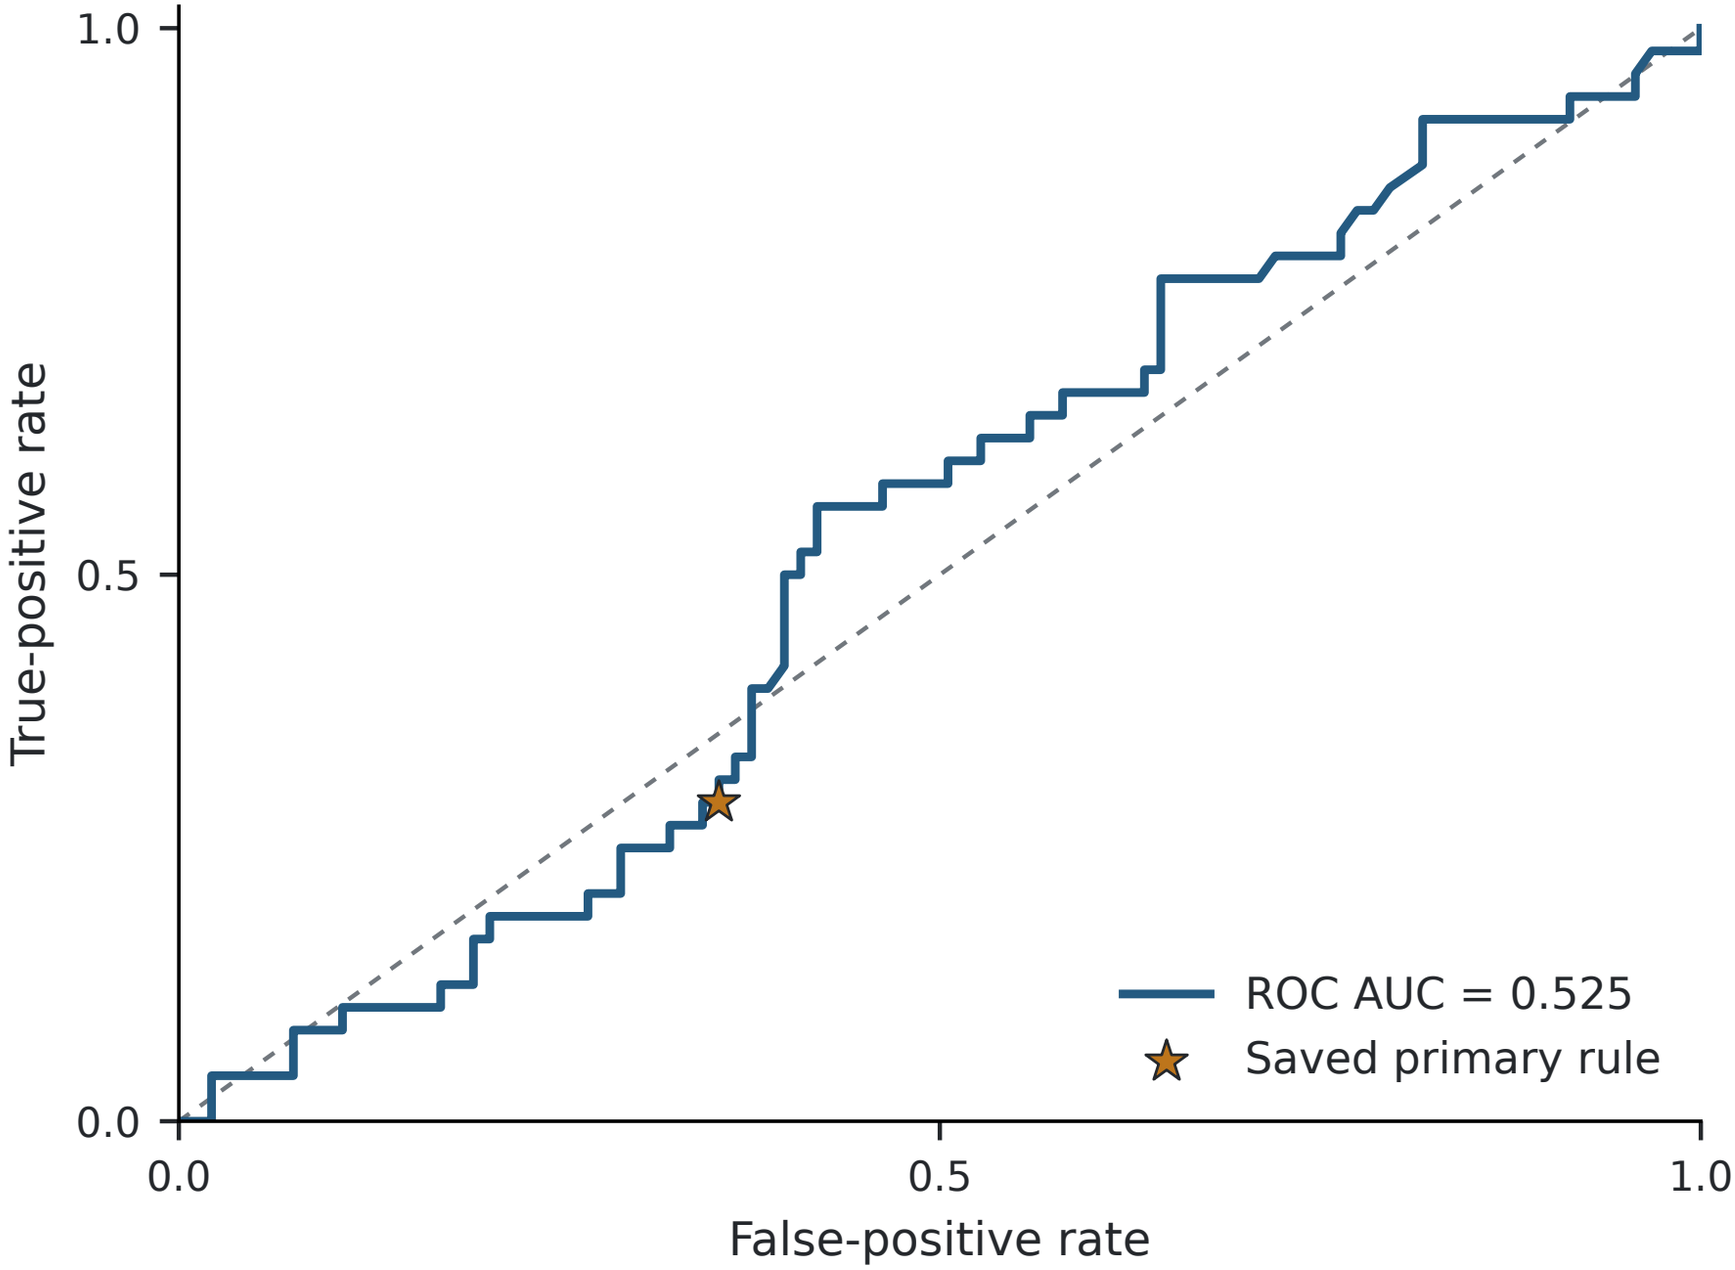

Primary cutoff: 0.0500 ppm

TP 14 | FP 33 | TN 60 | FN 34

Fixed structural labels and eligibility; all CSP cutoffs swept.
AUC measures binding-site localization of CSP magnitude.