2MNZ | apo 19913 / holo 19914

HN CSP ROC | 48 eligible residues

Binding site: 25 | Distal: 23

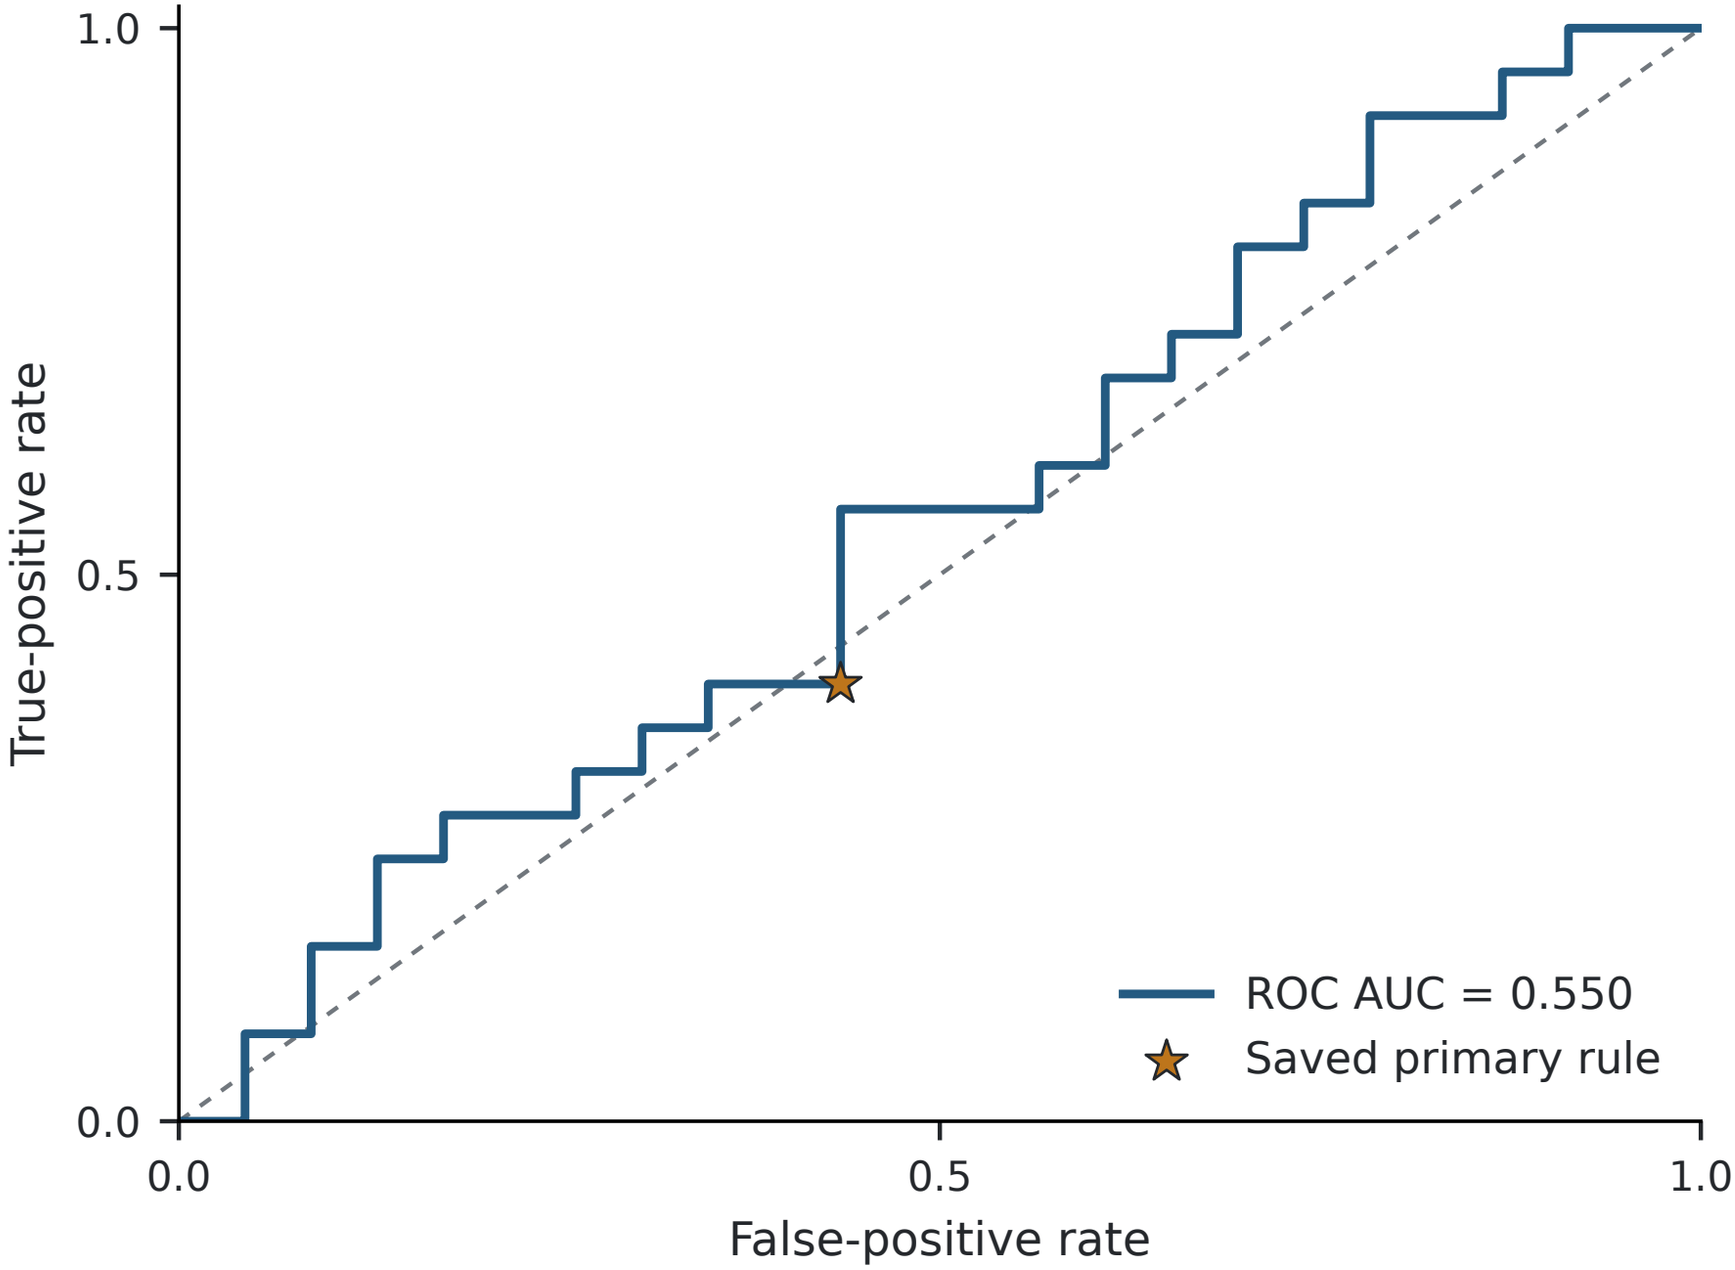

Primary cutoff: 0.1712 ppm

TP 10 | FP 10 | TN 13 | FN 15

Fixed structural labels and eligibility; all CSP cutoffs swept.
AUC measures binding-site localization of CSP magnitude.