2MUR | apo 25229 / holo 25230

HN CSP ROC | 39 eligible residues

Binding site: 20 | Distal: 19

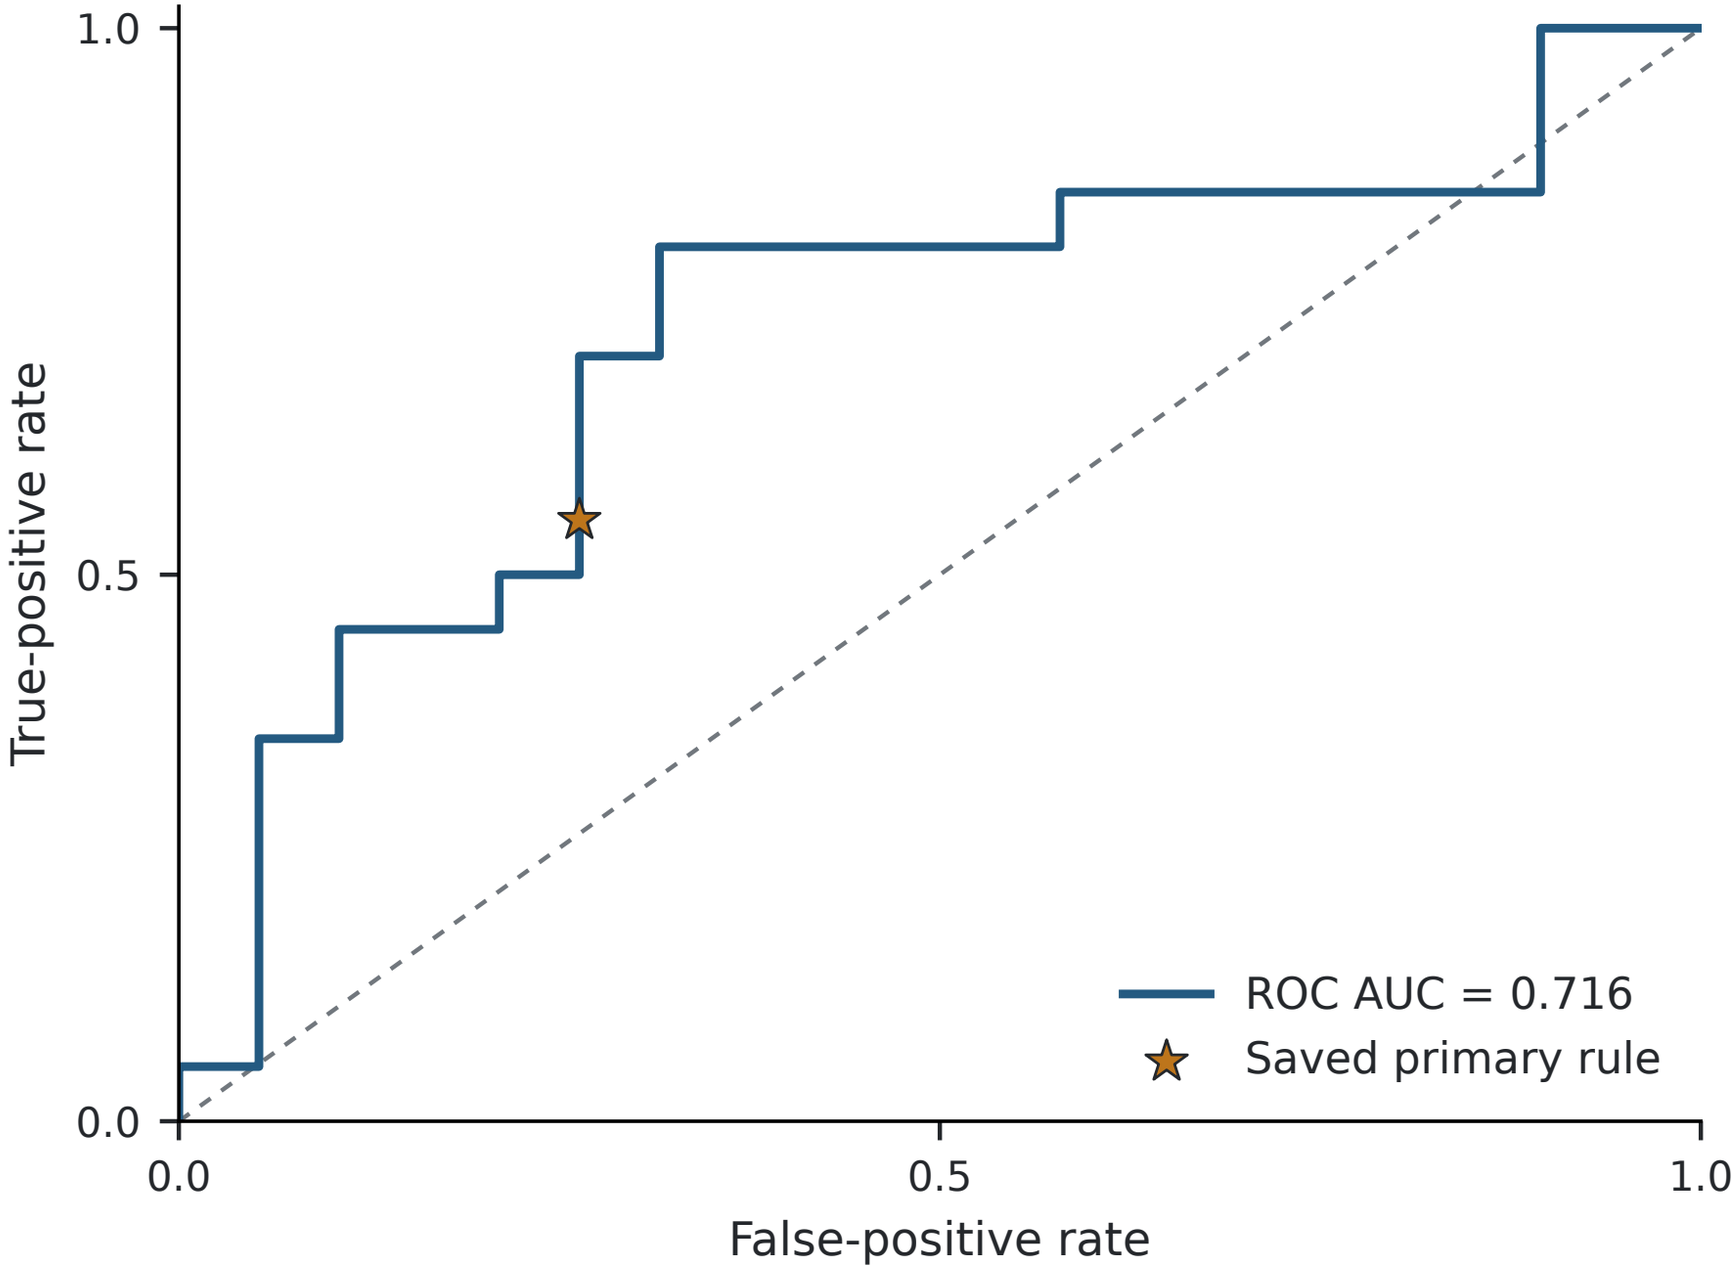

Primary cutoff: 0.1995 ppm

TP 11 | FP 5 | TN 14 | FN 9

Fixed structural labels and eligibility; all CSP cutoffs swept.
AUC measures binding-site localization of CSP magnitude.