2ND1 | apo 15125 / holo 26043

HN CSP ROC | 73 eligible residues

Binding site: 14 | Distal: 59

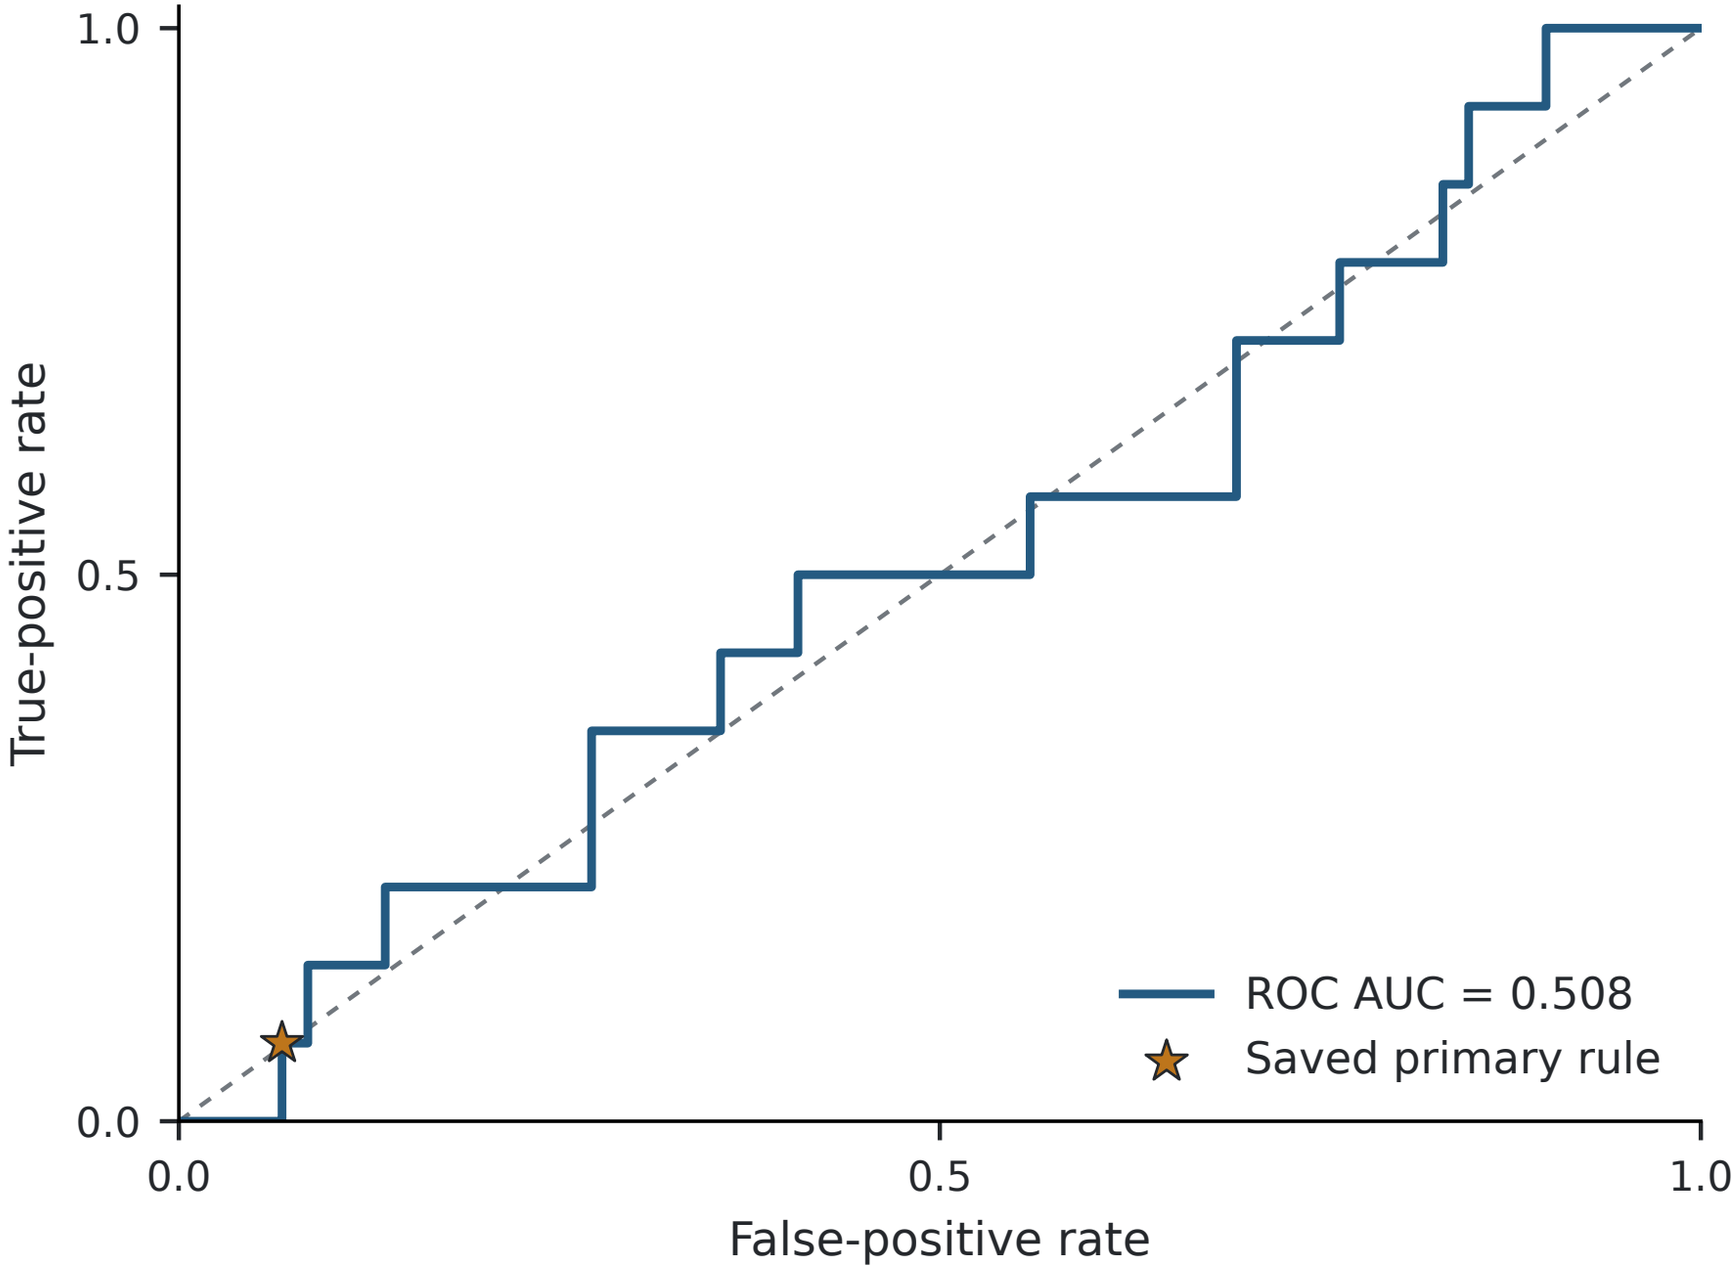

Primary cutoff: 0.0500 ppm

TP 1 | FP 4 | TN 55 | FN 13

Fixed structural labels and eligibility; all CSP cutoffs swept.
AUC measures binding-site localization of CSP magnitude.