2OJ2 | apo 4122 / holo 6581

HN CSP ROC | 61 eligible residues

Binding site: 10 | Distal: 51

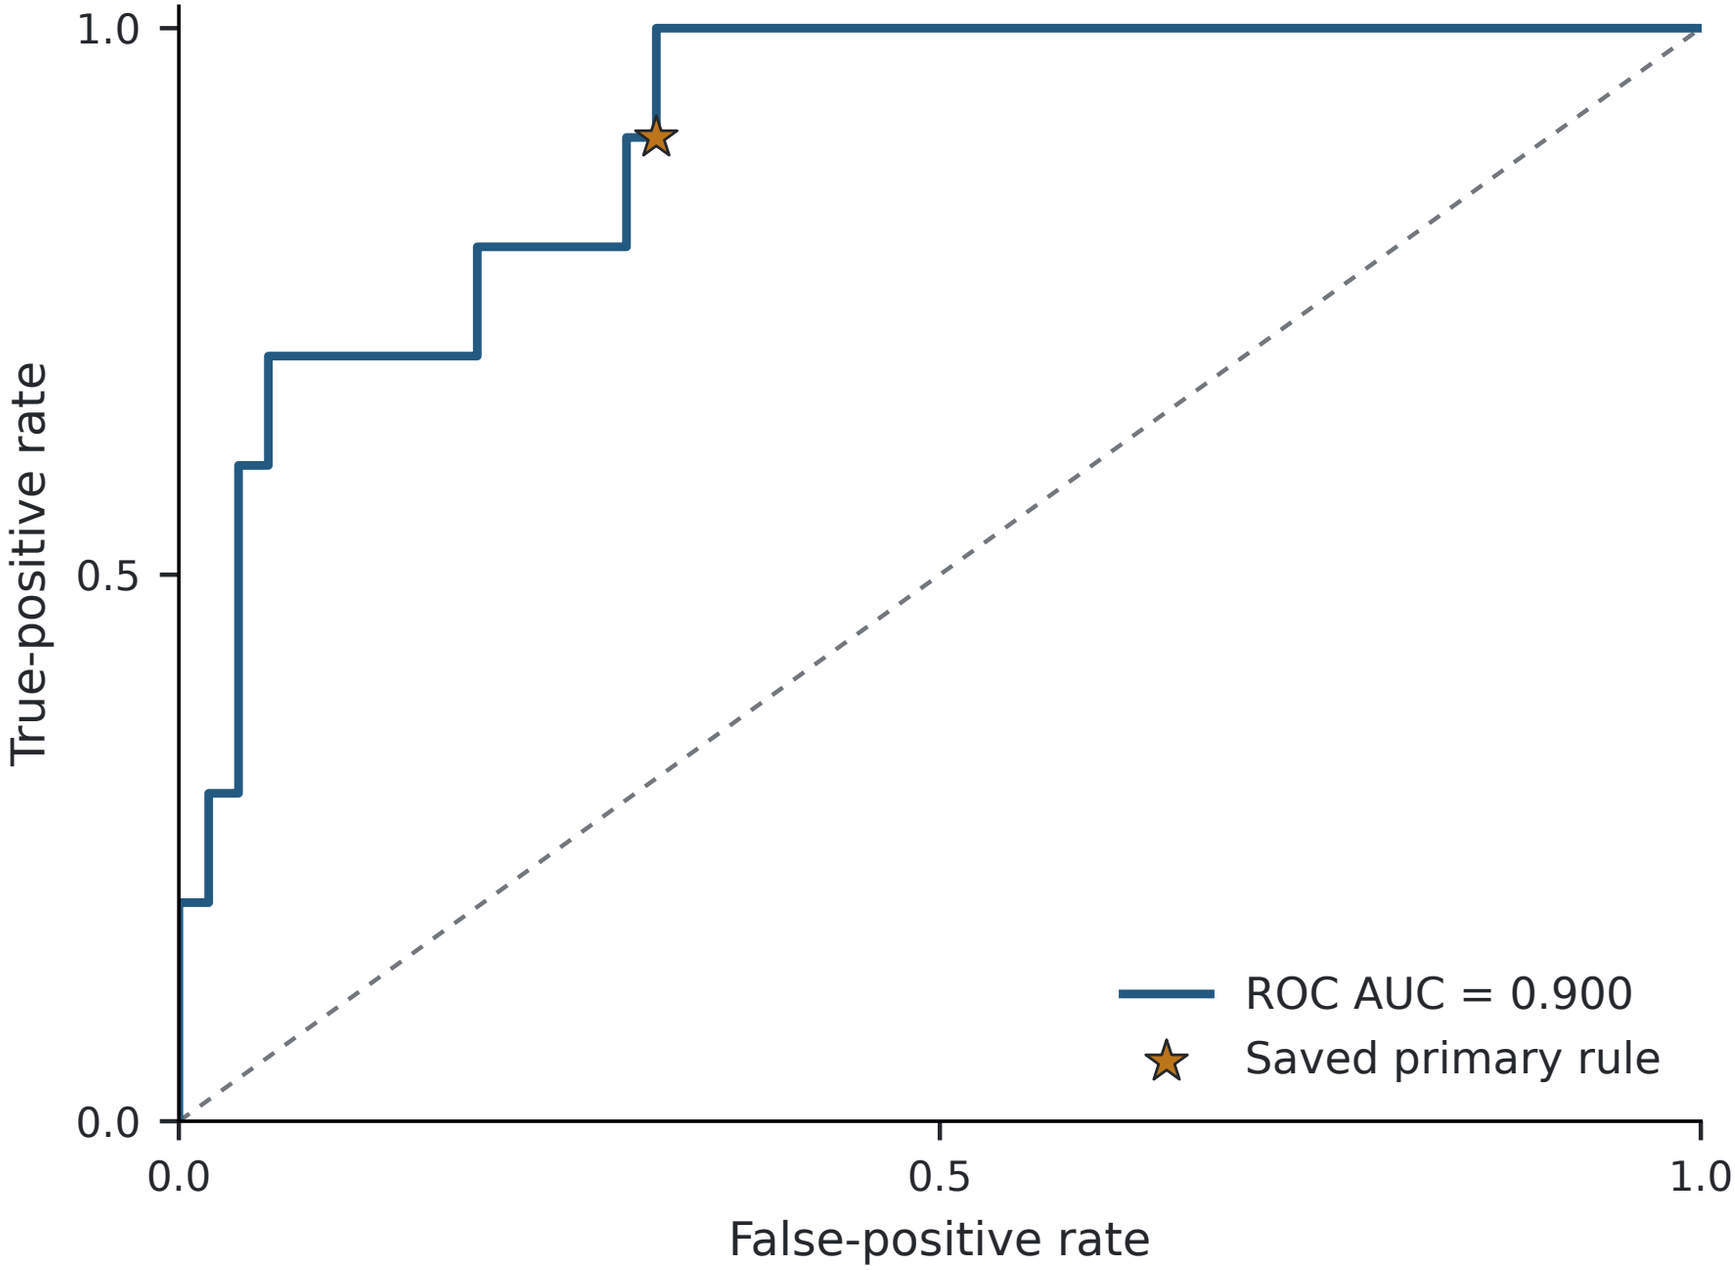

Primary cutoff: 0.0500 ppm

TP 9 | FP 16 | TN 35 | FN 1

Fixed structural labels and eligibility; all CSP cutoffs swept.
AUC measures binding-site localization of CSP magnitude.