2PLD | apo 5318 / holo 5310

HN CSP ROC | 98 eligible residues

Binding site: 15 | Distal: 83

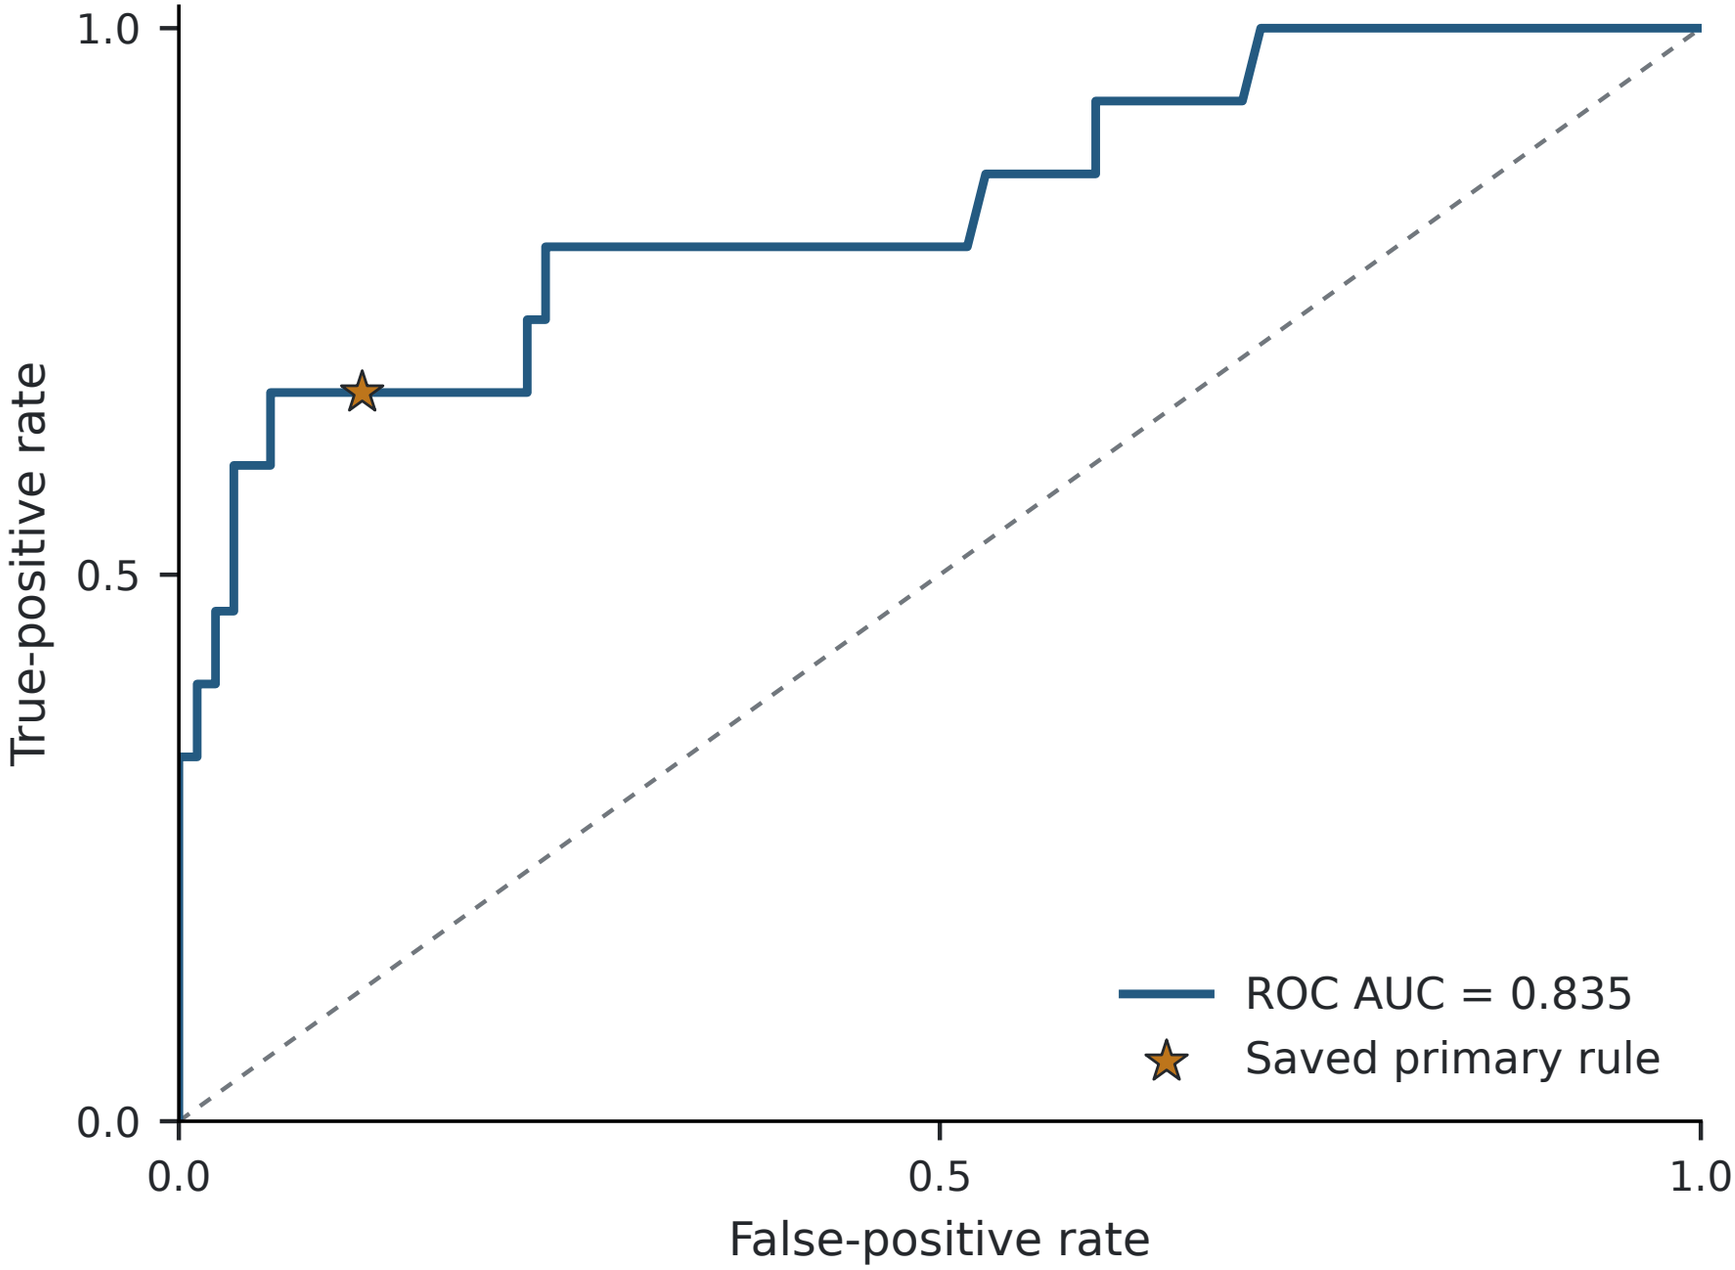

Primary cutoff: 0.0500 ppm

TP 10 | FP 10 | TN 73 | FN 5

Fixed structural labels and eligibility; all CSP cutoffs swept.
AUC measures binding-site localization of CSP magnitude.