2RQG | apo 4915 / holo 10019

HN CSP ROC | 75 eligible residues

Binding site: 13 | Distal: 62

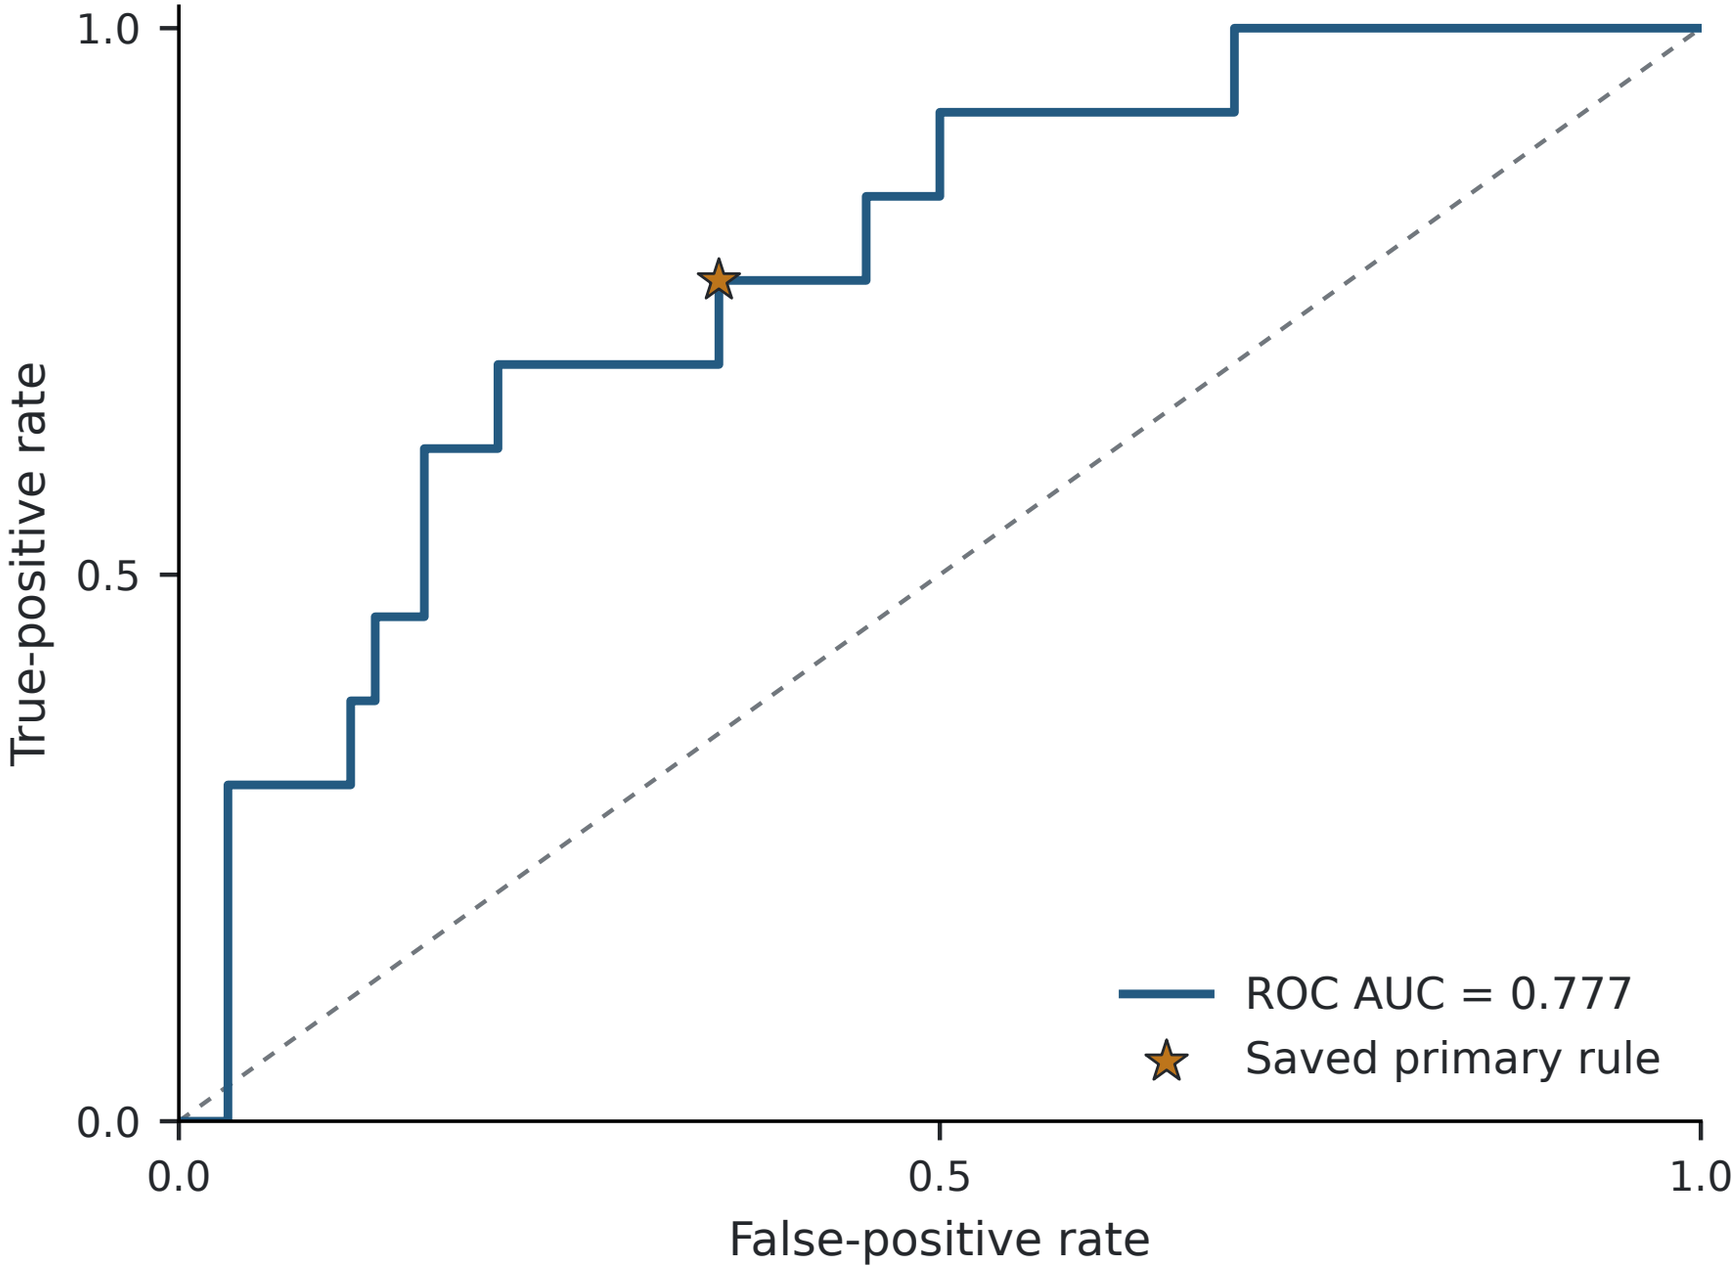

Primary cutoff: 0.0763 ppm

TP 10 | FP 22 | TN 40 | FN 3

Fixed structural labels and eligibility; all CSP cutoffs swept.
AUC measures binding-site localization of CSP magnitude.