2RR4 | apo 11362 / holo 11115

HN CSP ROC | 50 eligible residues

Binding site: 16 | Distal: 34

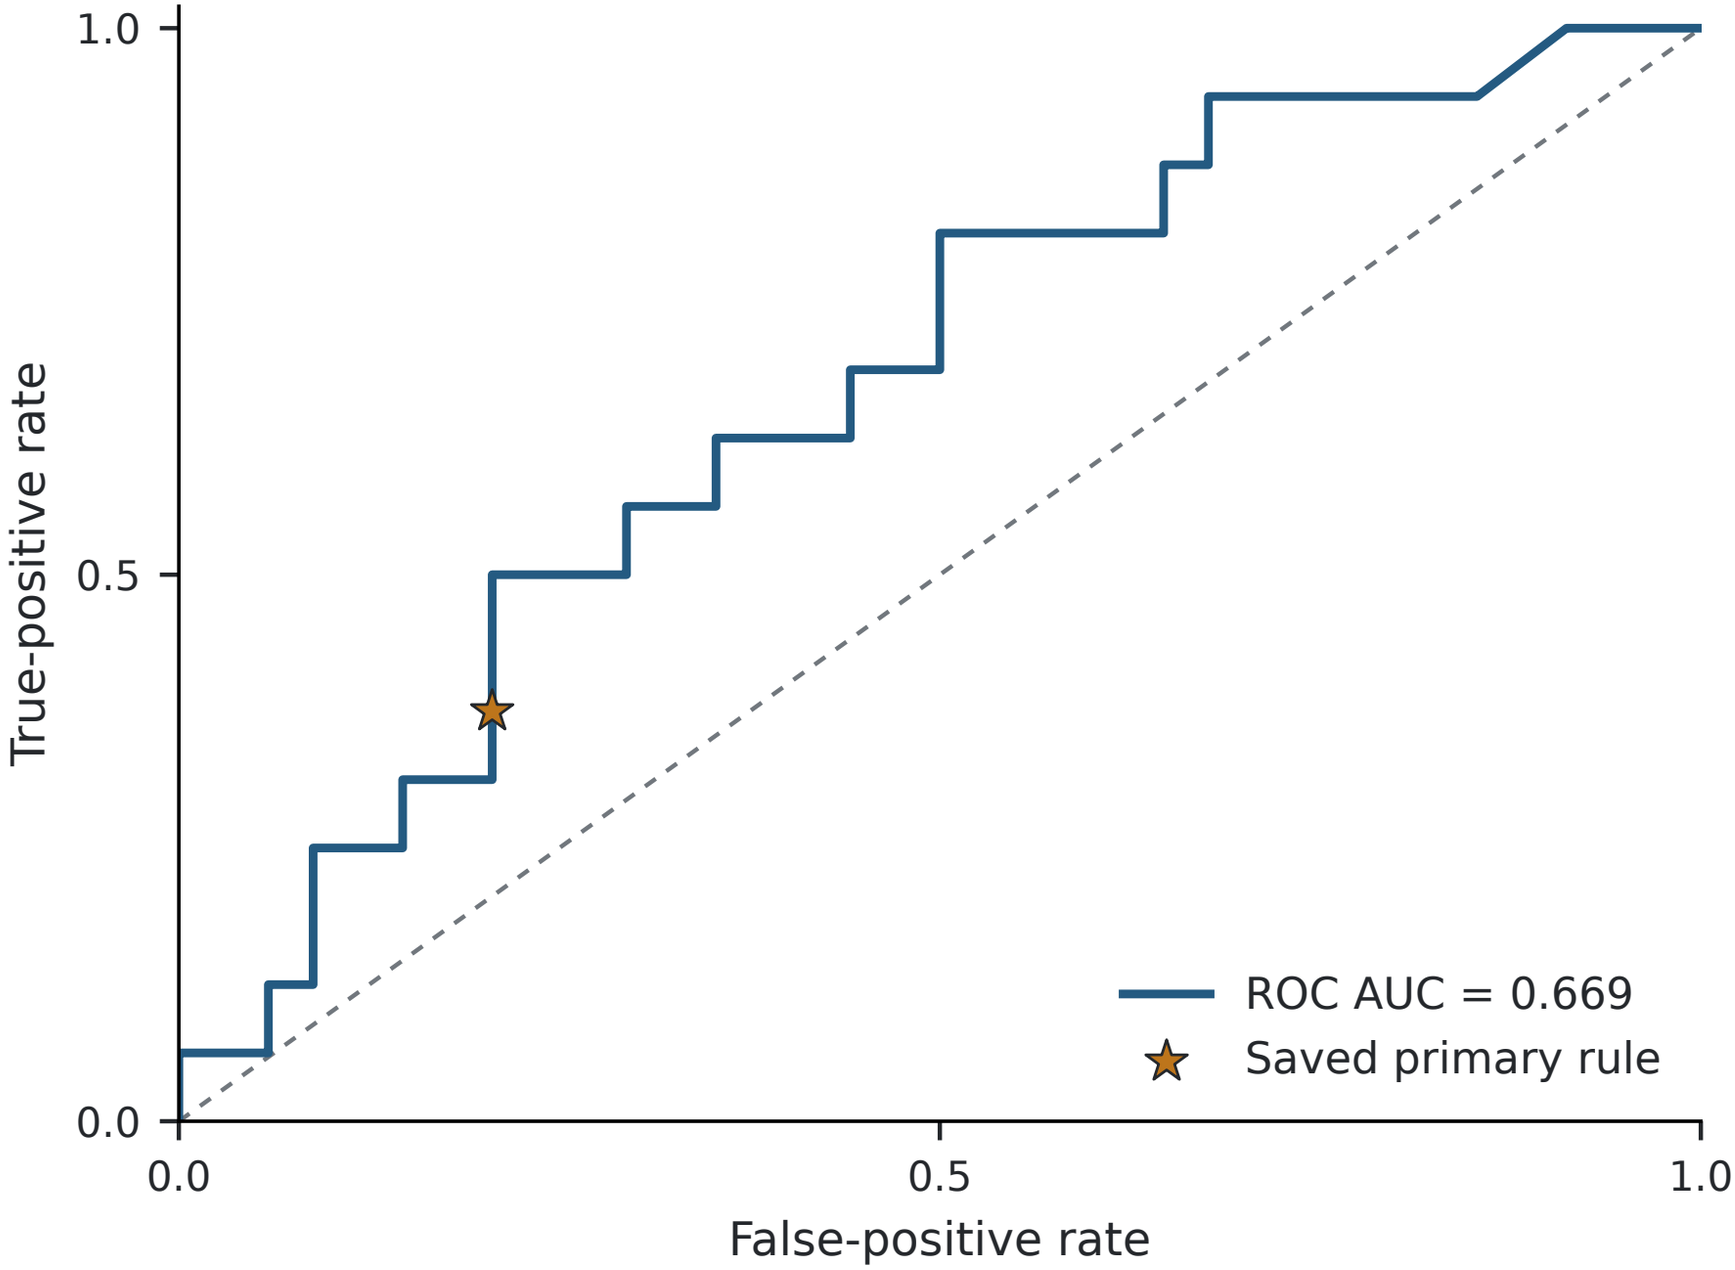

Primary cutoff: 0.0500 ppm

TP 6 | FP 7 | TN 27 | FN 10

Fixed structural labels and eligibility; all CSP cutoffs swept.
AUC measures binding-site localization of CSP magnitude.