2RUI | apo 16811 / holo 11570

HN CSP ROC | 136 eligible residues

Binding site: 12 | Distal: 124

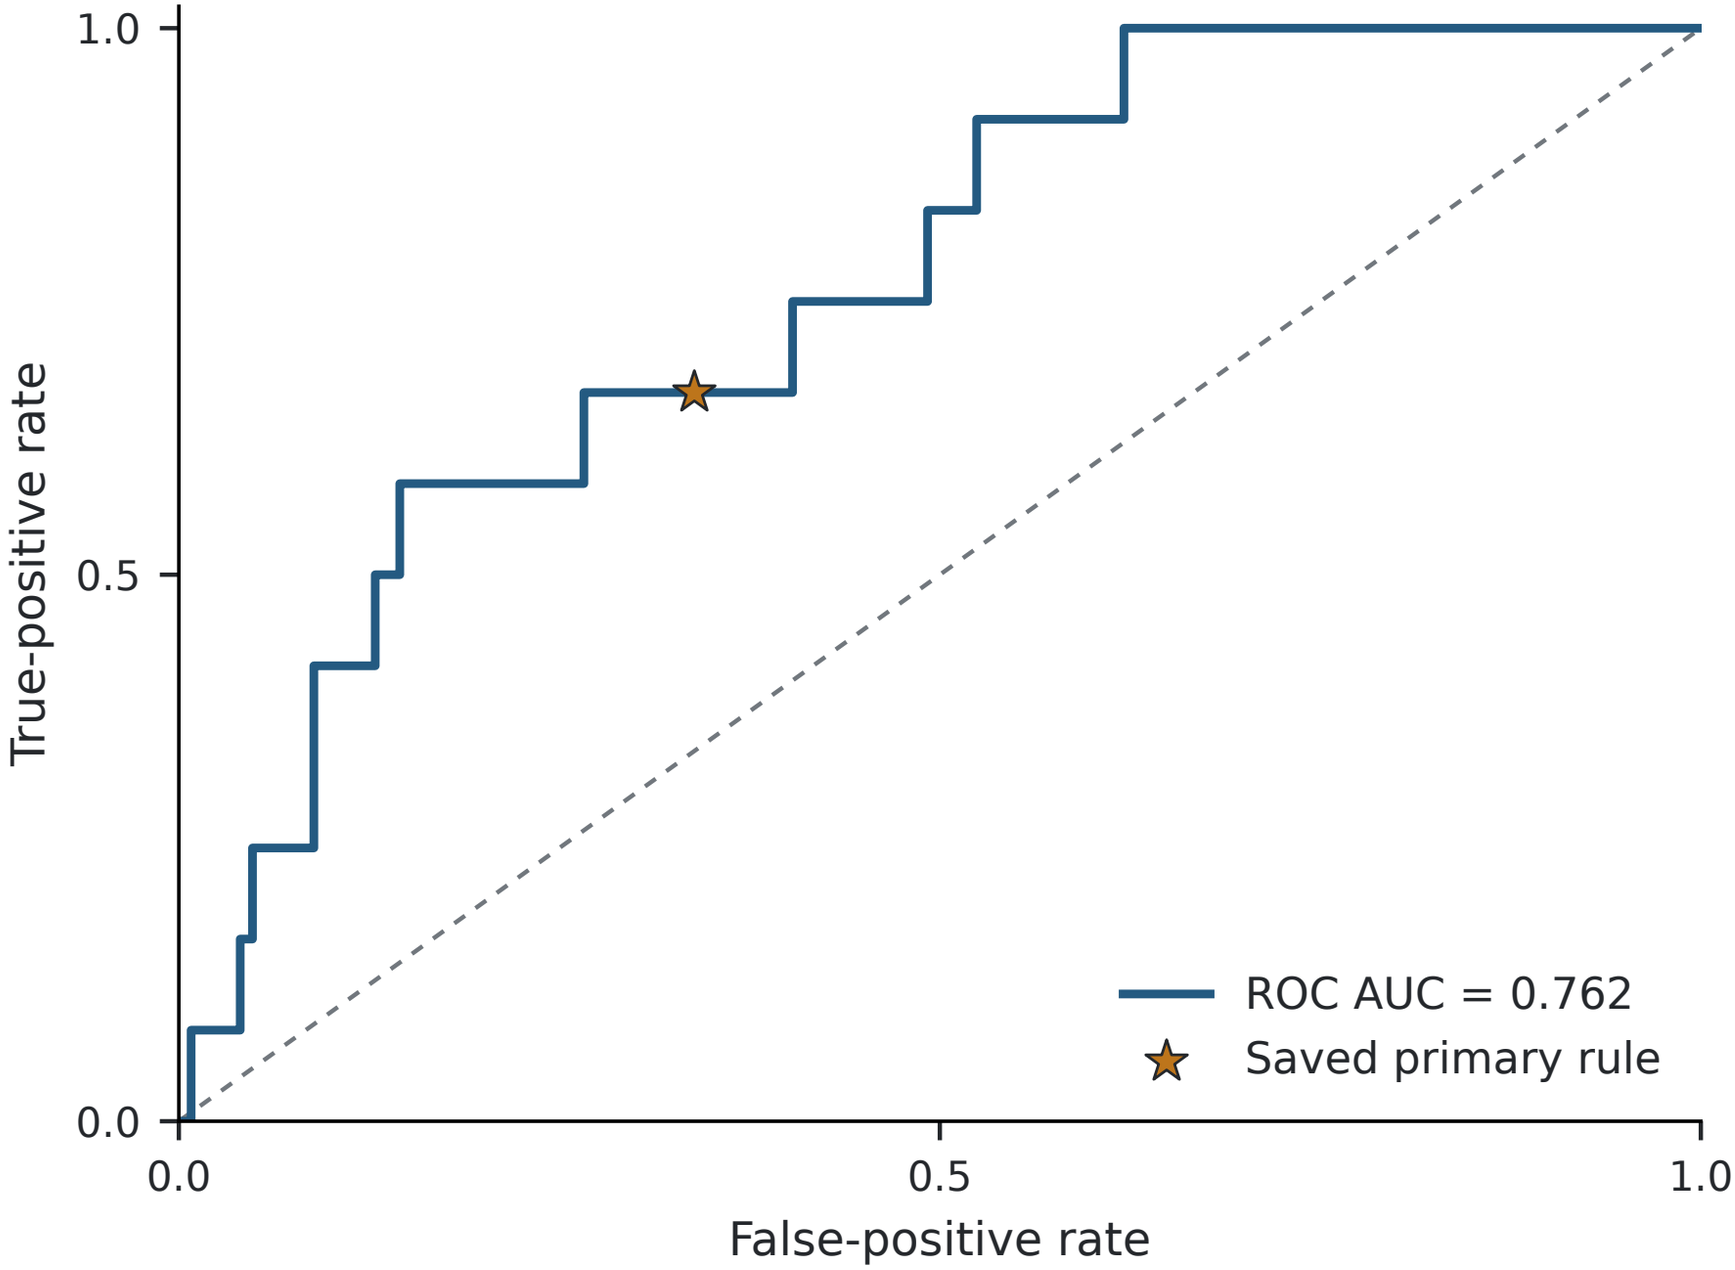

Primary cutoff: 0.0606 ppm

TP 8 | FP 42 | TN 82 | FN 4

Fixed structural labels and eligibility; all CSP cutoffs swept.
AUC measures binding-site localization of CSP magnitude.