# 2YKA | apo 16697 / holo 17693

HN CSP ROC | 111 eligible residues

Binding site: 15 | Distal: 96

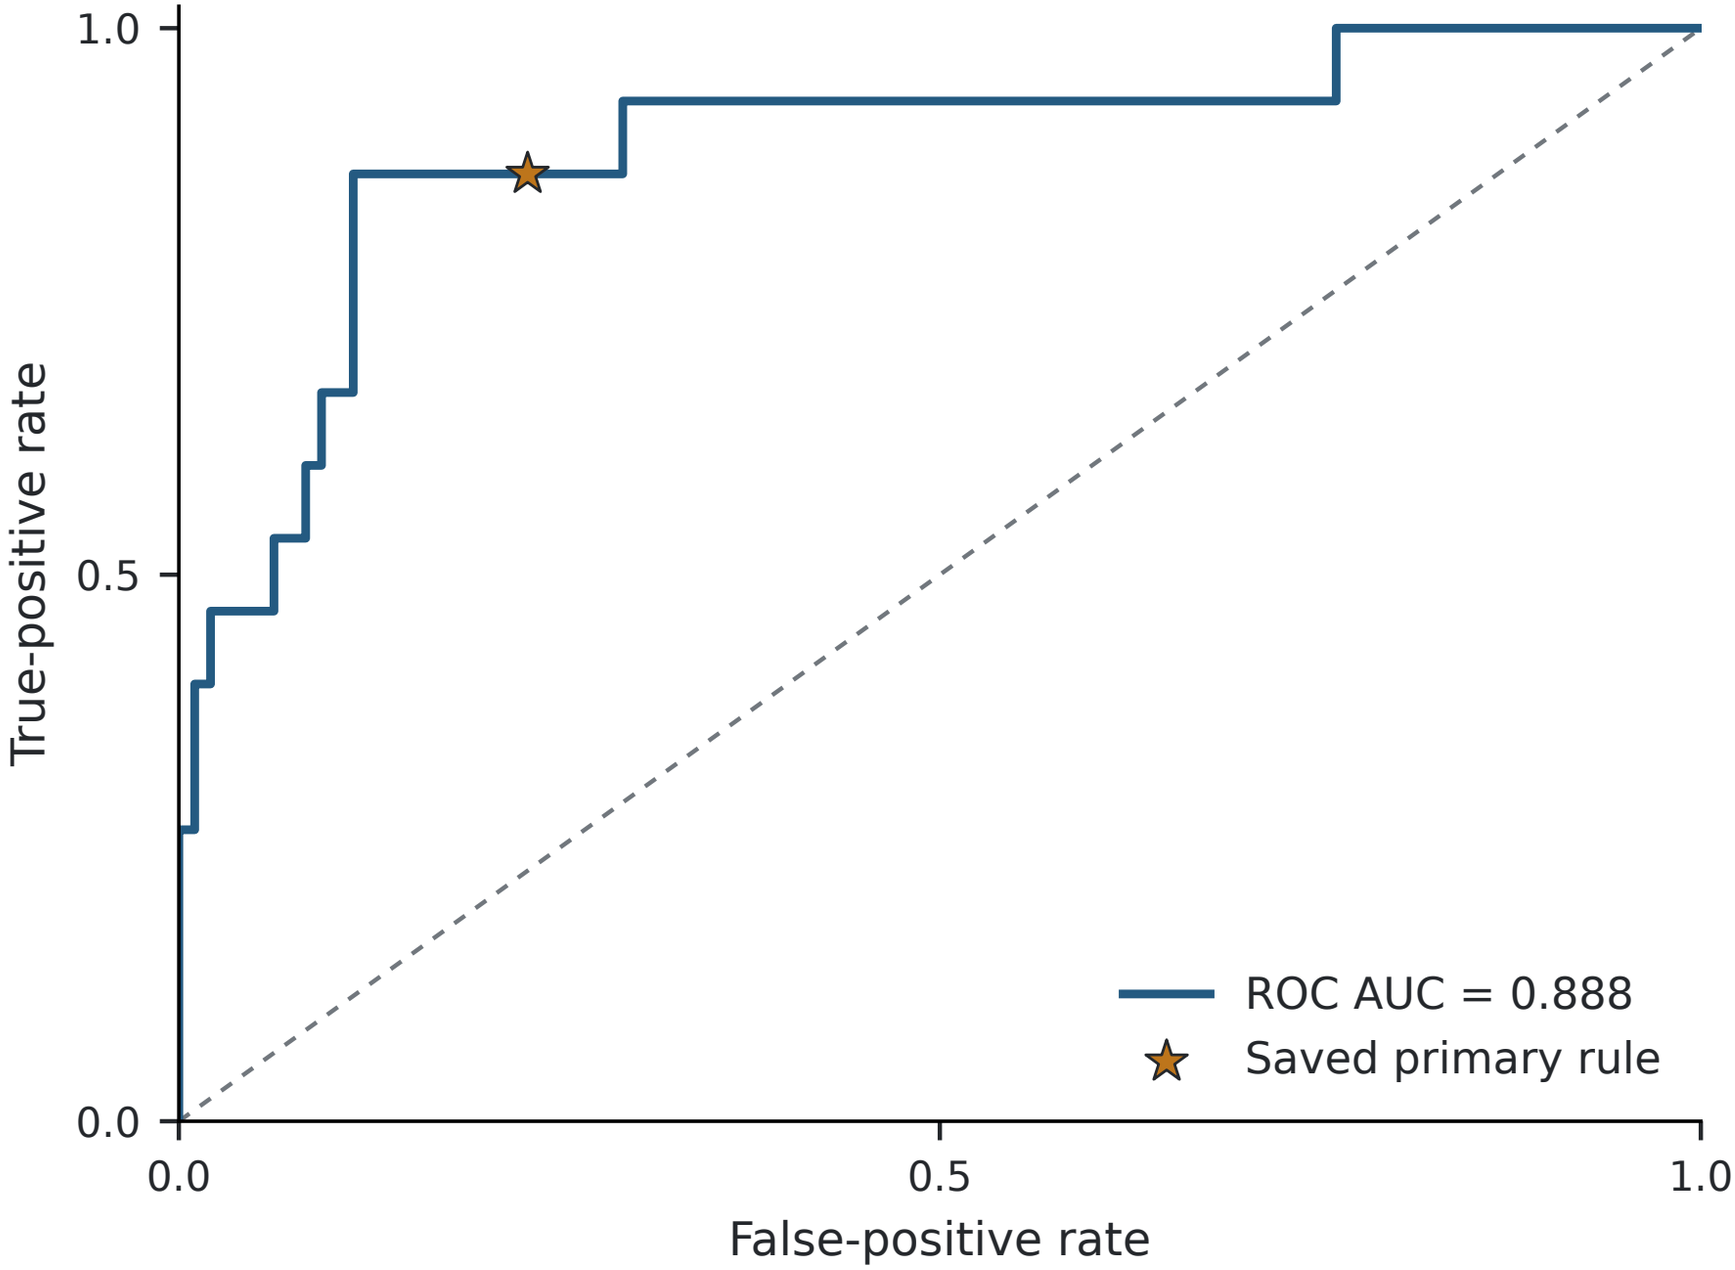


Primary cutoff: 0.0500 ppm

TP 13 | FP 22 | TN 74 | FN 2

Fixed structural labels and eligibility; all CSP cutoffs swept.
AUC measures binding-site localization of CSP magnitude.