2YS5 | apo 11095 / holo 11094

HN CSP ROC | 107 eligible residues

Binding site: 23 | Distal: 84

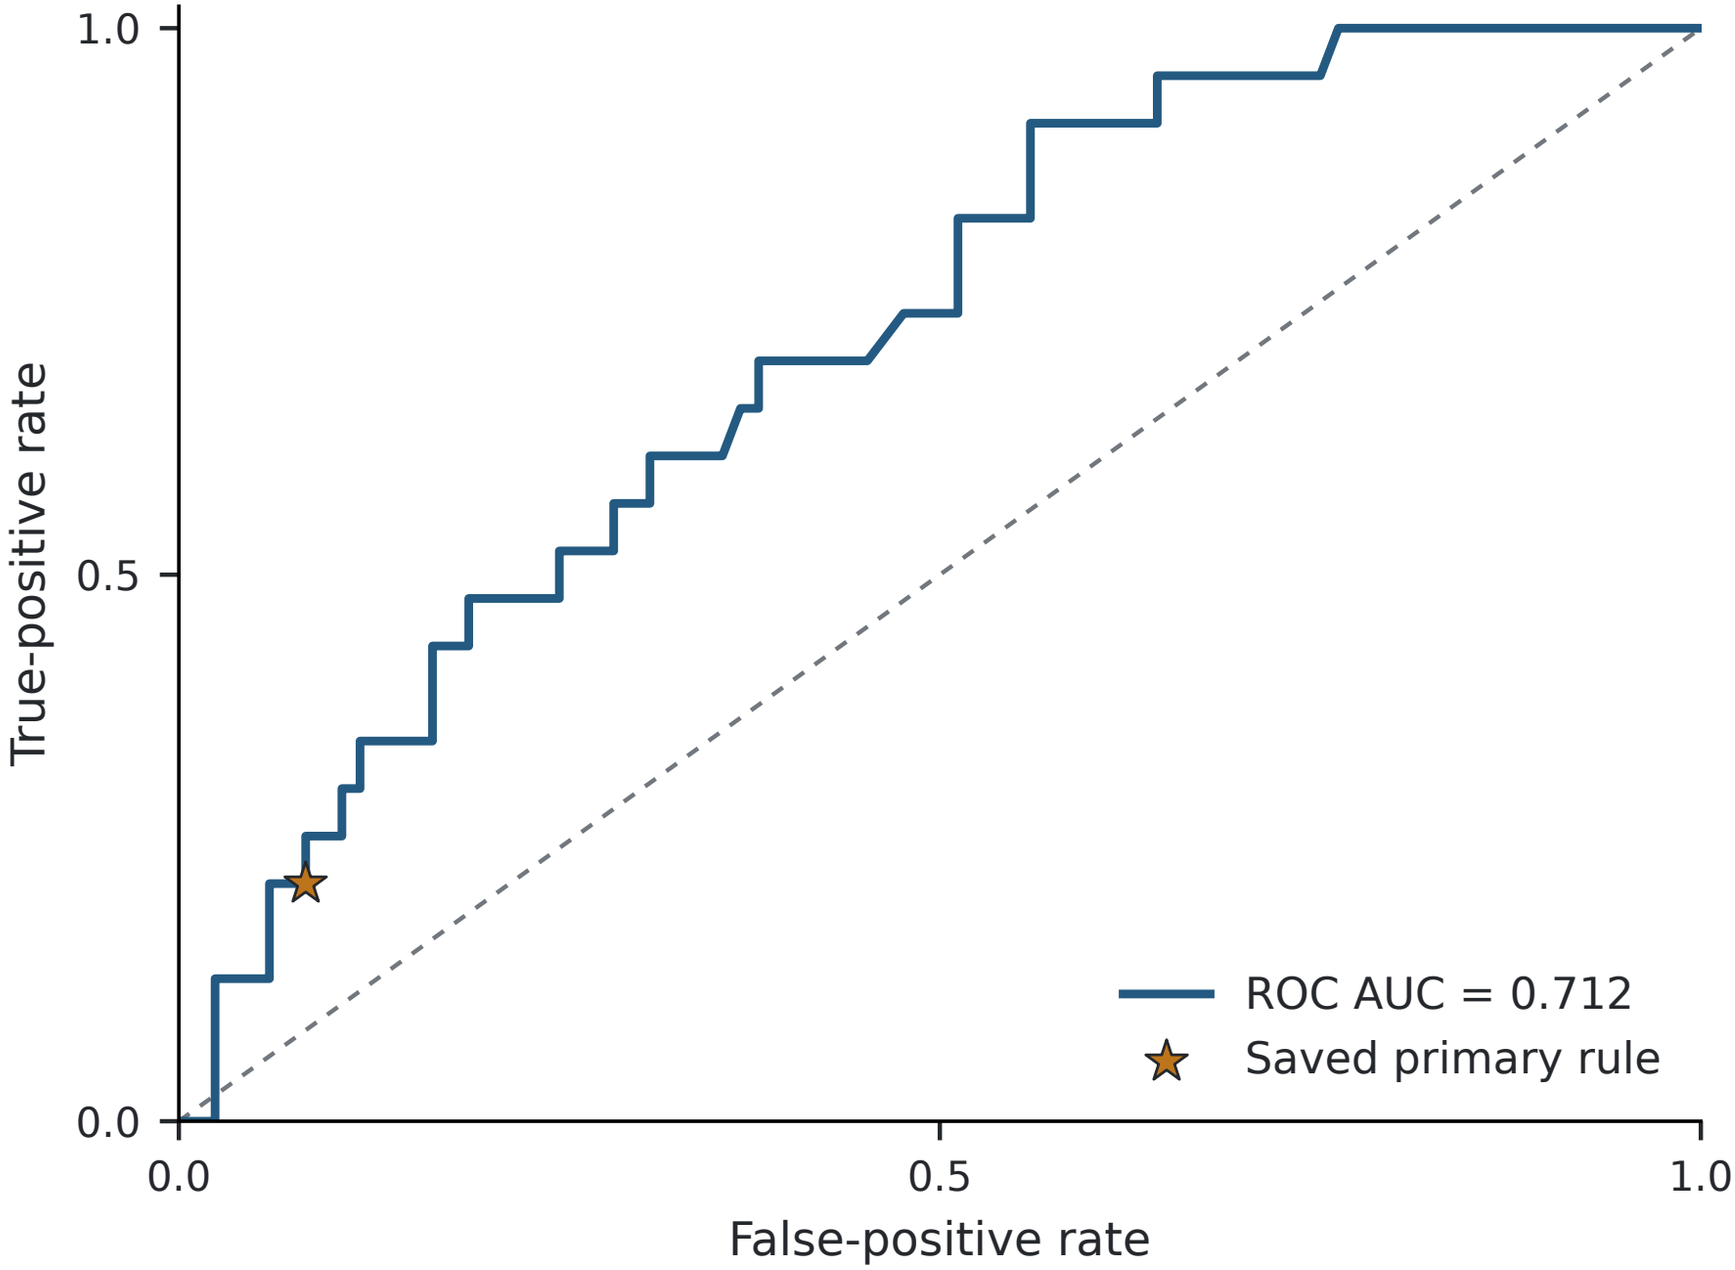

Primary cutoff: 0.0500 ppm

TP 5 | FP 7 | TN 77 | FN 18

Fixed structural labels and eligibility; all CSP cutoffs swept.
AUC measures binding-site localization of CSP magnitude.