5I22 | apo 4871 / holo 30010

HN CSP ROC | 72 eligible residues

Binding site: 12 | Distal: 60

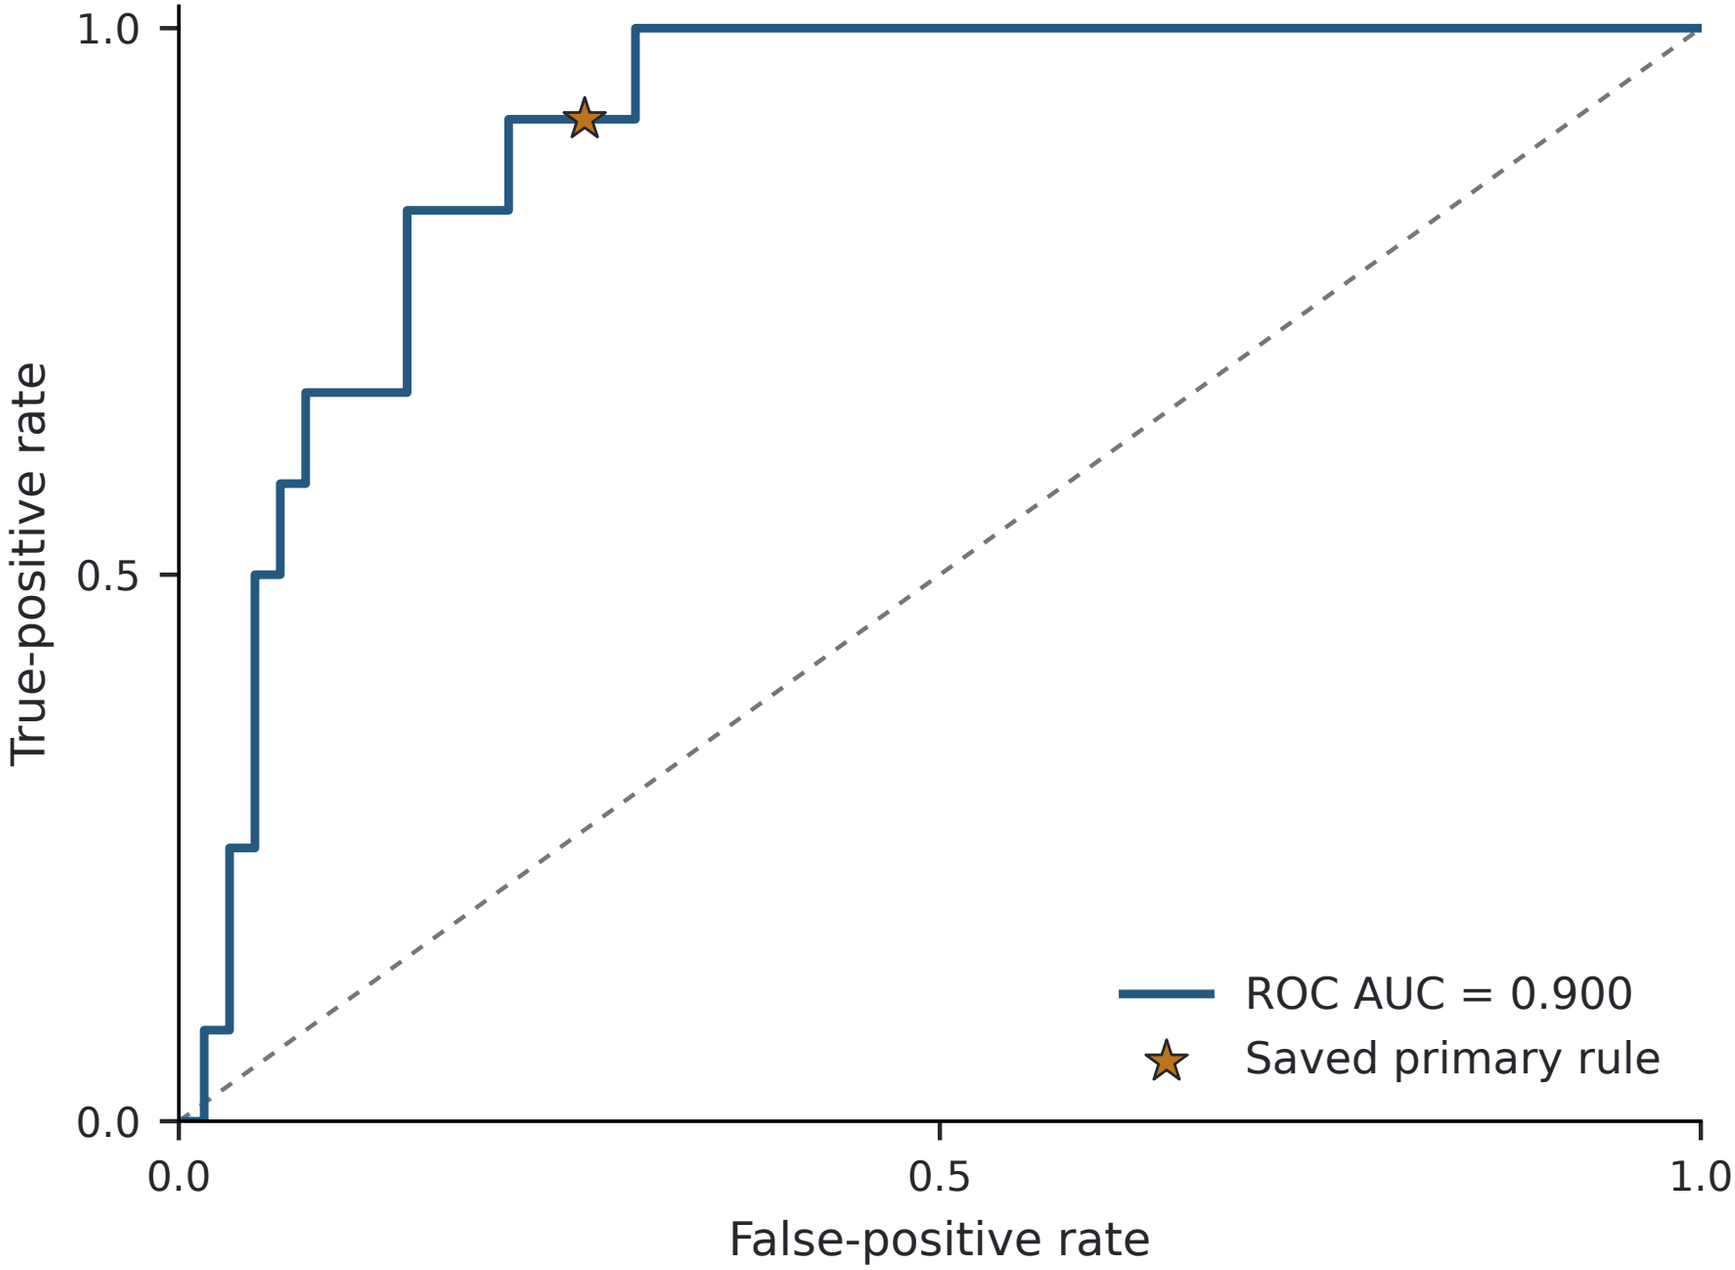

Primary cutoff: 0.0711 ppm

TP 11 | FP 16 | TN 44 | FN 1

Fixed structural labels and eligibility; all CSP cutoffs swept.
AUC measures binding-site localization of CSP magnitude.