6BGG | apo 30782 / holo 30367

HN CSP ROC | 74 eligible residues

Binding site: 8 | Distal: 66

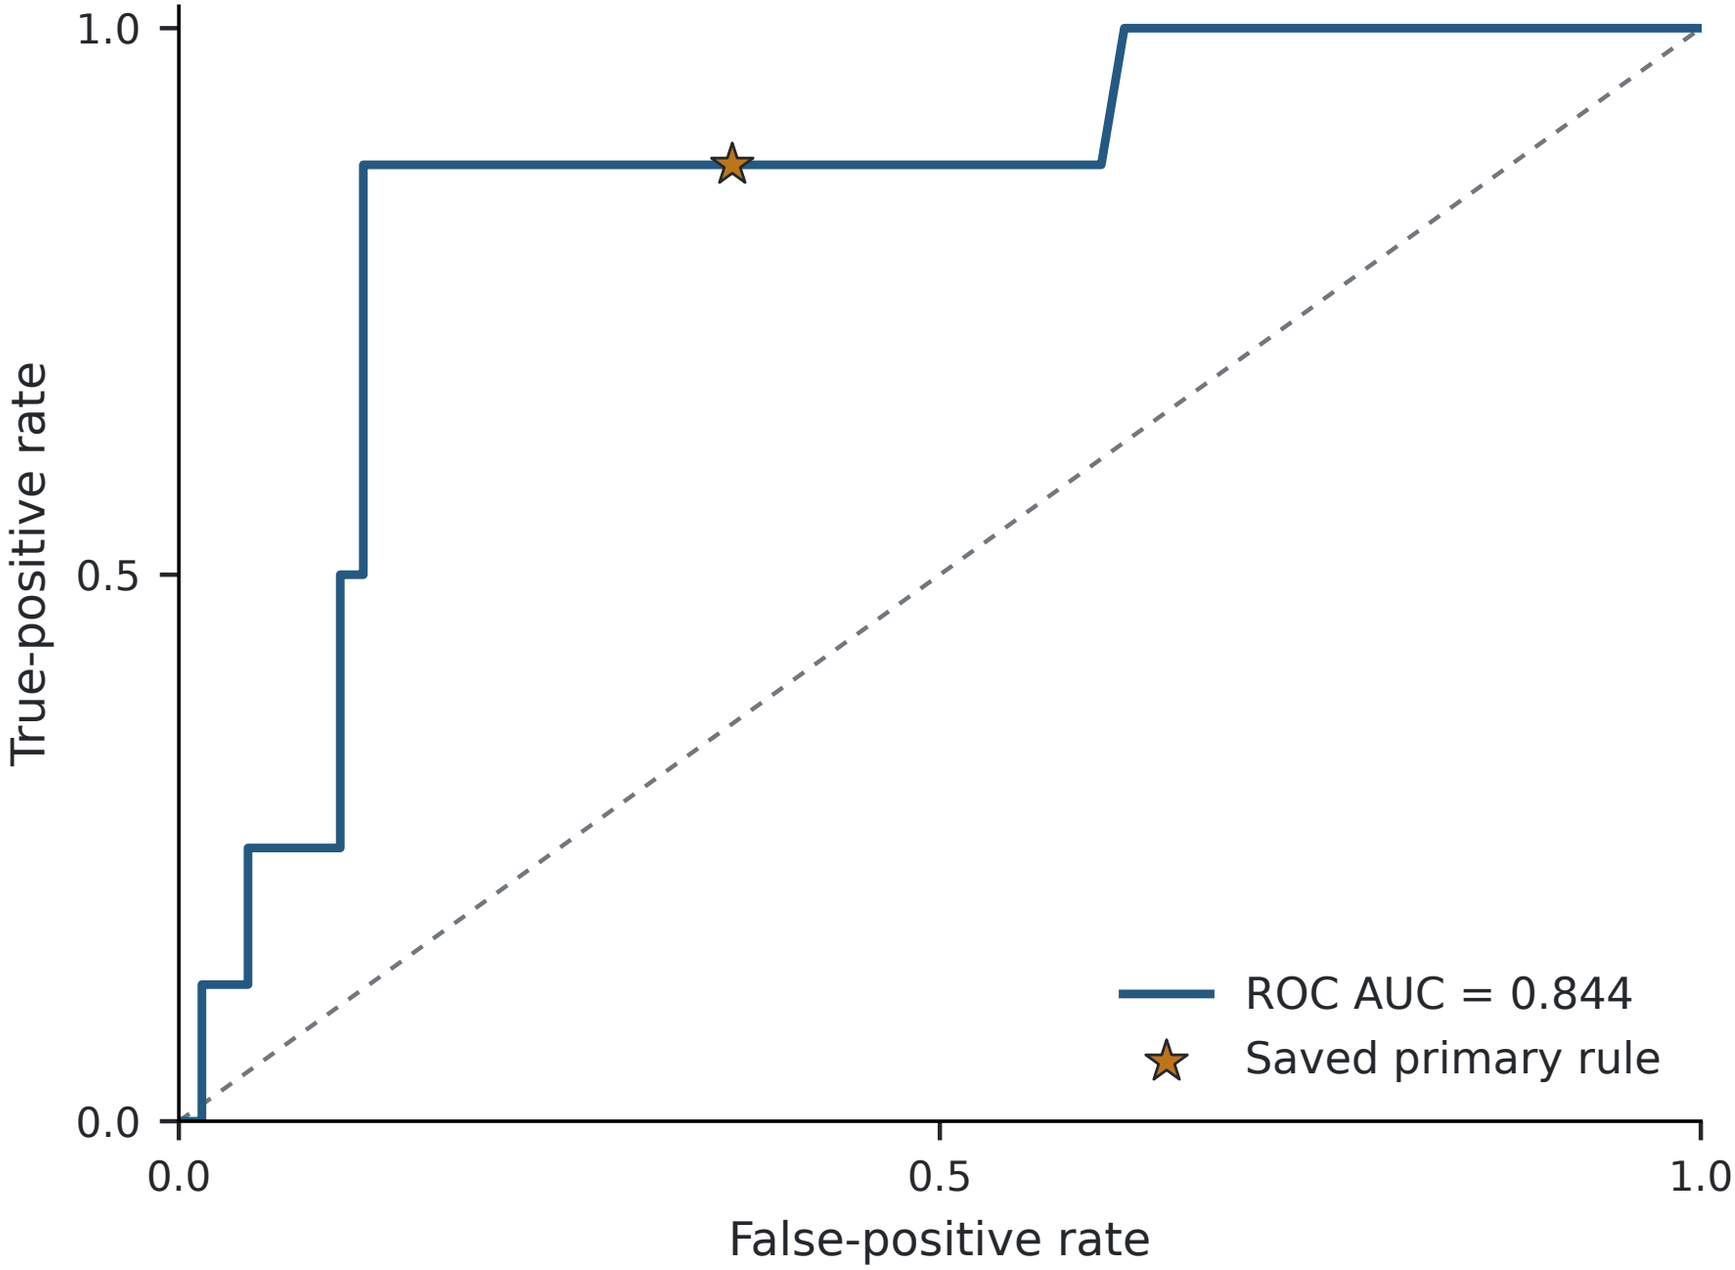

Primary cutoff: 0.0893 ppm

TP 7 | FP 24 | TN 42 | FN 1

Fixed structural labels and eligibility; all CSP cutoffs swept.
AUC measures binding-site localization of CSP magnitude.