6FDP | apo 19757 / holo 34223

HN CSP ROC | 116 eligible residues

Binding site: 18 | Distal: 98

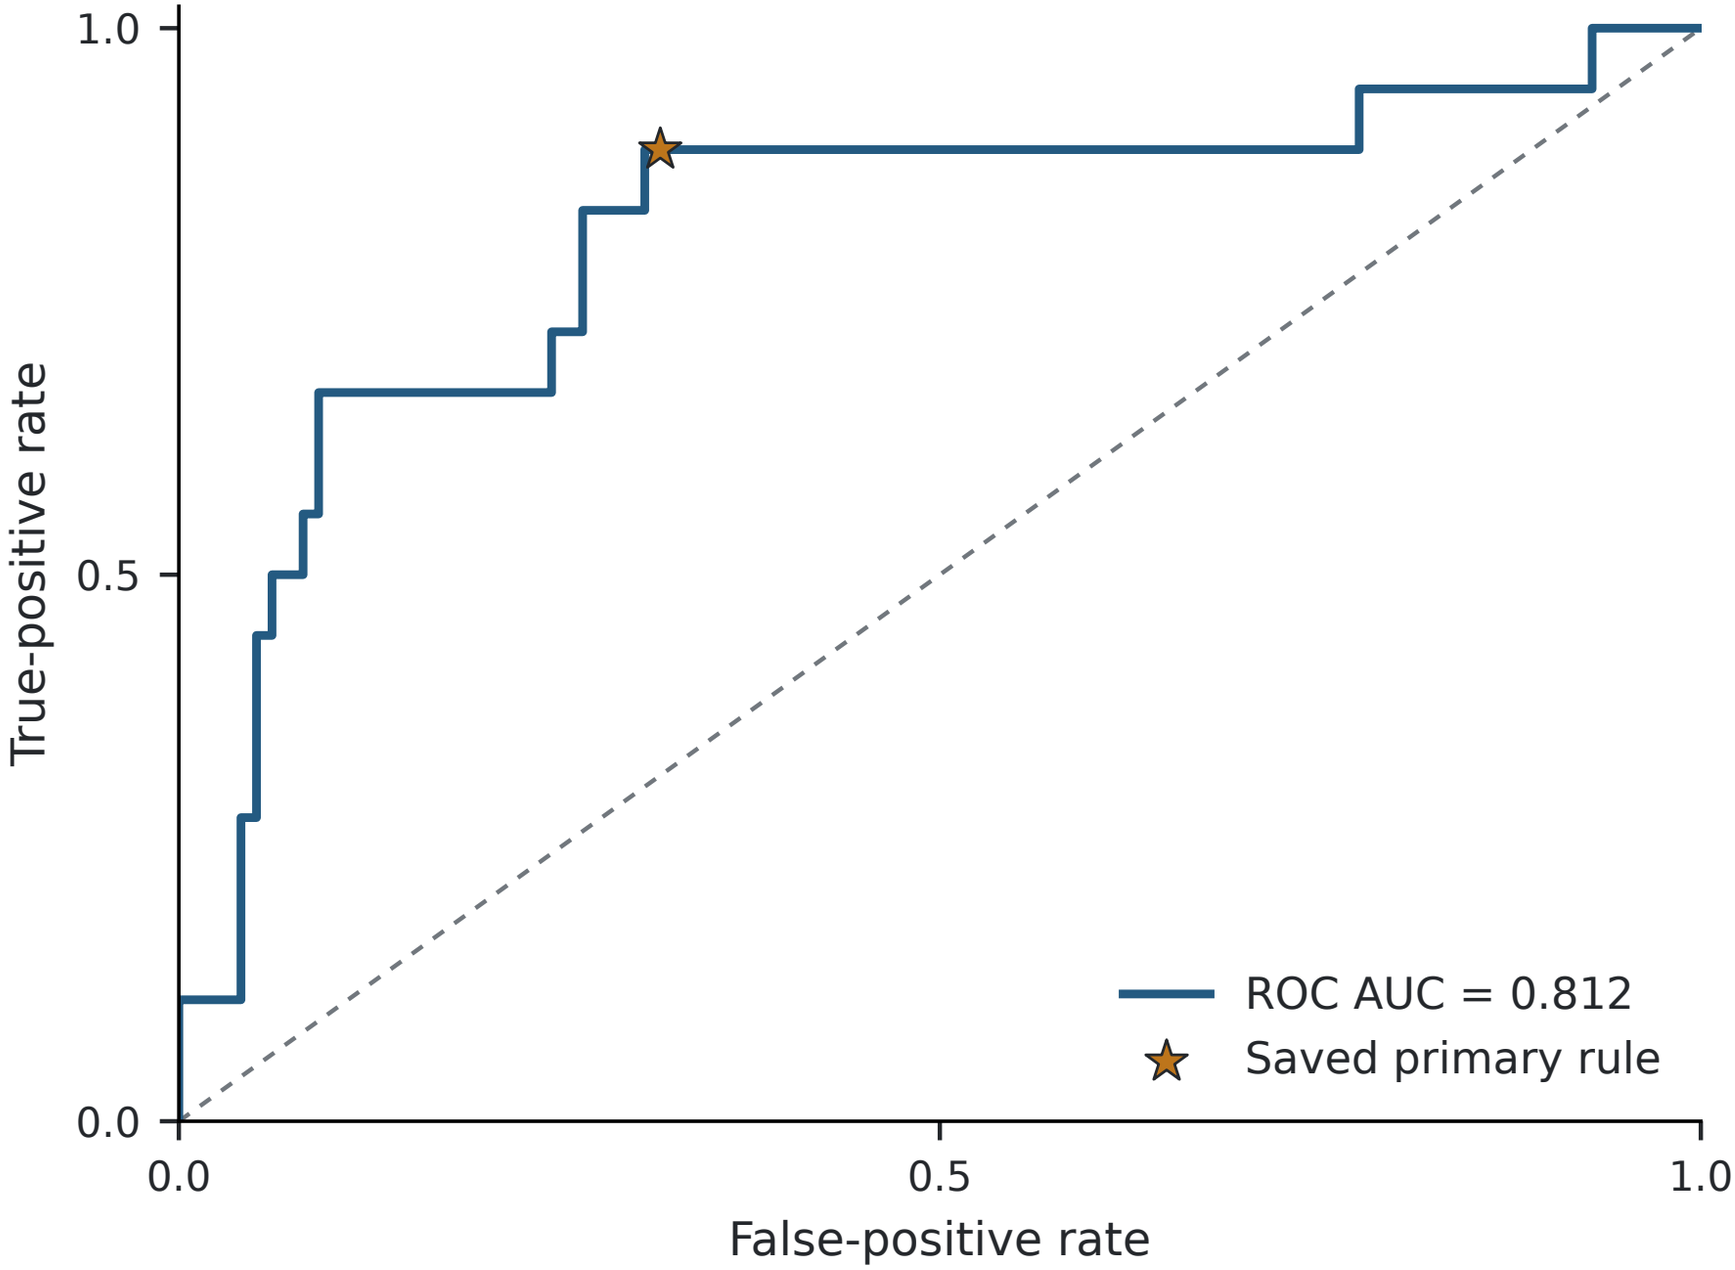

Primary cutoff: 0.0576 ppm

TP 16 | FP 31 | TN 67 | FN 2

Fixed structural labels and eligibility; all CSP cutoffs swept.
AUC measures binding-site localization of CSP magnitude.