6FDT | apo 19757 / holo 34224

HN CSP ROC | 116 eligible residues

Binding site: 12 | Distal: 104

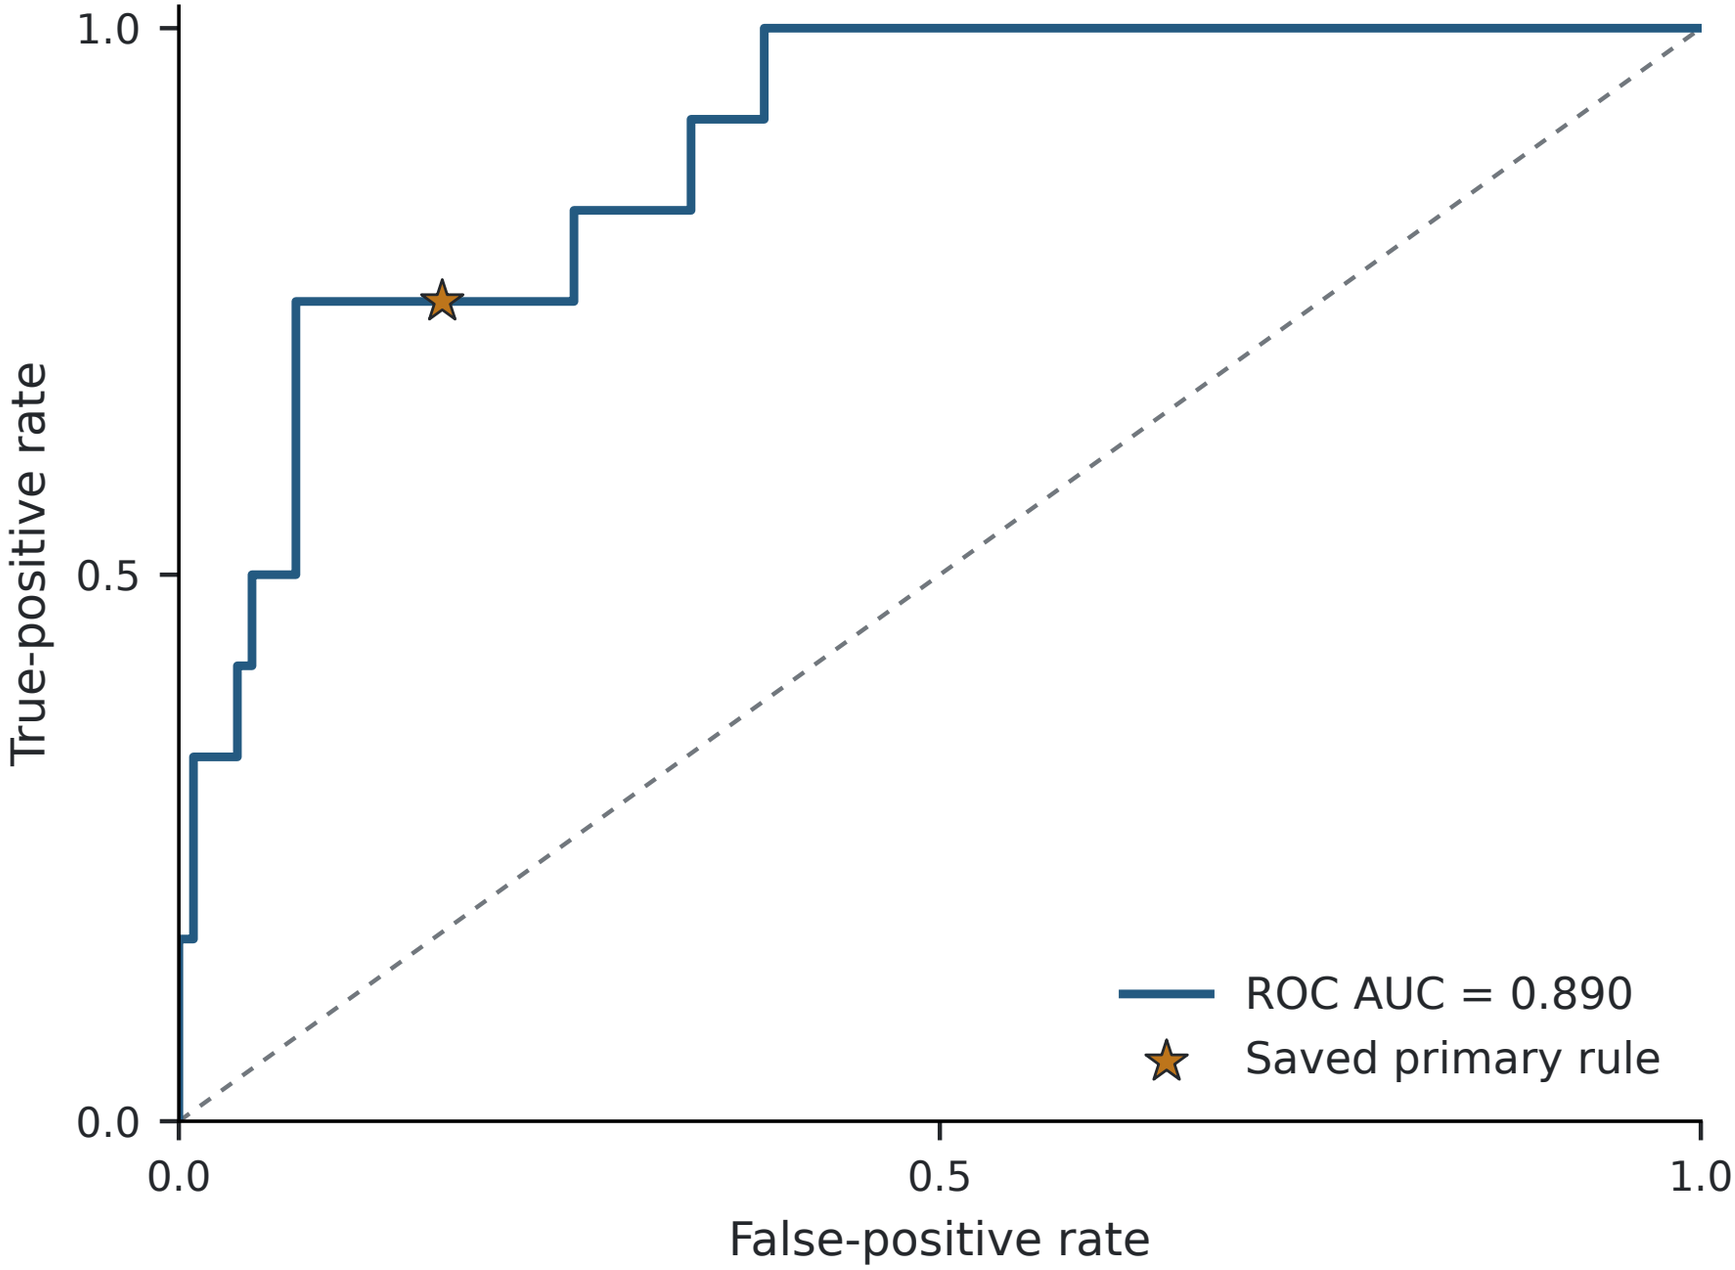

Primary cutoff: 0.0500 ppm

TP 9 | FP 18 | TN 86 | FN 3

Fixed structural labels and eligibility; all CSP cutoffs swept.
AUC measures binding-site localization of CSP magnitude.